


SEDM-L

Multi compartment smoke control damper

Technical Documentation

Installation, Commissioning, Operation, Maintenance and Service Manual

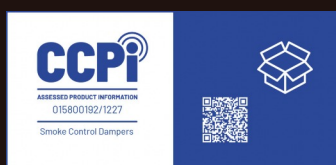

MANDÍK®

www.mandik.com

These technical specifications state a row of manufactured sizes, main dimensions, design and range of use of multi compartment smoke control dampers SEDM-L.

It is valid for production, design, ordering, delivery, storage, assembly, operation, maintenance and serviceability checks.

CONTENT

I. GENERAL.....3

 Description.....3

II. DESIGN.....5

 Design with actuating mechanism.....5

III. DIMENSIONS.....9

 Technical parameters.....12

IV. INSTALLATION.....15

 Placement and installation.....15

 Transport of the damper to the installation place and the installation procedure.....17

 Statement of installations.....22

 In solid wall construction.....23

 In gypsum wall construction.....28

 In shaft wall construction.....30

 In solid ceiling construction.....31

 Installation damper into/onto smoke extraction ducts.....32

V. SUSPENSION SYSTEMS.....38

 Example of duct connection.....41

VI. TECHNICAL DATA.....42

 Pressure loss.....42

 Noise data - level of acoustic output corrected with filter A.....47

VII. MATERIAL, FINISHING.....51

VIII. TRANSPORTATION, STORAGE AND WARRANTY.....51

 Logistic terms.....51

 Warranty.....51

IX. ASSEMBLY, ATTENDANCE AND MAINTENANCE.....51

 Electrical connection of the actuator in protection box.....52

 Entry into service and revisions.....53

X. ORDERING INFORMATION.....54

 Ordering key.....54

 Accessories.....55

 Data label.....55

I. GENERAL

Description

Smoke control dampers - SEDM-L are designed into an inlet or extract smoke ventilation system. The dampers are designed either to close to provide compartmentalization or to open (for fresh air inlet) or to allow removal of the heat and combustible products from a fire in the affected fire zone/compartment.

The damper blade is controlled by electrical actuating mechanism.

Dampers are fire resistant and are intended for systems with manual or automatic activation.

Dampers are designed for using in fire compartments that can be connected to the smoke exhaust ducts (tested according to EN 1366-8) or they can be installed in or on the construction of the fire compartment.



Damper characteristics

- CE certified acc. to EN 12101-8
- Tested in accordance with EN 1366-10
- Classified acc. to EN 13501-4
- External Casing leakage class ATC 3 (old marking "C")
- Internal leakage min. class 3 acc. to EN 1751
- Cycling test in class C_{mod} acc. to EN 12101-8
- Certificate of constancy of performance No. 1391-CPR-XXXX/XXXX
- Declaration of Performance No. PM/SEDM-L/01/XX/X
- Hygienic assessment - Report No. 1.6/pos/19/19b

Classification of Dampers

Supporting construction	Installation type	Classification
Horizontal or vertical smoke extraction ducts tested according to EN 1366-8 or EN 1366-9 into/onto the duct	Damper installed into a duct or onto a duct with grille	EI120(V _{edw})S1000[H]C _{mod} HOT400/30MAmulti
	Damper installed onto a duct without grille	EI90(V _{edw})S1000[H]C _{mod} HOT400/30MAmulti
Standard low- and high-density rigid wall construction according to EN 1363-1 - damper in the wall or shaft wall 100 mm min. wall thickness	Ablative Coated Batt	EI90(V _{edw})S1000[H]C _{mod} HOT400/30MAmulti
	Mortar or gypsum	EI120(V _{edw})S1000[H]C _{mod} HOT400/30MAmulti
Standard flexible wall construction, min. EI90. according to EN 1363-1 - damper in the wall or shaft wall 100 mm min. wall thickness	Ablative Coated Batt	EI90(V _{edw})S1000[H]C _{mod} HOT400/30MAmulti
	Mortar or gypsum	EI120(V _{edw})S1000[H]C _{mod} HOT400/30MAmulti
Non-standard asymmetrical shaft wall construction, min. EI120, made of gypsum plasterboards (3 × 15 mm and 1 × 19 mm) with steel studs - damper in the wall or shaft wall 107 mm min. wall thickness	Mortar or gypsum	EI90(V _{edw})S1000[H]C _{mod} HOT400/30MAmulti EI120(V _{edw})S1000[H]C _{mod} HOT400/30MAmulti
Standard low- and high-density rigid floor construction according to EN 1366-2 - damper in the shaft floor 150 mm min. wall thickness	Mortar or gypsum	EI90(H _{od})S1000[H]C _{mod} HOT400/30MAmulti EI120(H _{od})S1000[H]C _{mod} HOT400/30MAmulti

Working conditions

- Exact damper function is provided under the following conditions
 - maximum air velocity 12 m/s
 - underpressure max. -1000 Pa or overpressure max. 500 Pa
- Dampers are designed for installation in vertical or horizontal openings of fire separating constructions.
- The damper shall be installed only with the blade axes oriented horizontally.
- Dampers are designed for macroclimatic areas with mild climate according to EN IEC 60 721-3-3 ed.2., class 3K22. (Environment 3K22 is typically protected place with regulated temperature)
- Temperature in the place of installation is permitted to range from -30 °C to +50 °C.


Smoke and heat removal system

- In normal operation, SEDM-L dampers remain closed.
- If necessary, in the event of a fire, the SEDM-L dampers in the affected fire section will open completely so that the smoke can be removed.
- When the smoke and heat removal dampers are activated, the dampers used for air supply in the affected section open.
- The dampers used to supply air in the affected fire section are installed at the ground.
- The dampers are controlled from the central control system on the basis of signals, e.g. from smoke detectors.
- The use of cables with a certain fire resistance for the supply voltage ensures that the actuator is supplied even in the event of a fire.

Ventilation system

- During ventilation, SEDM-L dampers in the smoke and heat extraction system are controlled by a control system, it's possible to fully open, close or continuously control the flow.
- The SEDM-L dampers, which are used for air supply, remain closed during ventilation.

Example of a ventilation device for forced smoke and heat removal

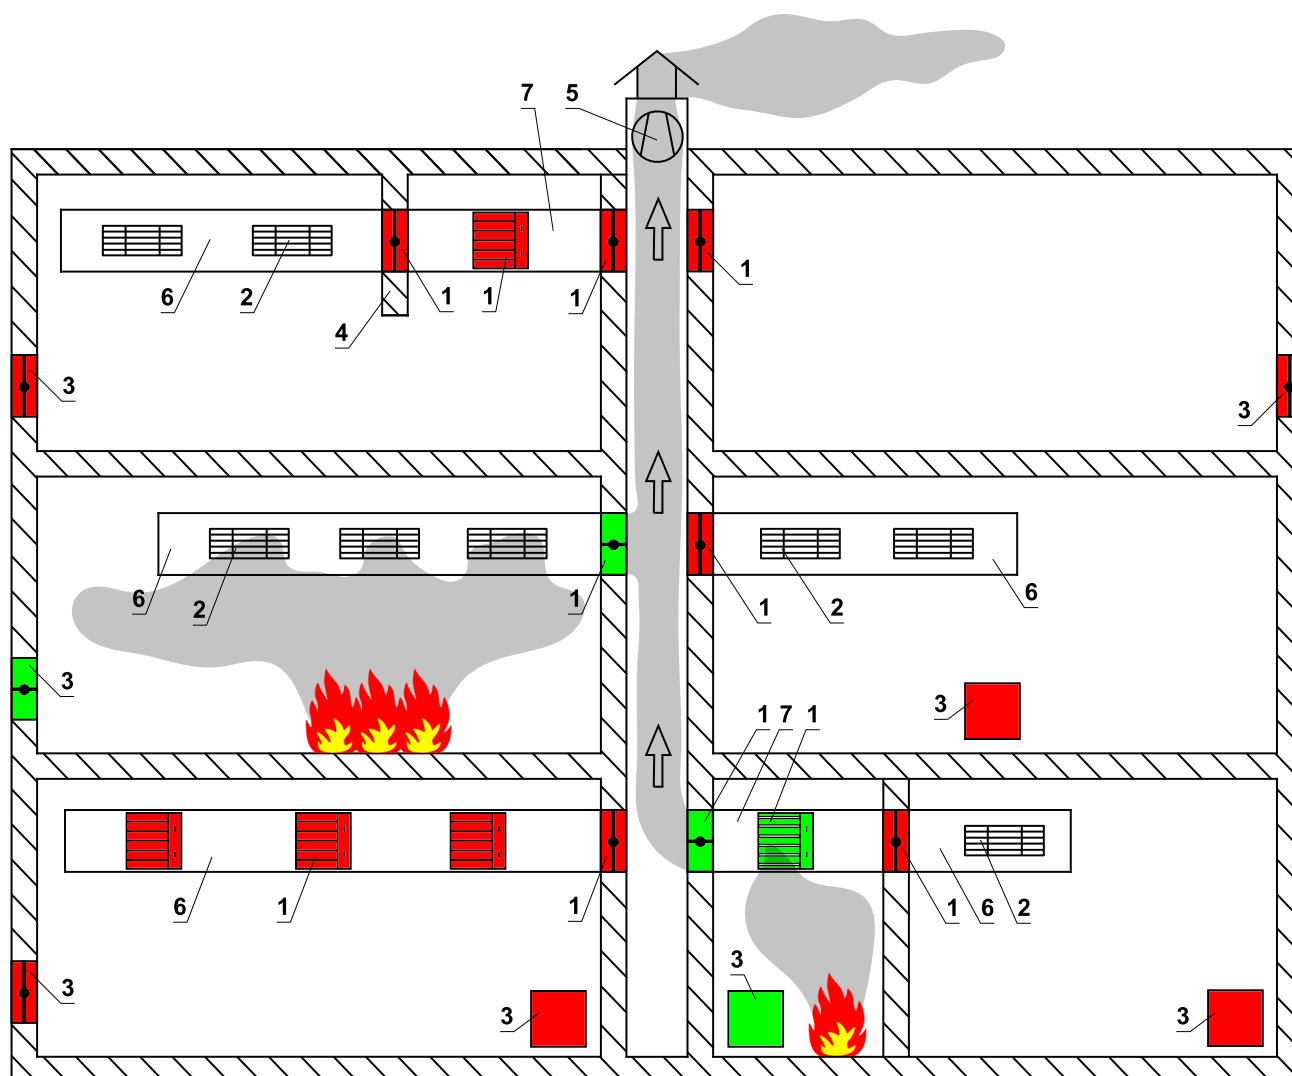

- 1 Multi compartment smoke control damper
- 2 Ventilation grille or damper for smoke and heat removal from one section
- 3 Air inlet
- 4 Smoke barrier
- 5 Fan for forced smoke and heat removal
- 6 Duct for smoke extraction from one section
- 7 Multi-section smoke extraction duct

II. DESIGN



Design with actuating mechanism

Design .44 and .54


- Belimo actuators are used for dampers, series BEN, BEE, BE for 230V AC resp. 24 V AC/DC actuators (universal 24V or 230V supply) are used for large size of dampers.
- After connection to the power supply voltage, the actuator moves the damper blade to the "OPEN" position or "CLOSED" (according to the corresponding connection, see wiring diagram). If the power supply is interrupted, the actuator stops at the current position. The signalling of the "OPEN" and "CLOSED" damper blade positions is ensured by two built-in fixed "potential-free" end- limit switches.
- The actuator for operating the damper blade is mounted in an insulated cover/box. It is accessible after removing the cover lid. The electrical connection of the actuator is made with a non-flammable cable (or a cable located in the adjoining cable duct), which passes through an opening made in the wall of the insulated cover/box when installing the damper or when connecting the actuator power cable. Cable penetrations must meet a minimum fire resistance of 30 minutes.

Design .65


- Belimo modulating actuators, BEN (BEE)-SR series for 24V AC/DC are specially designed for remote control of smoke control dampers. The position of the damper blade is adjustable by means of control voltage 0 (2)...10V DC.
- The signalling of the "OPEN" and "CLOSED" damper blade positions is ensured by two built-in fixed "potential-free" limit switches.
- The actuator for operating the damper blade is mounted in an insulated cover/box. It is accessible after removing the cover lid. The electrical connection of the actuator is made with non-flammable cables (or cables located in the adjoining cable duct), which pass through an opening made in the wall of the insulated cover when installing the damper or when connecting the power cables of the actuator. Cable penetrations must meet a minimum fire resistance of 30 minutes.

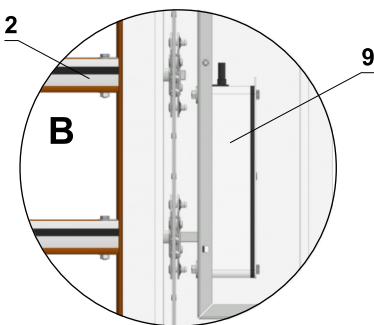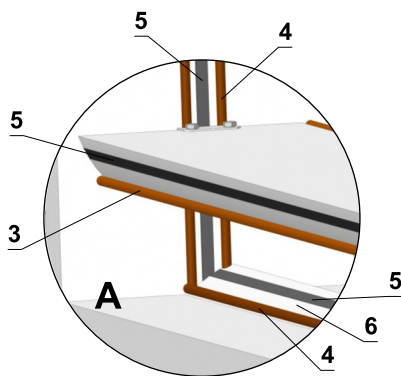


- | | |
|---------------------------|--------------------------|
| 1 Damper housing | 6 Blade stop |
| 2 Blades | 7 Actuator housing |
| 3 Silicone blade seal | 8 Actuator housing cover |
| 4 Internal silicone seal | 9 Actuator |
| 5 Fire-fighting foam tape | |

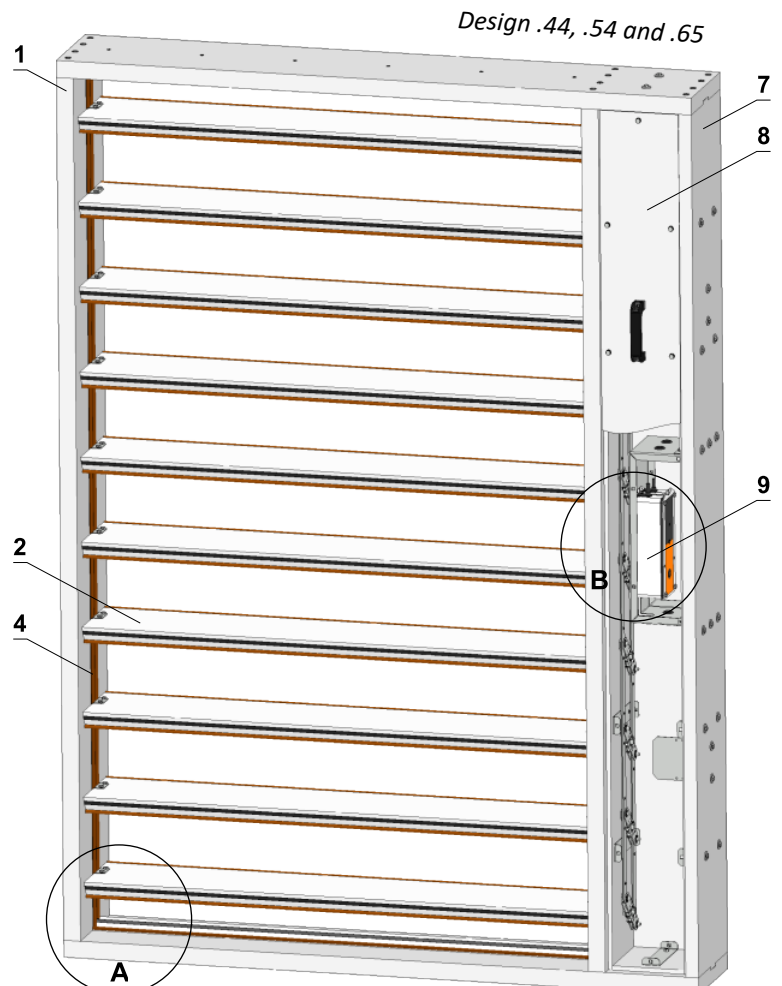


Actuator BELIMO BEN 24(-ST)

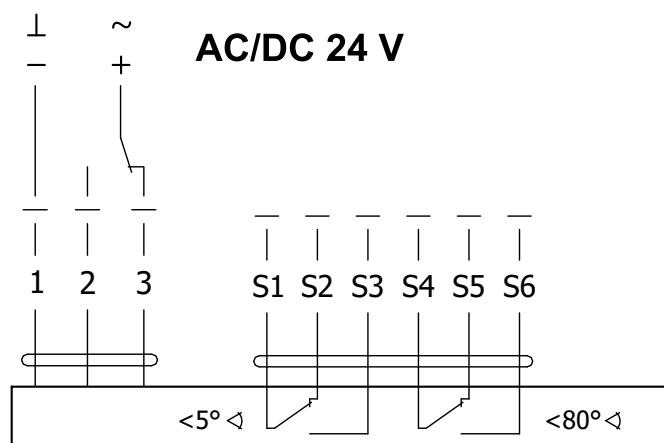

Actuator BELIMO BEN 24-SR

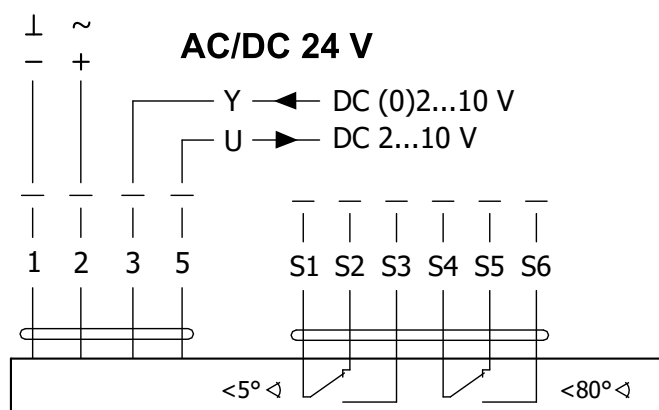

Actuator BELIMO BEN 230

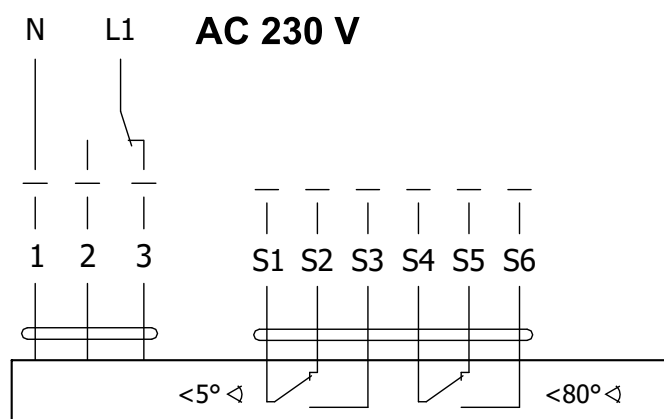


Actuator BELIMO BEN 24(-ST), BEN 24-SR, BEN 230


Actuator BELIMO - 15 Nm	BEN 24(-ST)	BEN 24-SR*	BEN 230
Power voltage	AC/DC 24 V 50/60Hz	AC/DC 24 V 50/60Hz	AC 230 V 50/60Hz
Power consumption - in operation - in the end position	3 W 0,1 W	3 W 0,3 W	4 W 0,4 W
Dimensioning	6 VA (I _{max} 8,2 A @ 5 ms)	6,5 VA (I _{max} 8.2 A @ 5 ms)	7 VA (I _{max} 4 A @ 5 ms)
Protection class	III	III	II
Degree of protection		IP 54	
Adjustment time for 95°		< 30 s	
Ambient temperature Storage temperature		-30°C ... +55°C -40°C ... +80°C	
Connection - drive - auxiliary switch	Cable 1 m, 3 x 0,75 mm ² Cable 1 m, 6 x 0,75 mm ² (BEN 24-ST) with plug connectors	Cable 1 m, 4 x 0,75 mm ² Cable 1 m, 6 x 0,75 mm ²	Cable 1 m, 3 x 0,75 mm ² Cable 1 m, 6 x 0,75 mm ²

* Only available for 24V and selected damper sizes


Actuator BELIMO BEE 24(-ST)

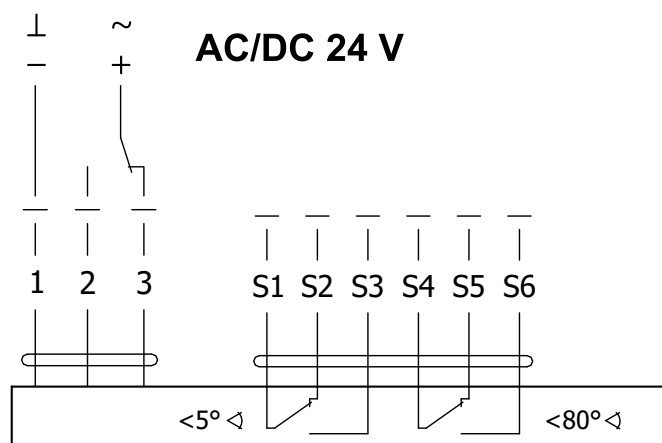

Actuator BELIMO BEE 24-SR

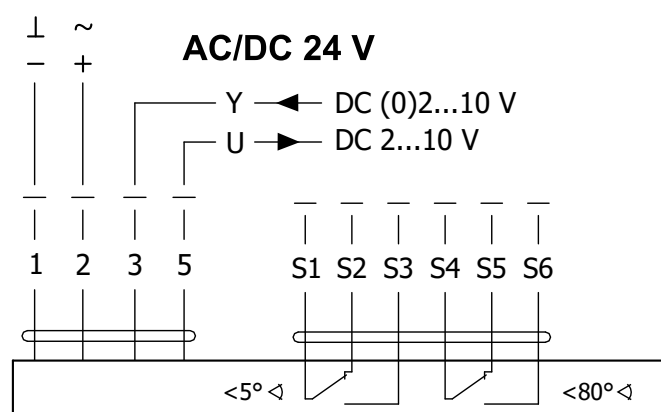

Actuator BELIMO BEE 230

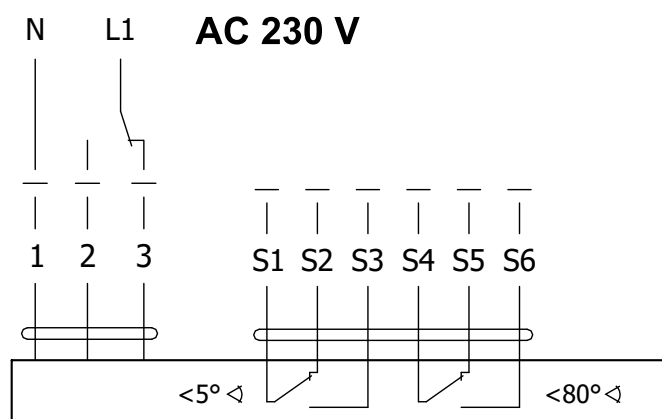


Actuator BELIMO BEE 24(-ST), BEE 24-SR, BEE 230


Actuator BELIMO - 25 Nm	BEE 24(-ST)	BEE 24-SR*	BEE 230
Power voltage	AC/DC 24 V 50/60Hz	AC/DC 24 V 50/60Hz	AC 230 V 50/60Hz
Power consumption - in operation - in the end position	2,5 W 0,1 W	3 W 0,3 W	3,5 W 0,4 W
Dimensioning	5 VA (Imax 8,2 A @ 5 ms)	5,5 VA (Imax 8.2 A @ 5 ms)	6 VA (Imax 4 A @ 5 ms)
Protection class	III	III	II
Degree of protection		IP 54	
Adjustment time for 95°		< 60 s	
Ambient temperature Storage temperature		-30°C ... +55°C -40°C ... +80°C	
Connection - drive - auxiliary switch	Cable 1 m, 3 x 0,75 mm ² Cable 1 m, 6 x 0,75 mm ² (BEE 24-ST) with plug connectors	Cable 1 m, 4 x 0,75 mm ² Cable 1 m, 6 x 0,75 mm ²	Cable 1 m, 3 x 0,75 mm ² Cable 1 m, 6 x 0,75 mm ²

* Only available for 24V and selected damper sizes

Actuator BELIMO BE 24-12(-ST)

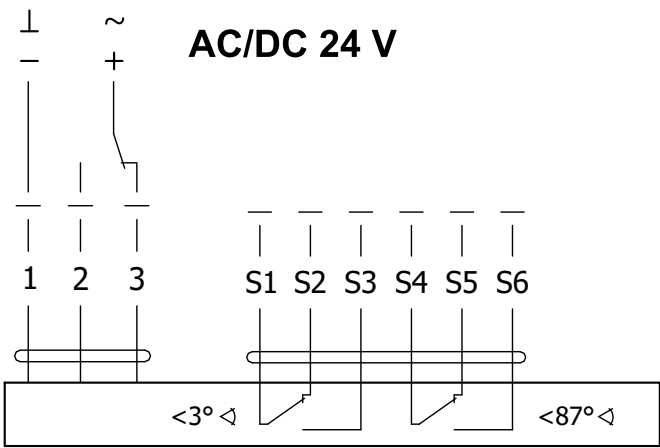

Actuator BELIMO BE 230-12

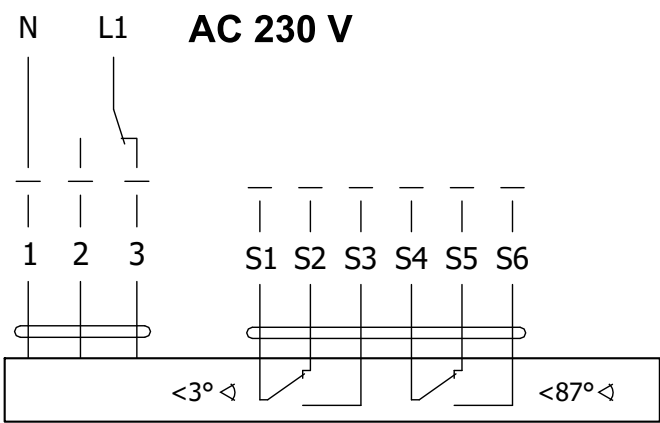


Actuator BELIMO BE 24-12(-ST), BE 230-12		
Actuator BELIMO - 40 Nm	BE 24-12(-ST)	BE 230-12
Power voltage	AC/DC 24 V 50/60Hz	AC 230 V 50/60Hz
Power consumption - in operation - in the end position	12 W 0,5 W	8 W 0,5 W
Dimensioning	18 VA (Imax 8,2 A @ 5 ms)	15 VA (Imax 7.9 A @ 5 ms)
Protection class	III	II
Degree of protection	IP 54	
Adjustment time for 95°	< 60 s	
Ambient temperature	-30°C ... +55°C	
Storage temperature	-40°C ... +80°C	
Connection - drive - auxiliary switch	Cable 1 m, 3 x 0,75 mm ² Cable 1 m, 6 x 0,75 mm ² (BE 24-ST) with plug connectors	

III.DIMENSIONS

SEDM-L without flange and cover grille


- The blade spacing is always 200mm

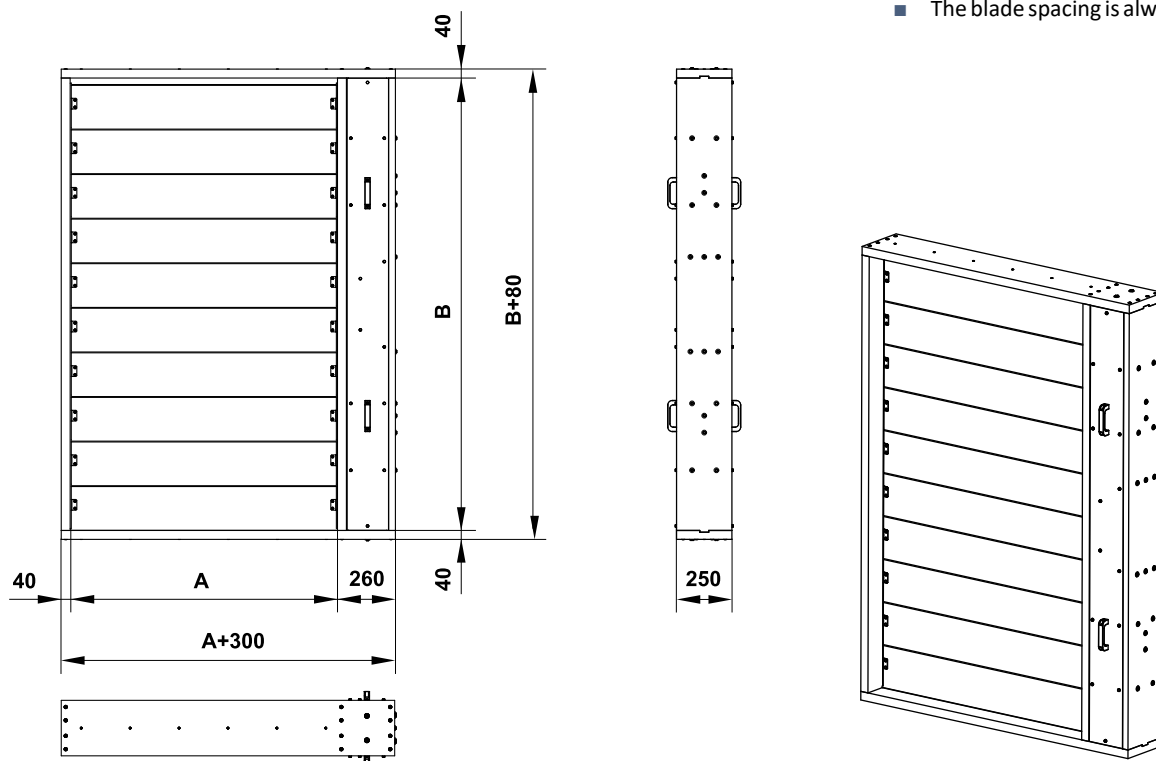

SEDM-L with flange and cover grille over blades

* External dimension of the grille

- The blade spacing is always 200mm
- For a detail of the cover grille filling, → see page 11

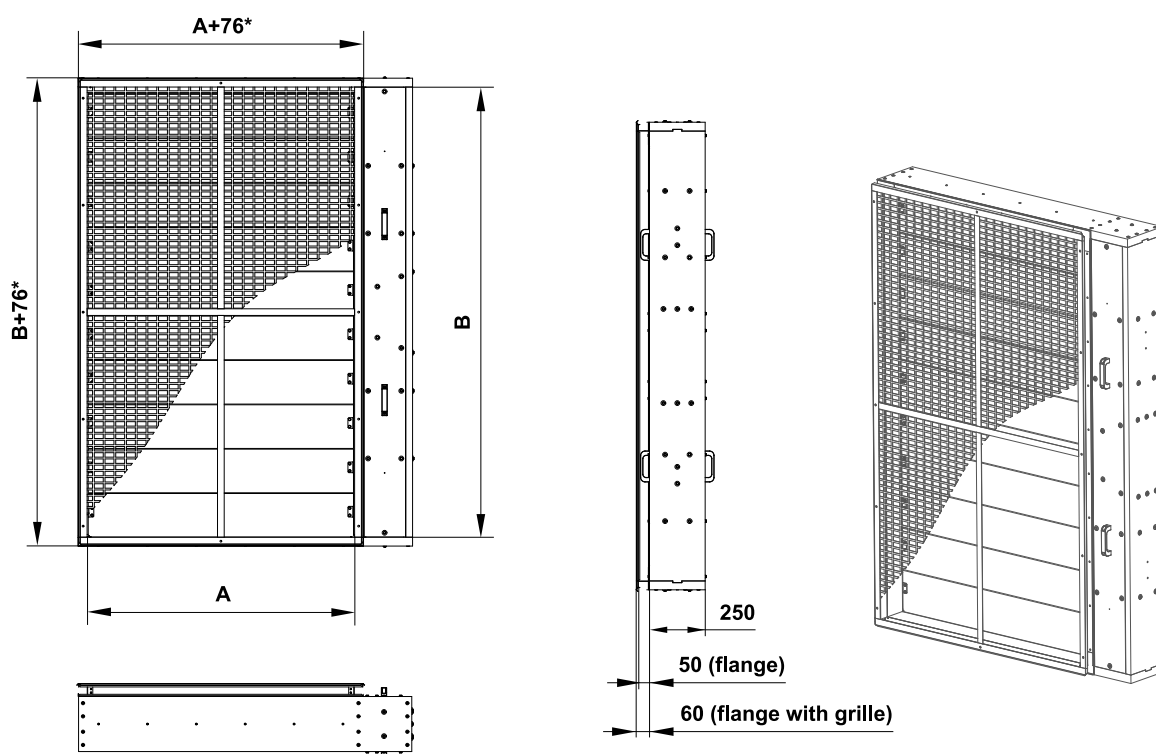


SEDM-L with flange and cover grille over damper

* External dimension of the grille


■ The blade spacing is always 200mm

■ For a detail of the cover grille filling, → see page 11

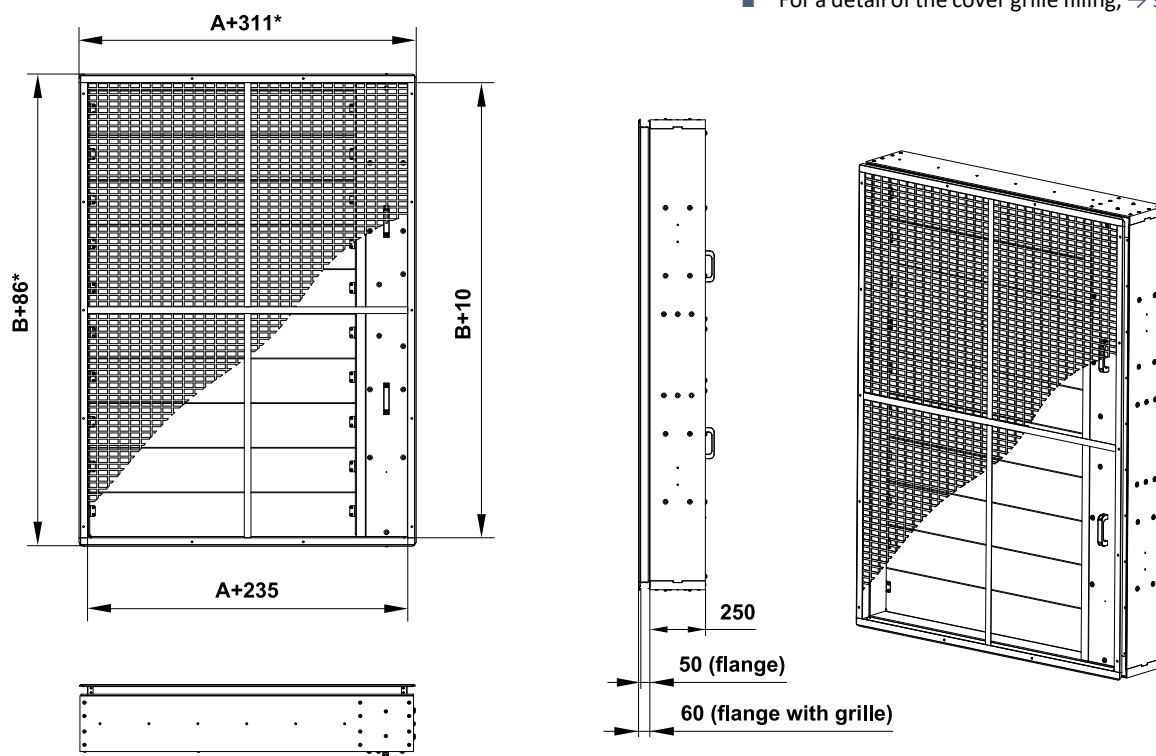


Flange (2 types)

Flange over blades

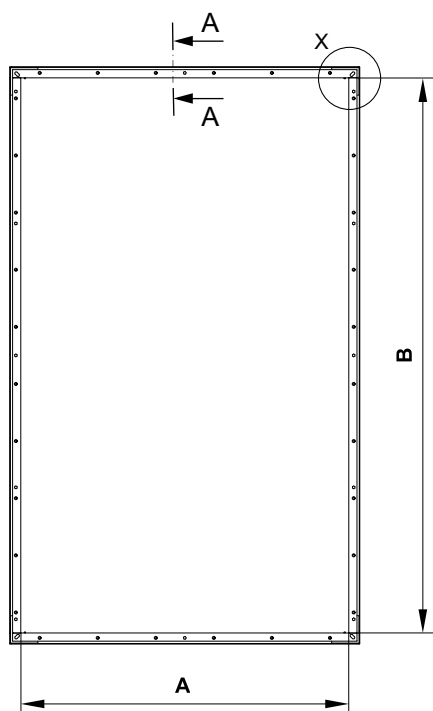


■ Oval holes in the corners are used to connect the duct. Other holes are technological.


Detail X





Detail Y




Flange over damper

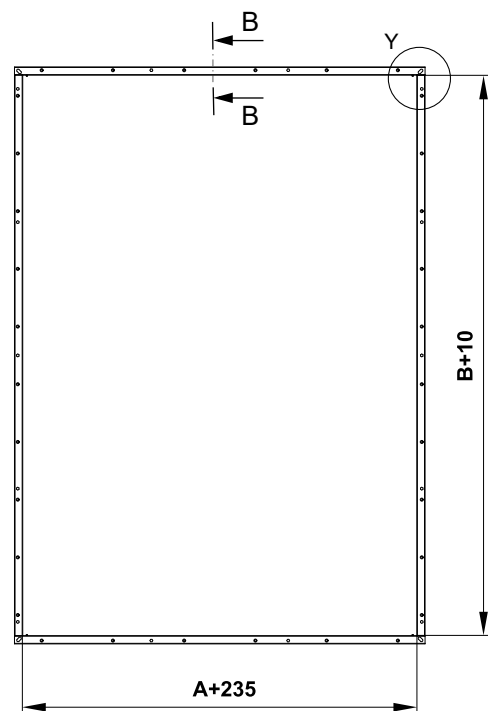

A-A

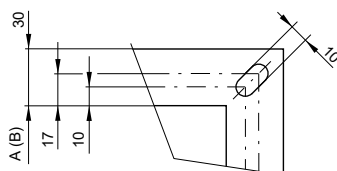

B-B



Cover grille KMM

- The grilles type KMM (TPM 002/96) can be used to close smoke control dampers.
- Maximum size KMM can we supply is 2400x2400mm.
- Free area value for KMM is 78%.



Technical parameters

A x B [mm]	Number of blades	Free area S _f [m²]	Weight SEDM-L [kg]	Weight flange over blades [kg]	Weight flange over damper [kg]	Weight grille over blades [kg]	Weight grille over damper [kg]	Actuating mechanism type
200	2	0,0537	32,2	1,8	2	0,9	1,4	BELIMO BEN (15 N.m)
250		0,0682	33,6	1,9	2,1	1	1,5	
300		0,0827	35,1	2	2,2	1,1	1,6	
350		0,0972	36,5	2,1	2,3	1,2	1,7	
400		0,1117	37,9	2,2	2,4	1,3	1,8	
450		0,1262	39,4	2,3	2,5	1,4	1,9	
500		0,1407	40,8	2,4	2,6	1,5	2	
550		0,1552	42,3	2,5	2,7	1,6	2,1	
600		0,1697	43,7	2,6	2,7	1,7	2,2	
650		0,1842	45,1	2,7	2,8	1,8	2,3	
700 x 430		0,1987	46,6	2,8	2,9	1,9	2,4	
750		0,2132	48	2,9	3	2	2,5	
800		0,2277	49,5	2,9	3,1	2,1	2,6	
850		0,2422	50,9	3	3,2	2,2	2,7	
900		0,2567	52,4	3,1	3,3	2,3	2,8	
950		0,2712	53,8	3,2	3,4	2,4	3	
1000		0,2857	55,2	3,4	3,5	2,5	3,1	
1050		0,3002	56,7	3,5	3,6	2,6	3,2	
1100		0,3147	58,1	3,6	3,7	2,7	3,3	
1150		0,3292	59,5	3,7	3,8	2,8	3,4	
1200		0,3437	61	3,8	3,9	3	3,5	
200	3	0,0833	42,1	2,2	2,4	1,2	1,8	BELIMO BEN (15 N.m)
250		0,1058	43,8	2,3	2,5	1,3	1,9	
300		0,1283	45,5	2,4	2,6	1,4	2	
350		0,1508	47,2	2,5	2,7	1,6	2,2	
400		0,1733	49	2,6	2,7	1,7	2,3	
450		0,1958	50,7	2,7	2,8	1,8	2,4	
500		0,2183	52,4	2,8	2,9	1,9	2,5	
550		0,2408	54,1	2,9	3	2	2,7	
600		0,2633	55,9	3	3,1	2,2	2,8	
650		0,2858	57,6	3,1	3,2	2,3	2,9	
700 x 630		0,3083	59,4	3,2	3,3	2,4	3	
750		0,3308	61,1	3,3	3,4	2,5	3,2	BELIMO BEE (25 N.m)
800		0,3533	62,8	3,3	3,5	2,7	3,4	
850		0,3758	64,5	3,4	3,6	2,8	3,5	
900		0,3983	66,3	3,5	3,7	2,9	3,6	
950		0,4208	68,2	3,6	3,8	3	3,8	
1000		0,4433	69,9	3,7	3,9	3,4	3,9	
1050		0,4658	71,7	3,9	3,9	3,5	4	
1100		0,4883	73,4	4	4	3,6	4,1	
1150		0,5108	75,1	4,1	4,1	3,8	4,3	
1200		0,5333	76,9	4,2	4,2	3,9	4,4	
200	4	0,1129	52,2	2,6	2,7	1,5	2,2	BELIMO BEN (15 N.m)
250		0,1434	54,2	2,7	2,8	1,6	2,3	
300		0,1739	56,2	2,8	2,9	1,8	2,5	
350		0,2044	58,2	2,9	3	1,9	2,6	
400		0,2349	60,2	3	3,1	2,1	2,8	
450		0,2654	62,2	3,1	3,2	2,2	2,9	
500		0,2959	64,3	3,2	3,3	2,4	3,1	
550		0,3264	66,3	3,3	3,4	2,5	3,2	
600		0,3569	68,3	3,4	3,5	2,7	3,4	
650		0,3874	70,4	3,5	3,6	2,8	3,5	
700 x 830		0,4179	72,6	3,6	3,7	2,9	3,7	BELIMO BEE (25 N.m)
750		0,4484	74,6	3,7	3,8	3,1	3,8	
800		0,4789	76,7	3,7	3,9	3,2	4,1	
850		0,5094	78,6	3,8	3,9	3,4	4,3	
900		0,5399	80,7	3,9	4	3,5	4,4	
950		0,5704	82,8	4	4,1	3,7	4,6	
1000		0,6009	84,8	4,2	4,2	4,1	4,7	
1050		0,6314	86,8	4,3	4,3	4,3	4,9	
1100		0,6619	88,8	4,4	4,4	4,4	5	
1150		0,6924	90,8	4,5	4,5	4,6	5,2	
1200		0,7229	92,8	4,6	4,6	4,7	5,3	

A x B [mm]	Number of blades	Free area S _f [m ²]	Weight SEDM-L [kg]	Weight flange over blades [kg]	Weight flange over damper [kg]	Weight grille over blades [kg]	Weight grille over damper [kg]	Actuating mechanism type
200	5	0,1425	62,1	3	3,1	1,8	2,6	BELIMO BEN (15 N.m)
250		0,1810	64,4	3,1	3,2	1,9	2,9	
300		0,2195	66,7	3,2	3,3	2,1	3,1	
350		0,2580	69	3,3	3,4	2,3	3,3	
400		0,2965	71,4	3,4	3,5	2,4	3,5	
450		0,3350	73,7	3,5	3,6	2,6	3,7	BELIMO BEE (25 N.m)
500		0,3735	76,2	3,5	3,7	3	3,9	
550		0,4120	78,5	3,6	3,8	3,2	4,1	
600		0,4505	80,8	3,7	3,9	3,3	4,3	
650		0,4890	83,1	3,8	3,9	3,5	4,4	
700 x 1030		0,5275	85,4	3,9	4,0	3,7	4,6	BELIMO BE (40 N.m)
750		0,5660	87,8	4	4,1	3,9	4,8	
800		0,6045	90,1	4,1	4,2	4,1	5,4	
850		0,6430	92,4	4,2	4,3	4,3	5,6	
900		0,6815	94,7	4,3	4,4	4,5	5,8	
950		0,7200	97,1	4,4	4,5	4,7	5,9	BELIMO BEN (15 N.m)
1000		0,7585	101,1	4,5	4,6	5,2	6,1	
1050		0,7970	103,4	4,6	4,7	5,4	6,3	
1100		0,8355	105,7	4,7	4,8	5,6	6,5	
1150		0,8740	108,1	4,8	4,9	5,8	6,7	
1200		0,9125	110,4	4,9	5	6	6,9	
200	6	0,1721	71,9	3,4	3,5	2,1	3,1	BELIMO BEN (15 N.m)
250		0,2186	74,5	3,5	3,6	2,3	3,4	
300		0,2651	77,1	3,6	3,7	2,4	3,6	
350		0,3116	80	3,7	3,8	2,6	3,8	
400		0,3581	82,6	3,8	3,9	2,8	4	BELIMO BEE (25 N.m)
450		0,4046	85,2	3,9	4	3,2	4,2	
500		0,4511	87,8	4	4	3,4	4,4	
550		0,4976	90,4	4,1	4,1	3,6	4,6	
600		0,5441	93	4,2	4,2	3,8	4,9	
650		0,5906	95,7	4,2	4,3	4	5,1	BELIMO BE (40 N.m)
700 x 1230		0,6371	98,3	4,3	4,4	4,2	5,3	
750		0,6836	100,9	4,5	4,5	4,5	5,5	
800		0,7301	103,5	4,5	4,6	4,7	6,1	
850		0,7766	107,8	4,6	4,7	4,9	6,3	
900		0,8231	110,4	4,7	4,8	5,1	6,6	BELIMO BEN (15 N.m)
950		0,8696	113	4,8	4,9	5,3	6,8	
1000		0,9161	115,6	4,9	5	5,9	7	
1050		0,9626	118,2	5	5,1	6,2	7,2	
1100		1,0091	120,8	5,1	5,2	6,4	7,4	
1150		1,0556	123,4	5,3	5,2	6,6	7,6	BELIMO BEE (25 N.m)
1200		1,1021	126	5,4	5,3	6,8	7,8	
200	7	0,2017	81,9	3,7	3,9	2,3	3,5	BELIMO BEN (15 N.m)
250		0,2562	84,8	3,8	3,9	2,6	3,8	
300		0,3107	87,9	3,9	4	2,8	4	
350		0,3652	90,8	4	4,1	3,1	4,2	
400		0,4197	93,7	4,1	4,2	3,4	4,5	BELIMO BEE (25 N.m)
450		0,4742	96,6	4,2	4,3	3,6	4,7	
500		0,5287	99,5	4,3	4,4	3,8	5	
550		0,5832	102,5	4,4	4,5	4,1	5,2	
600		0,6377	105,4	4,5	4,6	4,3	5,4	
650		0,6922	108,3	4,6	4,7	4,5	5,7	BELIMO BE (40 N.m)
700 x 1430		0,7467	111,1	4,7	4,8	4,8	5,9	
750		0,8012	115,8	4,8	4,9	5	6,1	
800		0,8557	118,7	4,9	5	5,2	6,9	
850		0,9102	121,6	5	5,1	5,5	7,1	
900		0,9647	124,5	5,1	5,1	5,7	7,3	BELIMO BEN (15 N.m)
950		1,0192	127,4	5,2	5,2	5,9	7,6	
1000		1,0737	130,2	5,3	5,3	6,7	7,8	
1050		1,1282	133,1	5,4	5,4	6,9	8	
1100		1,1827	136	5,5	5,5	7,1	8,3	
1150		1,2372	138,9	5,6	5,6	7,4	8,5	BELIMO BEE (25 N.m)
1200		1,2917	141,8	5,7	5,7	7,6	8,7	

A x B [mm]	Number of blades	Free area S _f [m ²]	Weight SEDM-L [kg]	Weight flange over blades [kg]	Weight flange over damper [kg]	Weight grille over blades [kg]	Weight grille over damper [kg]	Actuating mechanism type
200	8	0,2313	92,1	4,2	4,2	2,6	3,9	BELIMO BEE (25 N.m)
250		0,2938	95,3	4,3	4,3	2,9	4,2	
300		0,3563	98,4	4,4	4,4	3,1	4,5	
350		0,4188	101,7	4,4	4,5	3,5	4,7	
400		0,4813	104,9	4,5	4,6	3,7	5	
450		0,5438	108	4,7	4,7	4	5,2	
500		0,6063	111,2	4,7	4,8	4,3	5,5	
550		0,6688	114,5	4,8	4,9	4,5	5,8	
600		0,7313	117,7	4,9	5	4,8	6	
650		0,7938	122,6	5	5,1	5	6,3	BELIMO BE (40 N.m)
700 x 1630		0,8563	125,8	5,1	5,2	5,3	6,5	
750		0,9188	129	5,2	5,2	5,5	6,8	
800		0,9813	132,1	5,3	5,3	5,8	7,6	
850		1,0438	135,3	5,4	5,4	6,1	7,9	
900		1,1063	138,5	5,5	5,5	6,3	8,1	
950		1,1688	141,7	5,6	5,6	6,6	8,4	
1000		1,2313	144,8	5,7	5,7	7,4	8,7	
1050		1,2938	148	5,8	5,8	7,7	8,9	
1100	9	1,3563	151,2	5,9	5,9	7,9	9,2	BELIMO BEE (25 N.m)
1150		1,4188	154,4	6	6	8,2	9,4	
1200		1,4813	157,6	6,1	6,1	8,4	9,7	
200		0,2609	101,8	4,6	4,6	2,9	4,3	
250		0,3314	105,3	4,7	4,7	3,2	4,6	
300		0,4019	108,7	4,8	4,8	3,6	4,9	
350		0,4724	112,2	4,9	4,9	3,8	5,2	
400		0,5429	115,7	5	5	4,1	5,5	
450		0,6134	119,2	5,1	5,1	4,4	5,8	
500		0,6839	122,7	5,1	5,2	4,7	6	
550		0,7544	126,2	5,3	5,2	5	6,3	BELIMO BE (40 N.m)
600		0,8249	131,5	5,4	5,3	5,3	6,6	
650		0,8954	134,9	5,4	5,4	5,5	6,9	
700 x 1830		0,9659	138,4	5,5	5,5	5,8	7,2	
750		1,0364	141,8	5,6	5,6	6,1	7,5	
800		1,1069	145,3	5,7	5,7	6,4	8,4	
850		1,1774	148,8	5,8	5,8	6,7	8,7	
900		1,2479	152,3	5,9	5,9	6,9	8,9	
950		1,3184	155,7	6	6	7,2	9,2	
1000	10	1,3889	159,2	6,1	6,1	8,1	9,5	BELIMO BEE (25 N.m)
1050		1,4594	162,7	6,2	6,2	8,4	9,8	
1100		1,5299	166,1	6,3	6,3	8,7	10,1	
1150		1,6004	169,6	6,4	6,4	9	10,4	
1200		1,6709	173,1	6,5	6,4	9,3	10,6	
200		0,2905	111,5	4,9	5	3,2	4,7	
250		0,3690	115,2	5	5,1	3,6	5,1	
300		0,4475	119,1	5,1	5,2	3,9	5,4	
350		0,5260	122,8	5,2	5,2	4,2	5,7	
400		0,6045	126,6	5,3	5,3	4,5	6	
450		0,6830	130,3	5,4	5,4	4,8	6,3	BELIMO BE (40 N.m)
500		0,7615	135,9	5,5	5,5	5,1	6,6	
550		0,8400	139,7	5,6	5,6	5,4	6,9	
600		0,9185	143,5	5,7	5,7	5,7	7,2	
650		0,9970	147,2	5,8	5,8	6	7,5	
700 x 2030		1,0755	151	5,9	5,9	6,3	7,8	
750		1,1540	154,7	6	6	6,6	8,1	
800		1,2325	158,5	6,1	6,1	7	9,1	
850		1,3110	162,3	6,2	6,2	7,3	9,4	
900		1,3895	166	6,3	6,3	7,6	9,7	BELIMO BE (40 N.m)
950		1,4680	169,8	6,4	6,3	7,9	10	
1000		1,5465	173,5	6,5	6,4	8,9	10,4	
1050		1,6250	177,3	6,6	6,5	9,2	10,7	
1100		1,7035	181	6,7	6,6	9,5	11	
1150		1,7820	184,8	6,8	6,7	9,8	11,3	
1200		1,8605	188,6	6,9	6,8	10,1	11,6	


IV. INSTALLATION

Placement and installation


- Dampers are designed to remove heat and combustion products (e.g. smoke) from fire compartments
- Dampers are suitable for installation in vertical and horizontal position passages of fire separating constructions. The damper installation procedures must be done so that all load transfer from the fire separating constructions to the damper is absolutely excluded.
- Following air-conditioning duct must be suspended or supported so that all load transfer from the following duct to the damper flange is absolutely excluded.
- The gap between the installed damper and the fire separating construction must be perfectly filled with approved material.
- The dampers are suitable for installation into/onto smoke extraction ducts, tested and certified according to EN 1366-8 → see pages 32-37
- After installing the damper, the damper blades must only be opened, or closed by operation of the actuator only.
- The distance between the damper and the construction (wall, ceiling) must be 75 mm at the minimum, according to EN 1366-2. If two or more dampers are to be installed in one fire separating construction, the distance between adjacent dampers must be 200 mm at the minimum, according to EN 1366-10.
- To provide the necessary space for access to the control device, it is recommended that other objects be at least 350 mm away from the control parts of the damper.

Minimum distance between the dampers and the construction

- minimum distance 200 mm between dampers, according to EN 1366-10
- minimum distance 75 mm between damper and construction (wall/ceiling), according to EN 1366-10

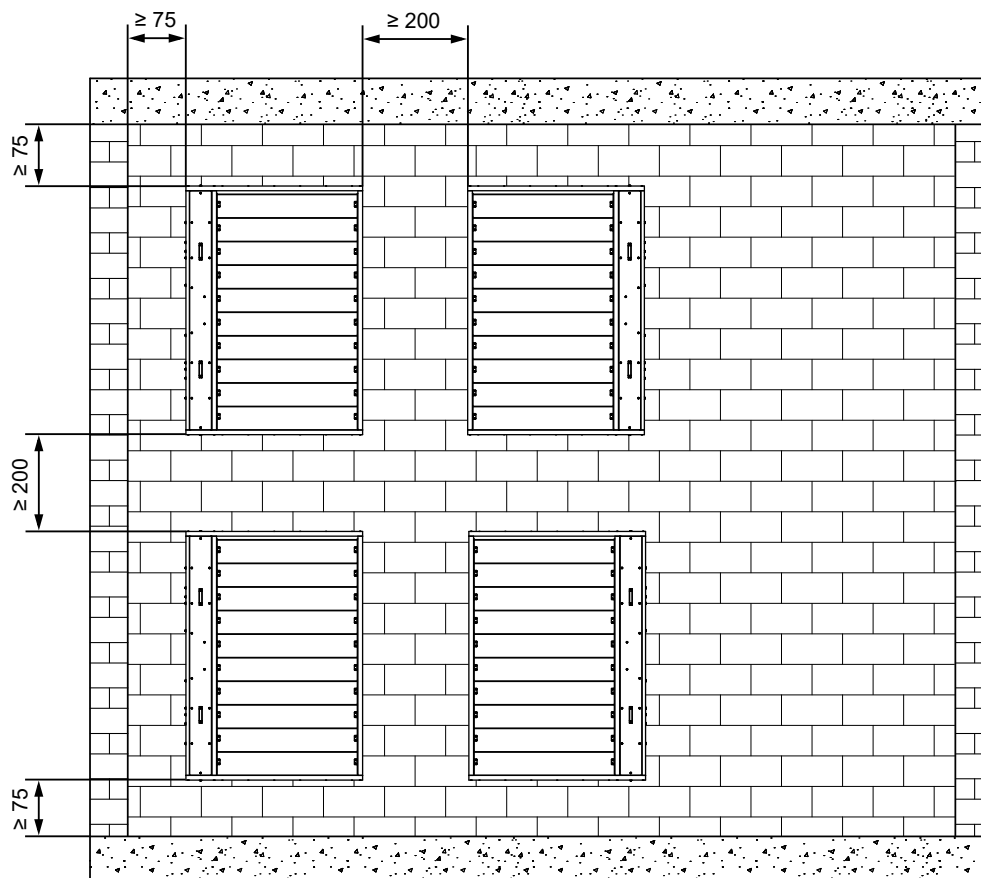

Recommended construction openings

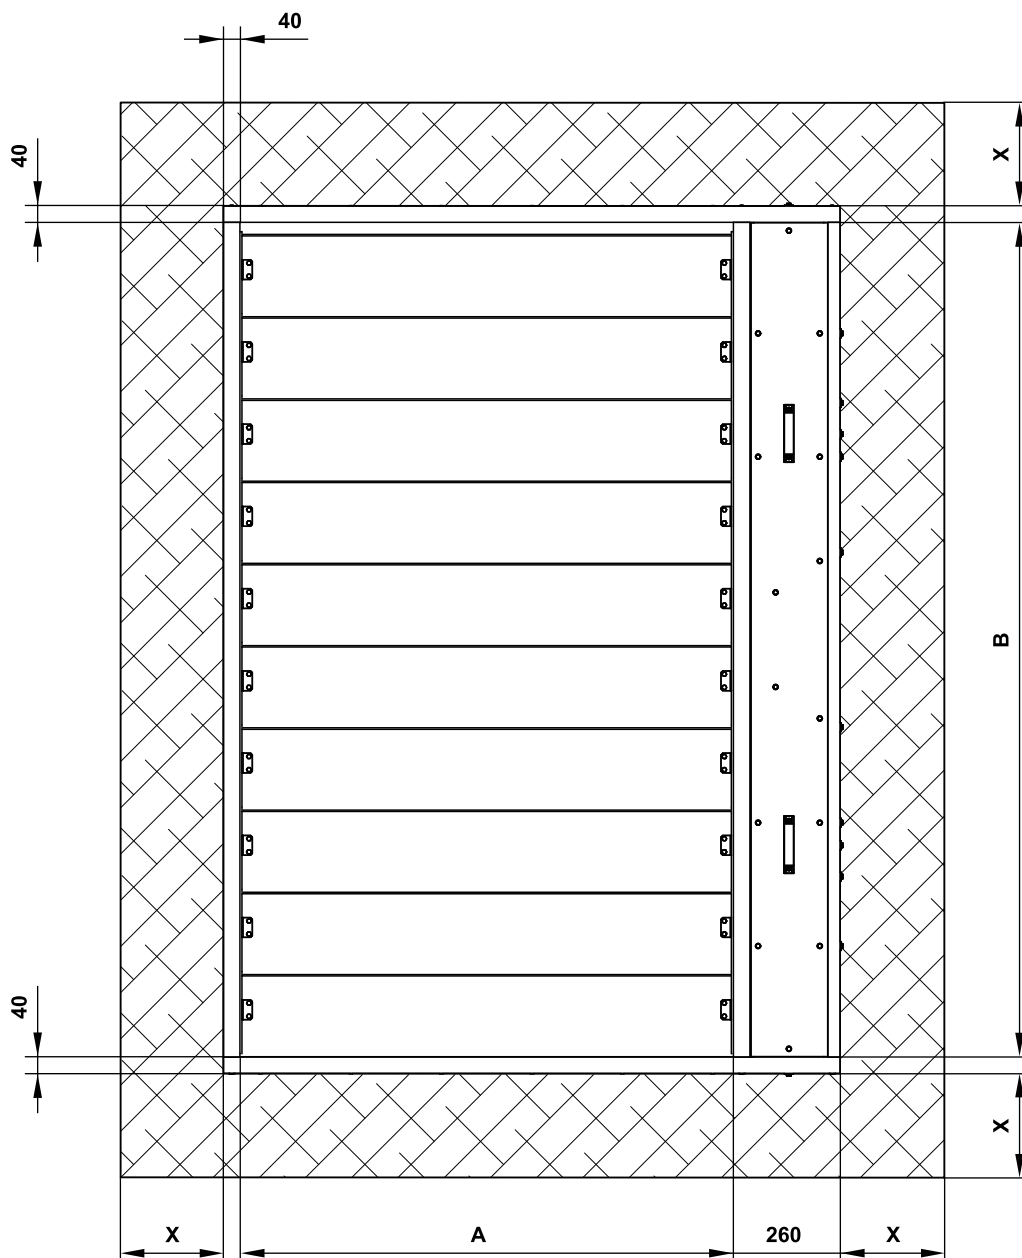

Mortar or gypsum, damper in solid/ceiling/shaft wall construction

- x = min. 50 mm
- x = max. 150 mm

Mortar or gypsum, damper in gypsum wall construction

- x = 50 mm^{+10/-0} for max. fire resistance of the installation EI 120 S
- x = min. 50 mm for max. fire resistance of the installation EI 90 S
- x = max. 150 mm for max. fire resistance of the installation EI 90 S

Ablative Coated Batt

- x = 200 mm^{+0/-10} for max. fire resistance of the installation EI 120 S
- x = min. 40 mm for max. fire resistance of the installation EI 90 S
- x = max. 230 mm for max. fire resistance of the installation EI 90 S

Transport of the damper to the installation place and the installation procedure


- Transport the damper to the installation site in the transport packaging. Pay attention to the appropriate length of the forks of the forklift /handling equipment/ to avoid breaking of wooden planks, consequently damaging the damper's blades.
- Smaller dimensions can be transported, handled and installed into the builders work opening manually, for dimensions where a handling insert is included in the delivery, it is recommended to use a suitable handling tools and machines, e.g. a forklift.

Damper handling when installed in the mounting hole

1. Place the damper in a vertical position. Do not remove the transport pacers and corners !




2. Place handling inserts between the top blade and the damper housing.

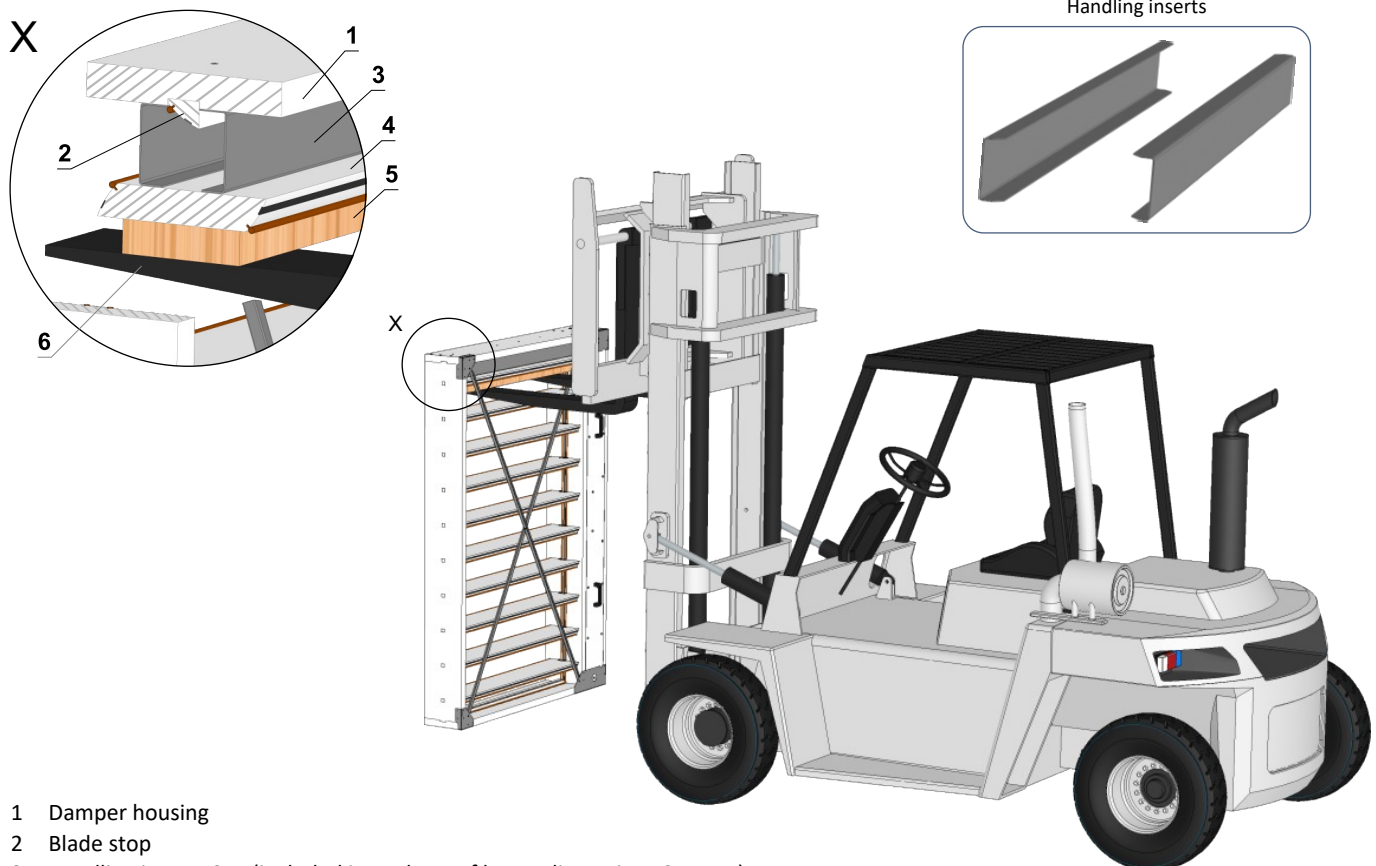

- 1 Damper housing
- 2 Blade stop
- 3 Handling inserts 2pc (included in package of larger dimensions SEDM-L)
- 4 Blade
- 5 Board - thickness min. 25mm (not included)
- 6 Forks

3. Drive the forklift under the highest blade. It's necessary to put a board between the blade and the fork along the blade's entire length so that the blade is not damaged when the damper is raised.






4. Place the damper in the installation hole.

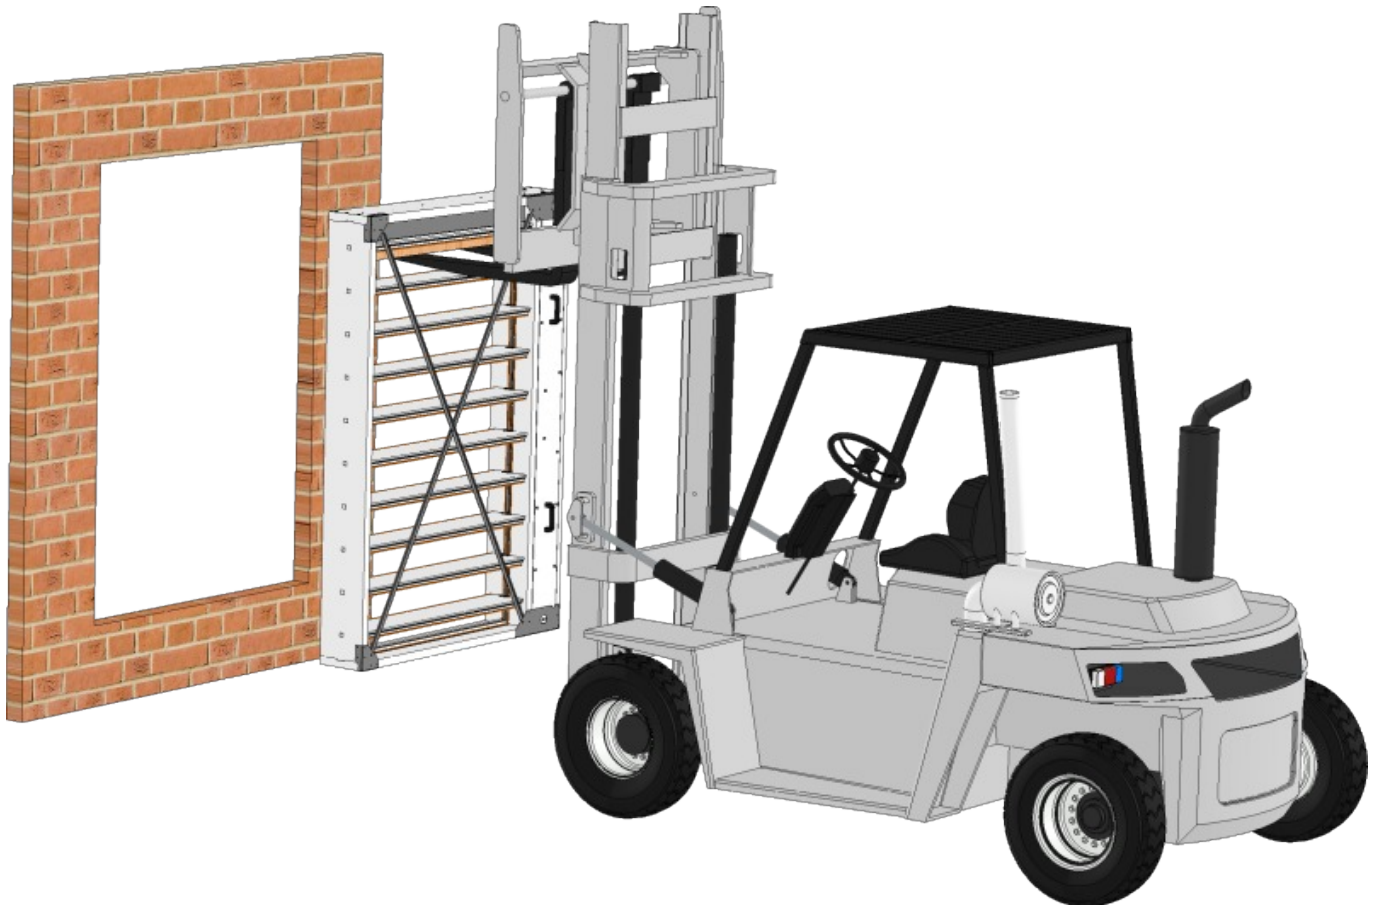


5. After installing the damper and possibly hardening the plaster/mortar, remove the transport struts and corners.




6. Ways of placing the flange on the damper (2 types of flanges)

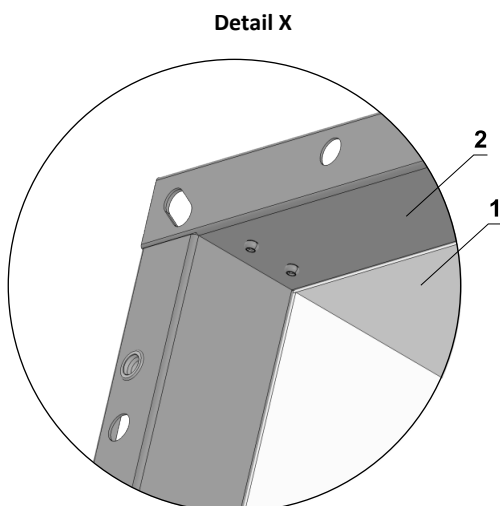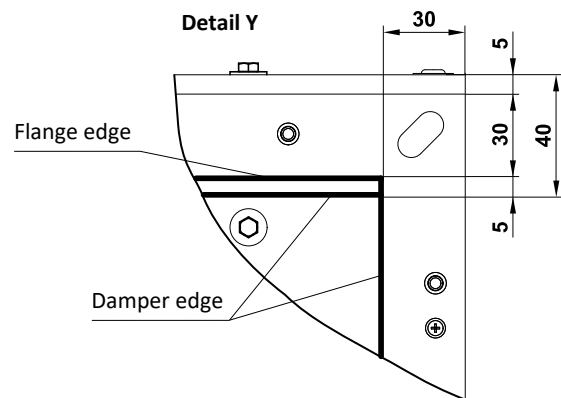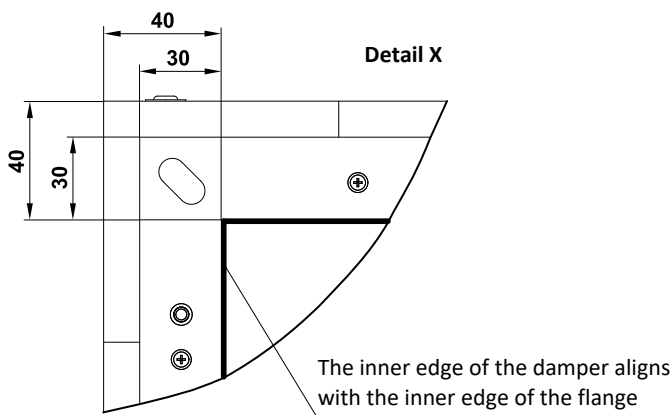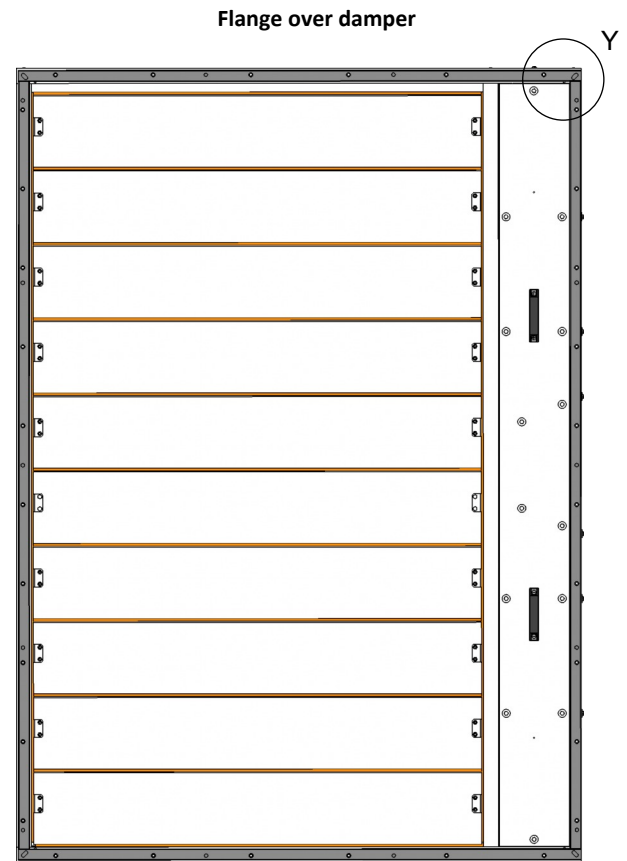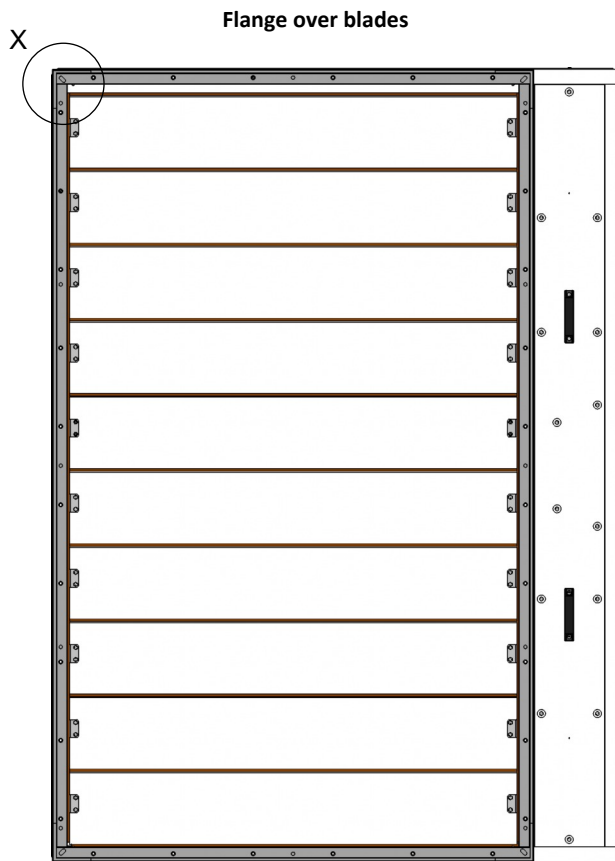

- 1 SED-M-L
- 2 Flange

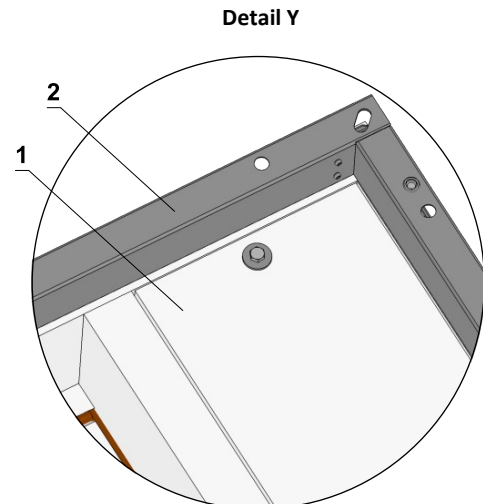

7. Mounting the flange on the damper

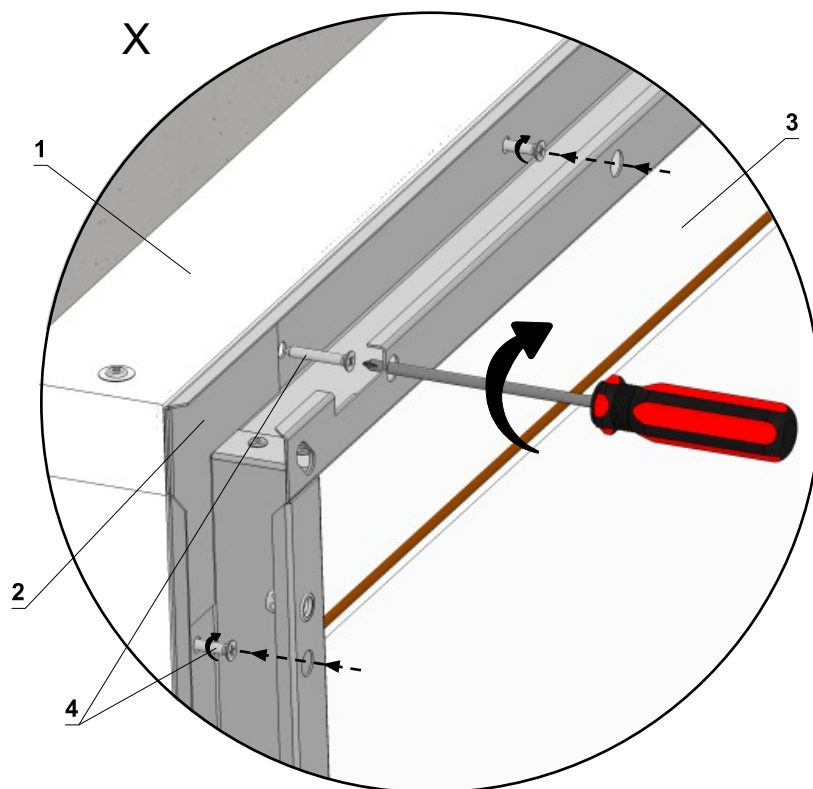


* Fix in all holes, around the perimeter of the flange.


- 1 SEDM-L
- 2 Flange
- 3 Blades
- 4 Screw UNI 4x30 mm (included in the flange package)*

8. Ways of placing the grille on the damper with a flange (2 types)

Grille over blades


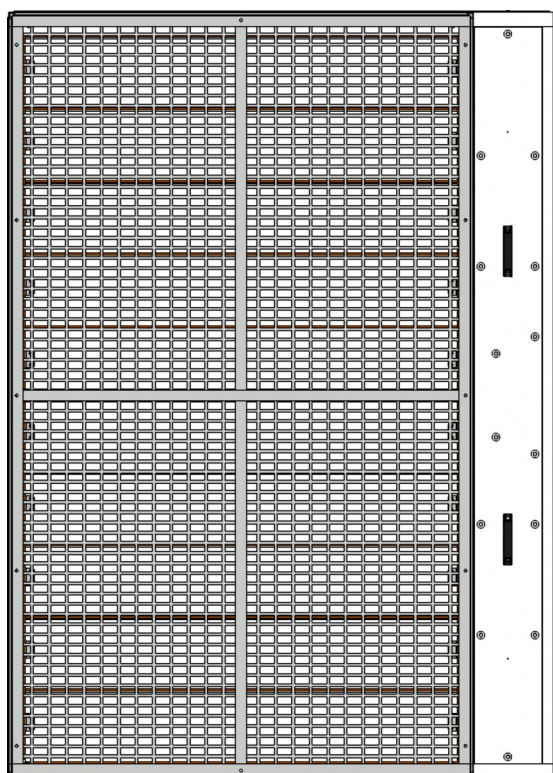


Grille over damper

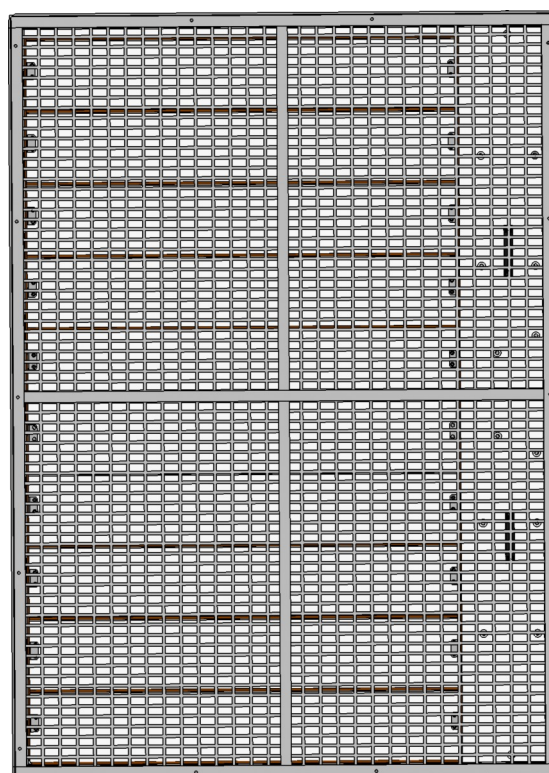



■ For a detail of the cover grille filling, → see page 11

9. Mounting the grille on the flange

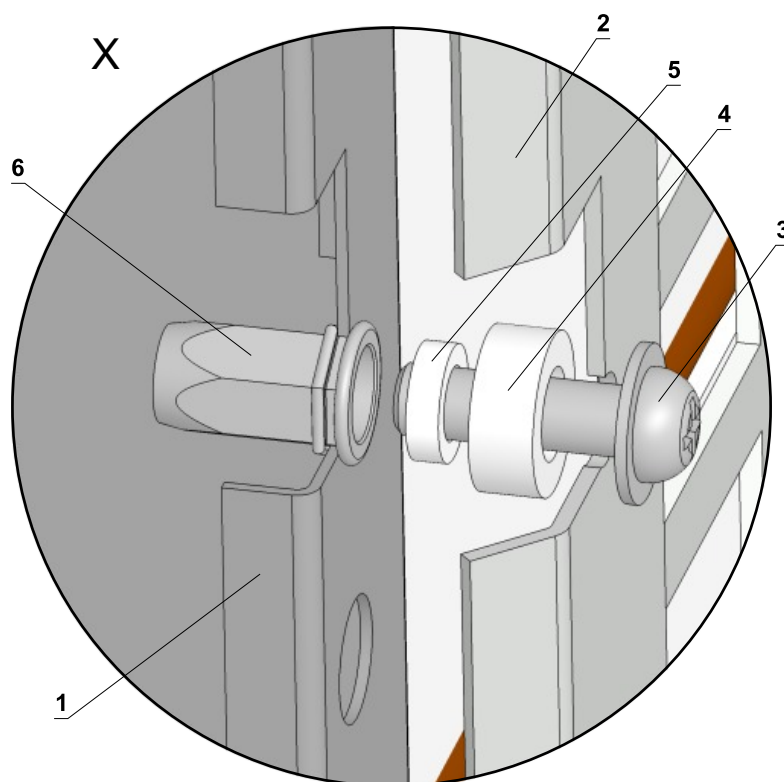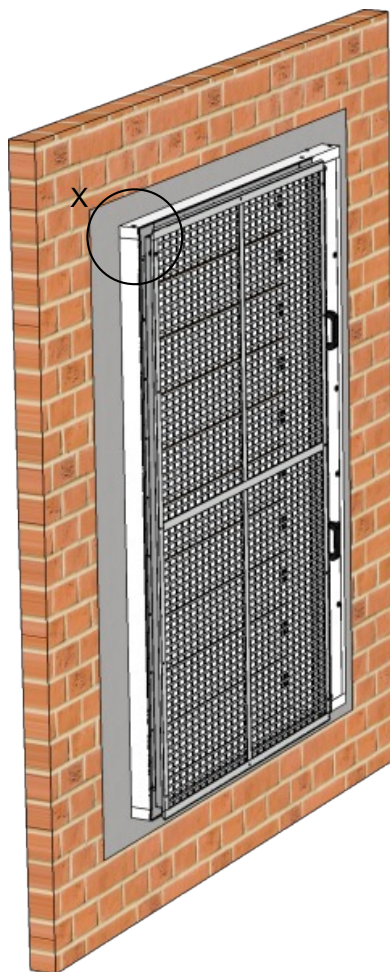

- 1 Flange
- 2 Grille
- 3 Bolt M6x20 type BN 4825 (included in the grille package)
- 4 Spacer ring (included in the grille package)
- 5 Retaining ring (included in the grille package)
- 6 Rivet nuts (mounted on the flange from the factory)

10. Mounting the handrail on the damper

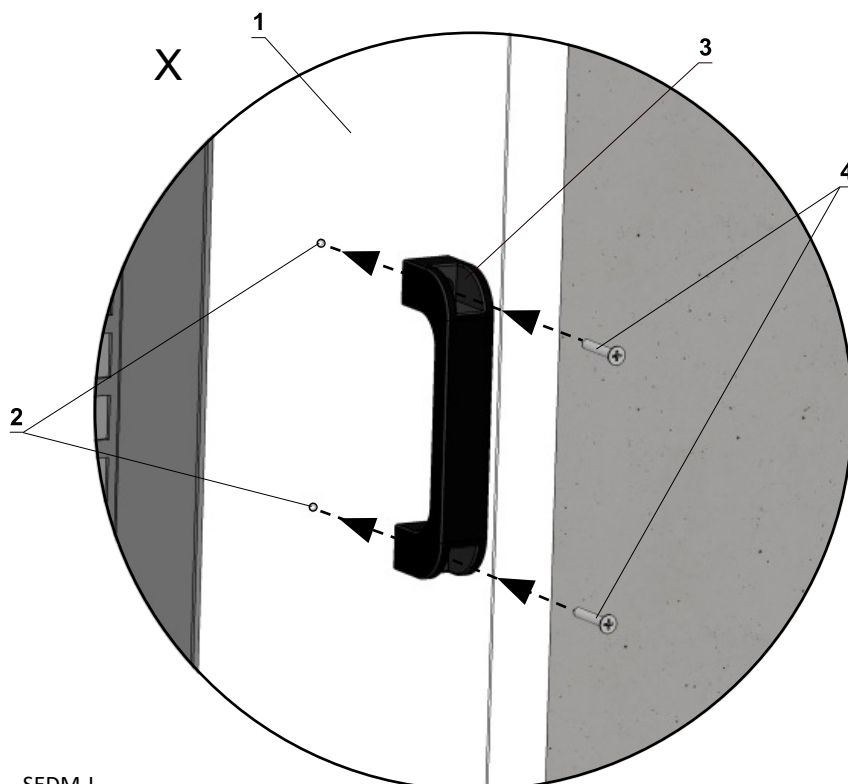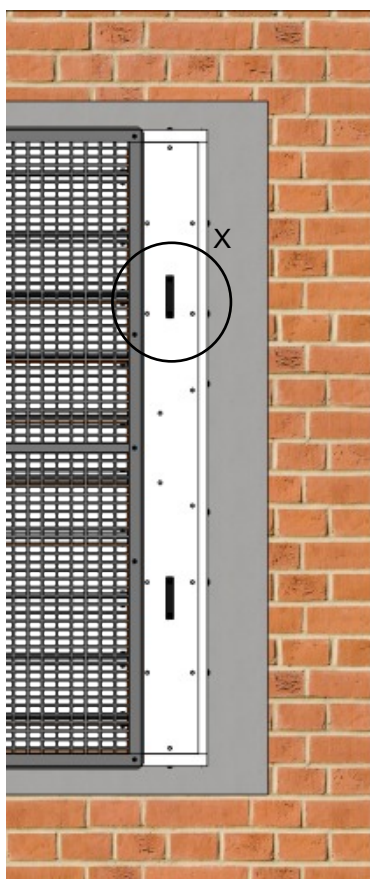

- 1 SEDM-L
- 2 Pre-drilled holes
- 3 Handrail (part of SEDM-L)
- 4 Screw UNI 5x50 mm (part of SEDM-L)

Statement of installations

Fire separating construction, location of the damper	Installation type, installation system	Gap width [mm]	Classification	Page
Horizontal or vertical smoke extraction ducts tested according to EN 1366-8 or EN 1366-9 into/onto the duct	Damper installed into a duct or onto a duct with grille	N/A	EI120(V _{ed})S1000[H]C _{mod} HOT400/30MAmulti	32-35
	Damper installed onto a duct without grille	N/A	EI90(V _{ed})S1000[H]C _{mod} HOT400/30MAmulti	
Vertical smoke extraction ducts Orishaft tested according to EN 1366-8 onto the duct	Damper installed onto a duct with or without grille	N/A	EI60(V _{ed})S1000[H]C _{mod} HOT400/30MAmulti EI120(V _{ed})S1000[H]C _{mod} HOT400/30MAmulti	36-37
Standard low- and high-density rigid wall construction according to EN 1363-1 - damper in the wall or shaft wall 100 mm min. wall thickness	Ablative Coated Batt	40-230	EI90(V _{edw})S1000[H]C _{mod} HOT400/30MAmulti	27
		200	EI120(V _{edw})S1000[H]C _{mod} HOT400/30MAmulti*	
	Mortar or gypsum**	50-150	EI90(V _{edw})S1000[H]C _{mod} HOT400/30MAmulti	23-26
			EI120(V _{edw})S1000[H]C _{mod} HOT400/30MAmulti*	
Standard flexible wall construction, min. EI90. according to EN 1363-1 - damper in the wall or shaft wall 100 mm min. wall thickness	Ablative Coated Batt	40-230	EI90(V _{edw})S1000[H]C _{mod} HOT400/30MAmulti	29
		200	EI120(V _{edw})S1000[H]C _{mod} HOT400/30MAmulti*	
	Mortar or gypsum	50-150	EI90(V _{edw})S1000[H]C _{mod} HOT400/30MAmulti	28
		50	EI120(V _{edw})S1000[H]C _{mod} HOT400/30MAmulti*	
Non-standard asymmetrical shaft wall construction, min. EI120, made of gypsum plasterboards (3 × 15 mm and 1 × 19 mm) with steel studs - damper in the wall or shaft wall 107 mm min. wall thickness	Mortar or gypsum	50-150	EI90(V _{edw})S1000[H]C _{mod} HOT400/30MAmulti EI120(V _{edw})S1000[H]C _{mod} HOT400/30MAmulti*	30
Standard low- and high-density rigid floor construction according to EN 1366-2 - damper in the shaft floor 150 mm min. wall thickness	Mortar or gypsum	50-150	EI90(H _{od})S1000[H]C _{mod} HOT400/30MAmulti EI120(H _{od})S1000[H]C _{mod} HOT400/30MAmulti*	31


* Where the damper is installed without a connected duct, the installation shall be terminated with a grille.

** Including assembly of dampers – side by side → see pages 24 to 26


In solid wall construction

In solid or shaft wall construction - mortar or gypsum

- Standard low- and high-density rigid wall construction according to EN 1363-1
- Examples of anchors to the fire dividing construction → see pages 38 to 40
- Damper must be properly supported until the gypsum has fully hardened.


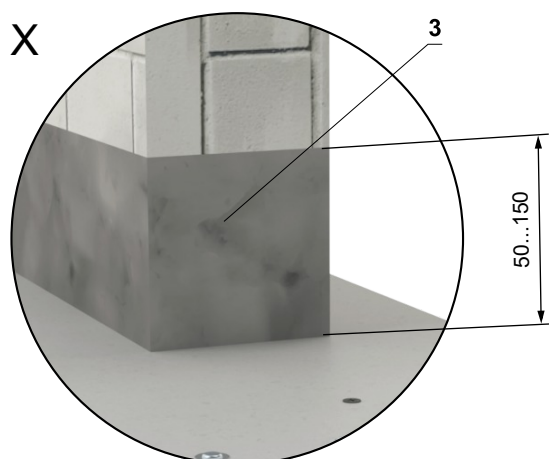


W = min. 50 mm
W = max. 150 mm

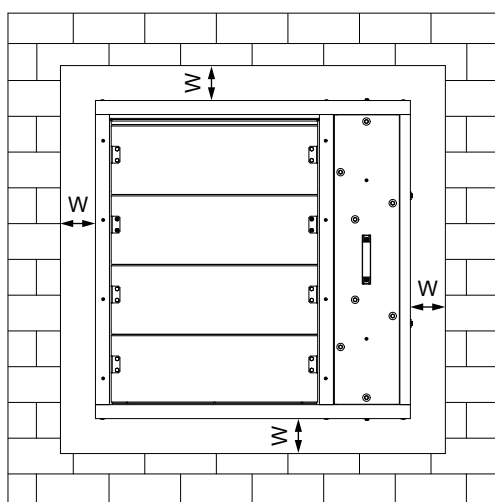

EI90(v_{edw})S1000[H]C_{mod}HOT400/30MAmulti
EI120(v_{edw})S1000[H]C_{mod}HOT400/30MAmulti¹⁾

- 1) Where the damper is installed without a connected duct, the installation shall be terminated with a grille.

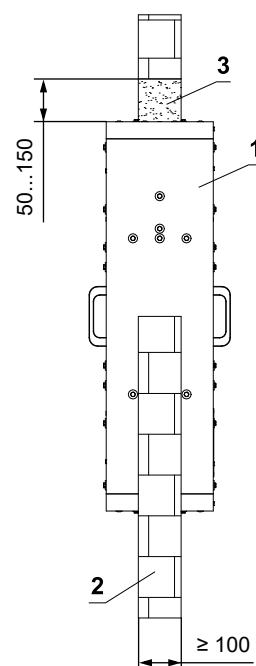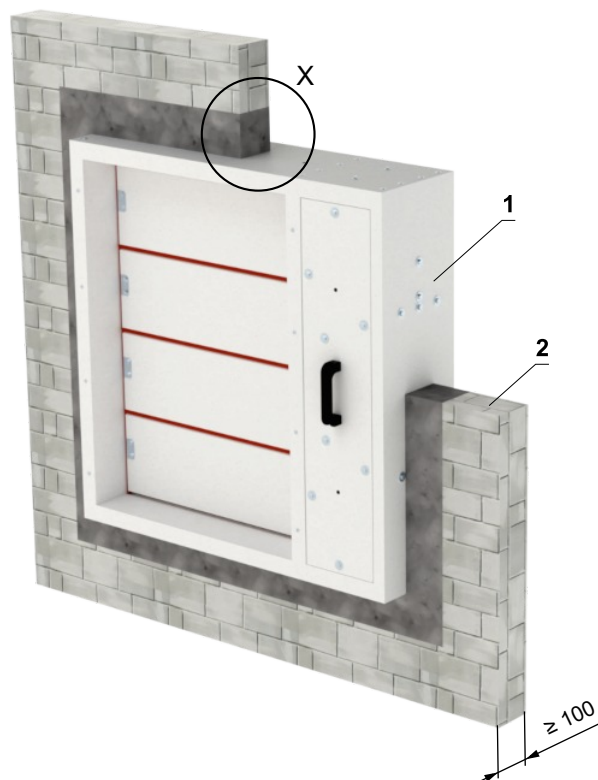


- 1 SEDM-L
- 2 Solid wall construction
- 3 Mortar or gypsum

In solid or shaft wall construction - 2 dampers side by side - mortar or gypsum

EI90(v_{edw})S1000[H]C_{mod}HOT400/30MAmulti
EI120(v_{edw})S1000[H]C_{mod}HOT400/30MAmulti¹⁾

- Standard low- and high-density rigid wall construction according to EN 1363-1
- Examples of anchors to the fire dividing construction → see pages 38 to 40
- Damper must be properly supported until the gypsum has fully hardened.
- Spacer straps and screw connections, are not included in the delivery!

1] Where the damper is installed without a connected duct, the installation shall be terminated with a grille.

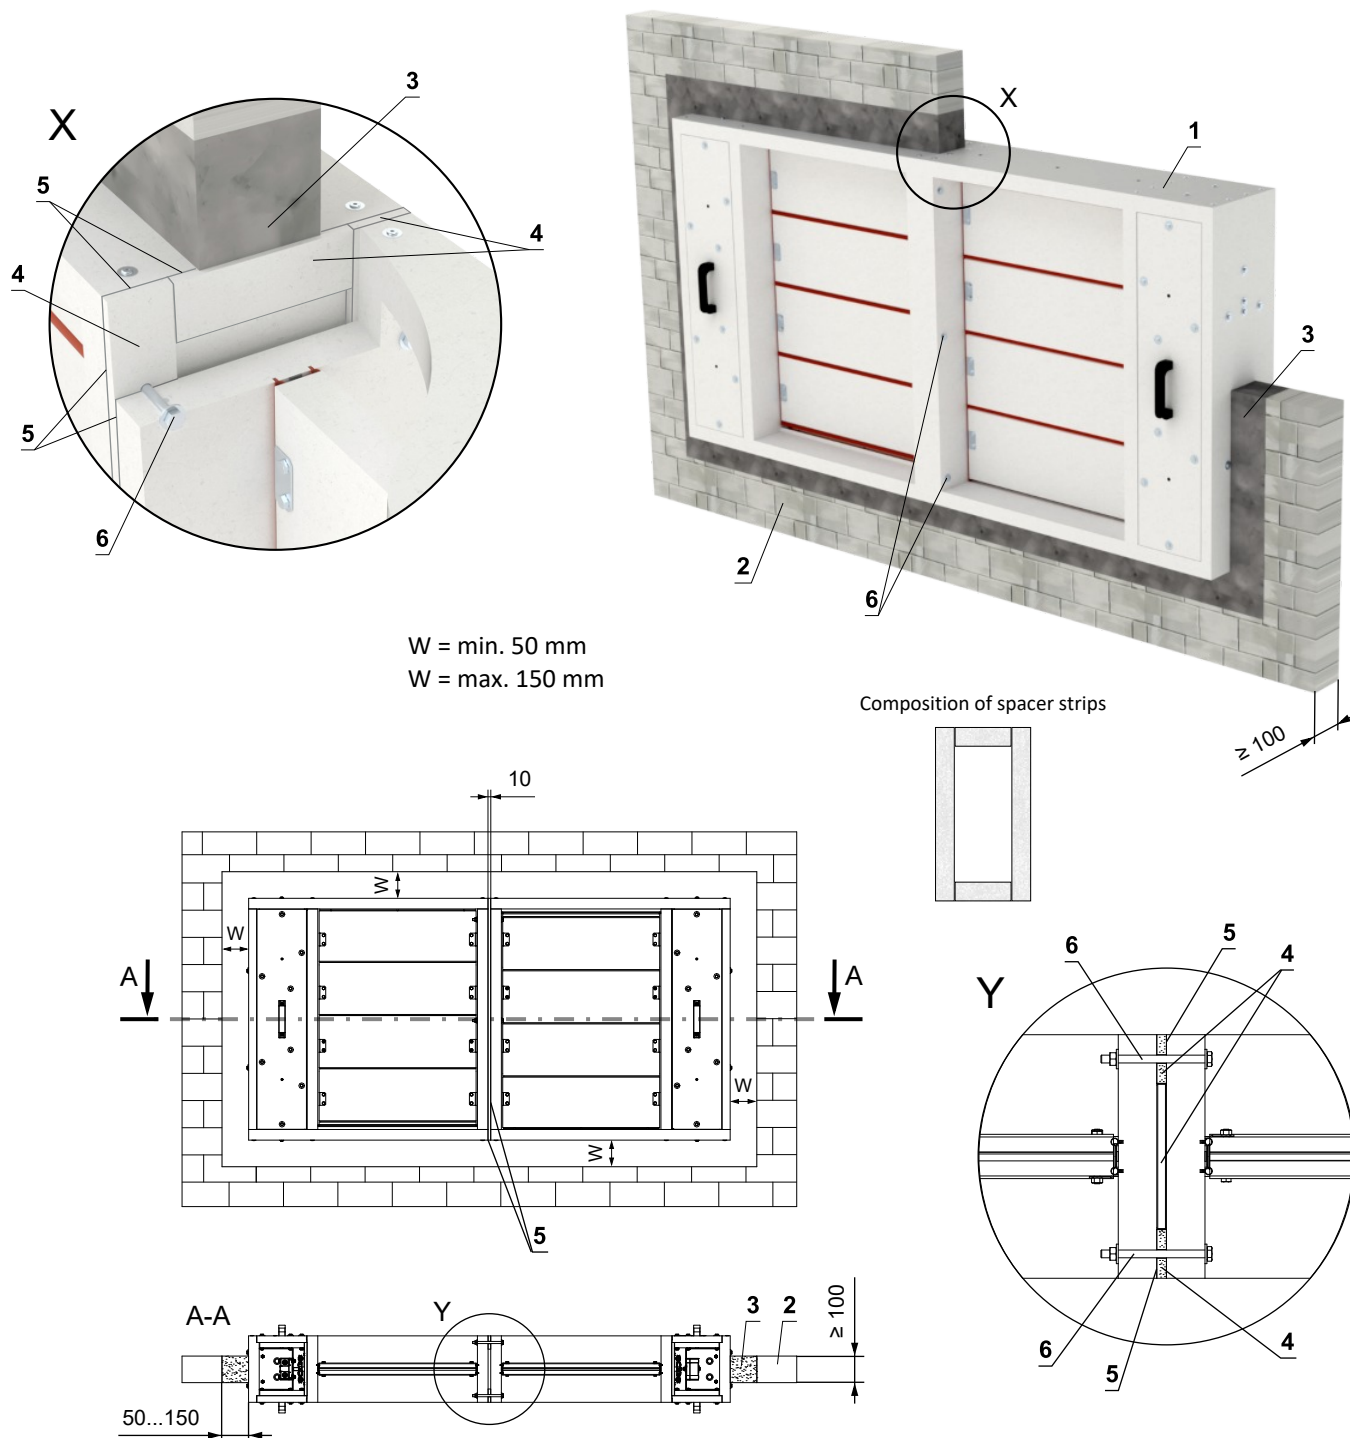

* **RESPECT JOINT POSITION !**

Bolts and nuts shall not prevent free rotation on the blades.


- 1 SEDM-L
2 Solid wall construction
3 Mortar or gypsum
4 Spacing strip (e.g. Promatect-H, th. 10 mm, width 50 mm) - glue with HILTI CFS-S ACR (position 5) to the damper body
5 Fire-resistant mastic - (HILTI CFS-S ACR...)
6 M8 bolt assembly (bolt M8x105 mm, 2 pcs large washer M8, nut M8)*

In solid or shaft wall construction - 2 on top of each other -
mortar or gypsum

EI90(v_{edw})S1000[H]C_{mod}HOT400/30MAmulti
EI120(v_{edw})S1000[H]C_{mod}HOT400/30MAmulti¹⁾


- Standard low- and high-density rigid wall construction according to EN 1363-1
- Examples of anchors to the fire dividing construction → see pages 38 to 40
- Damper must be properly supported until the gypsum has fully hardened.
- Spacer straps and screw connections, are not included in the delivery!

1) Where the damper is installed without a connected duct, the installation shall be terminated with a grille.




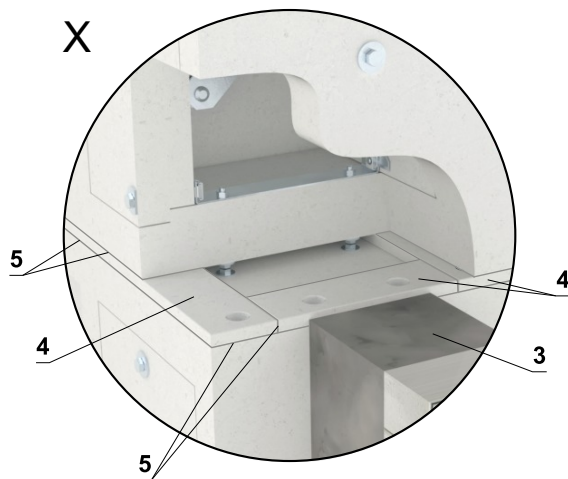


- If the spacer strip rests on the screw head, it is necessary to create a recess in this place (alternatively drill a hole).

Composition of spacer strips



W = min. 50 mm
W = max. 150 mm

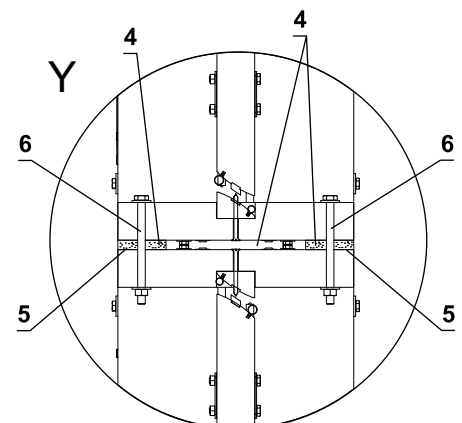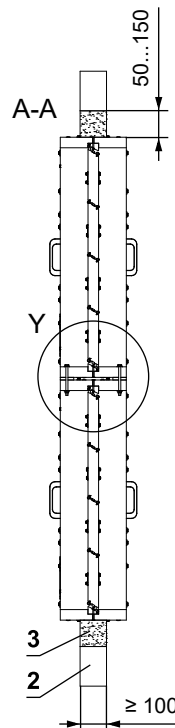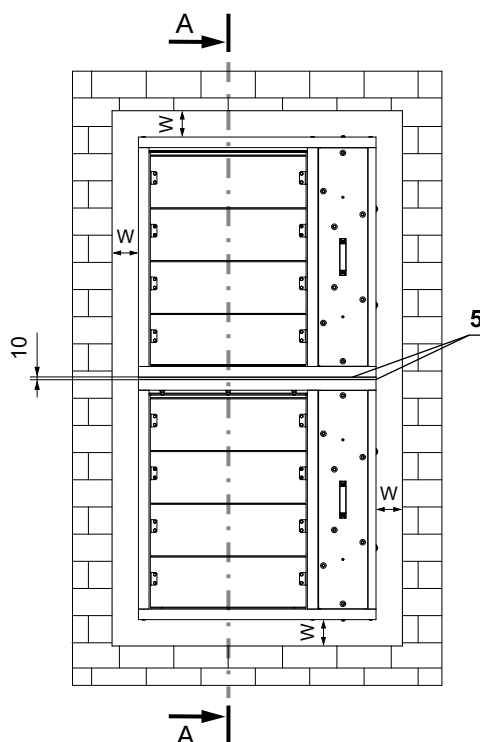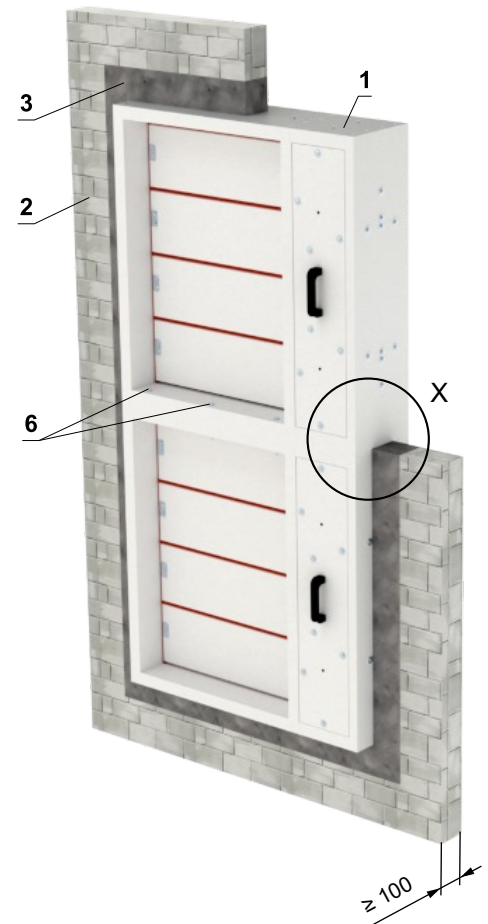


- 1 SEDM-L
- 2 Solid wall construction
- 3 Mortar or gypsum
- 4 Spacing strip (e.g. Promatect-H, th. 10 mm, width 50 mm) - glue with HILTI CFS-S ACR (position 5) to the damper body
- 5 Fire-resistant mastic - (HILTI CFS-S ACR...)
- 6 M8 bolt assembly (bolt M8x105 mm, 2 pcs large washer M8, nut M8)

In solid or shaft wall construction - 4 dampers - mortar or gypsum

EI90(v_{edw})S1000[H]C_{mod}HOT400/30MAmulti
EI120(v_{edw})S1000[H]C_{mod}HOT400/30MAmulti^{1]}

- Standard low- and high-density rigid wall construction according to EN 1363-1
- Examples of anchors to the fire dividing construction → [see pages 38 to 40](#)
- Damper must be properly supported until the gypsum has fully hardened.
- Spacer straps and screw connections, are not included in the delivery!

1] Where the damper is installed without a connected duct, the installation shall be terminated with a grille.

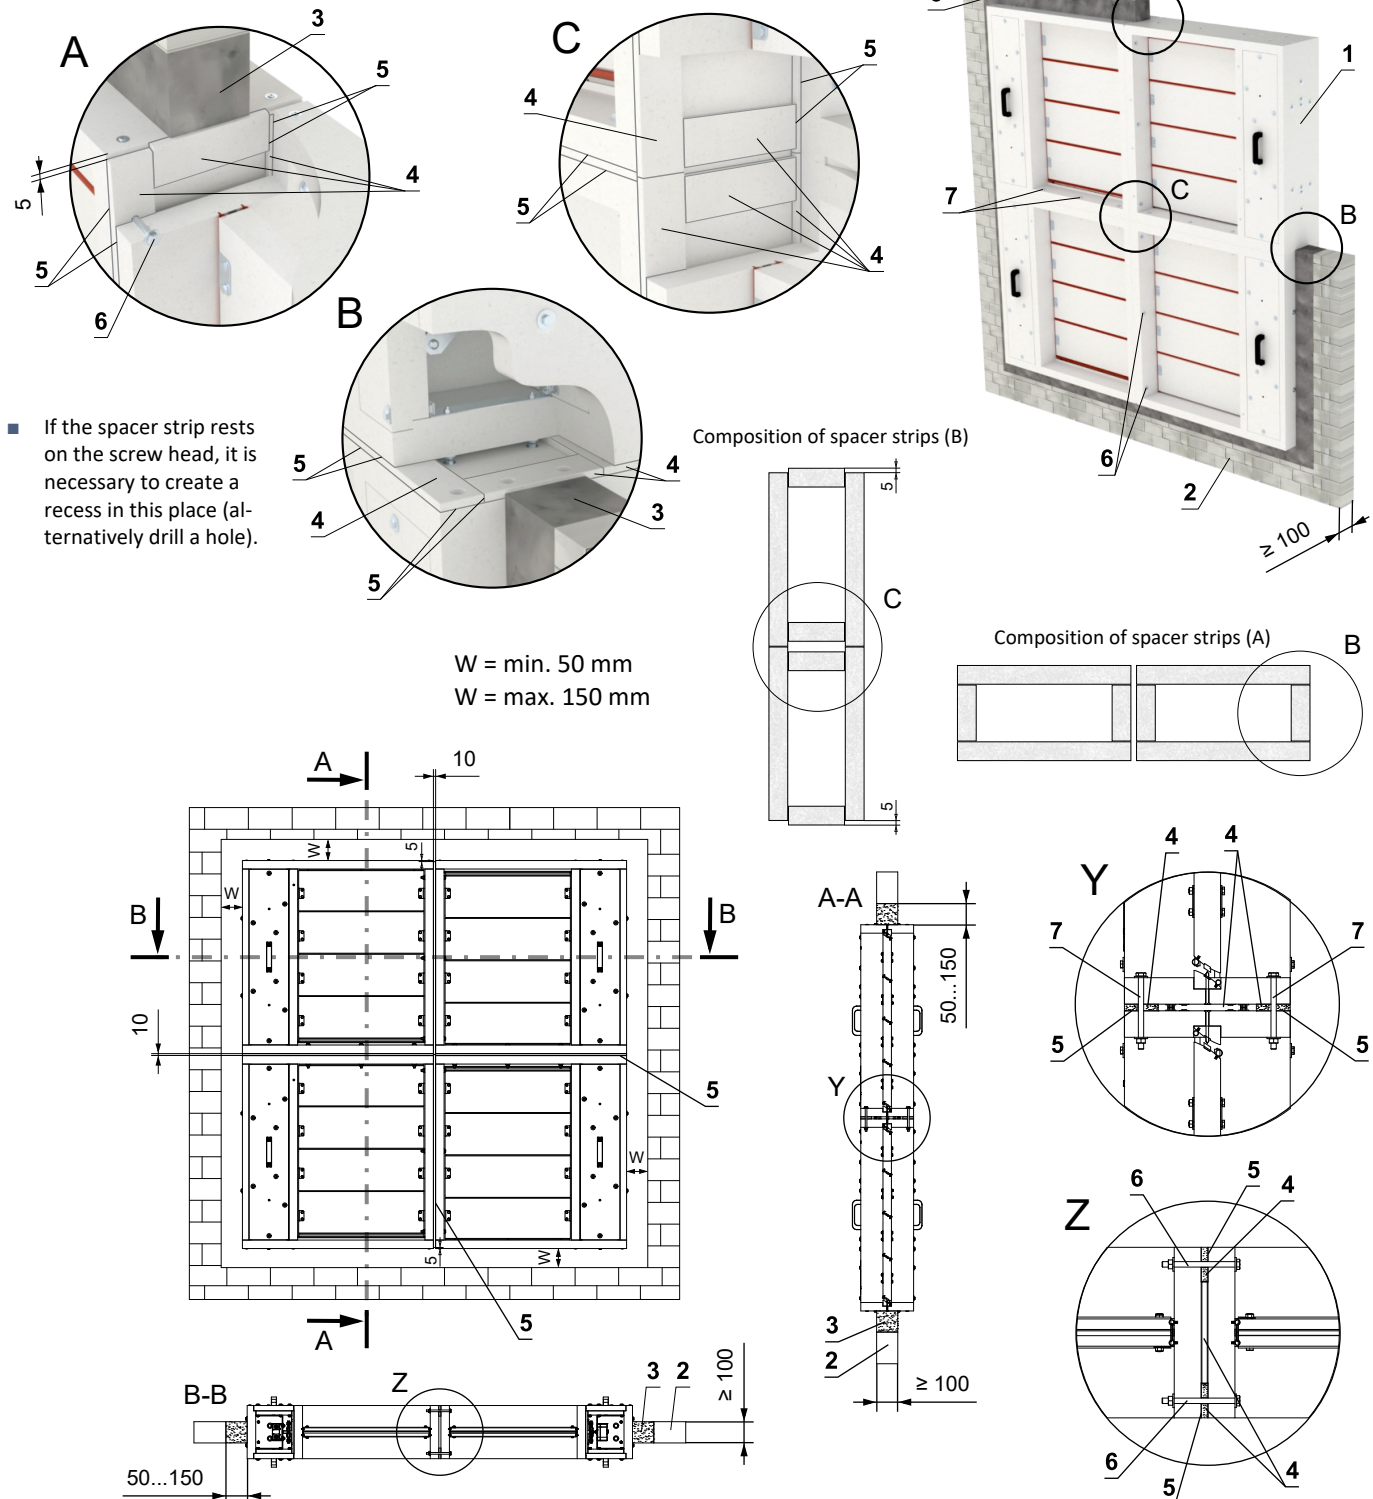

- | | |
|--|--|
| 1 SEDM-L
2 Solid wall construction
3 Mortar or gypsum
4 Spacing strip (e.g. Promatect-H, th. 10 mm, width 50 mm) - glue with HILTI CFS-S ACR (po...
5 Fire-resistant mastic - (HILTI CFS-S ACR...)
6 M8 bolt assembly (bolt M8x105 mm, 2 pcs large washer M8, nut M8)*
7 M8 bolt assembly (bolt M8x105 mm, 2 pcs large washer M8, nut M8), span 200-300 mm | * RESPECT JOINT
Bolts and nuts |
|--|--|



* **RESPECT JOINT POSITION !**
Bolts and nuts shall not prevent free rotation on the blades.

In solid or shaft wall construction - Ablative Coated Batt



- Standard low- and high-density rigid wall construction according to EN 1363-1
- Examples of anchors to the fire dividing construction → see pages 38 to 40

EI90(v_{edw})S1000[H]C_{mod}HOT400/30MAmulti
***EI120(v_{edw})S1000[H]C_{mod}HOT400/30MAmulti¹⁾**

1) Where the damper is installed without a connected duct, the installation shall be terminated with a grille.

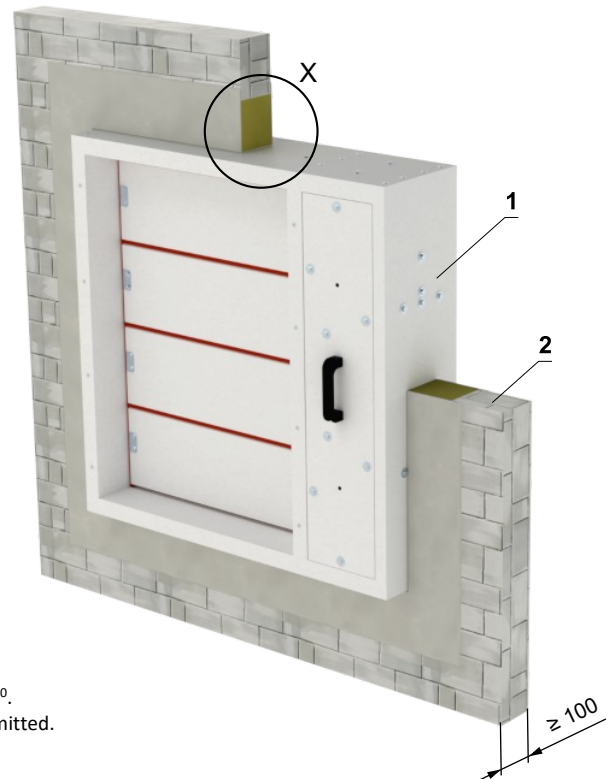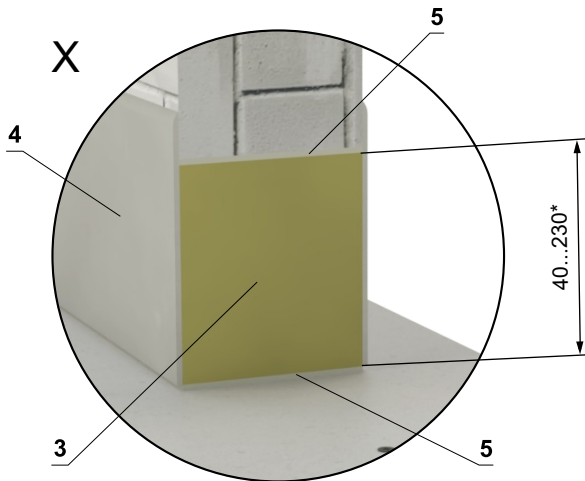

* In the case of fire resistance EI 120, the installation gap is limited to 200 mm ^{+0/-10}.
For fire resistance EI 90 or lower, an installation gap range of 40–230 mm is permitted.

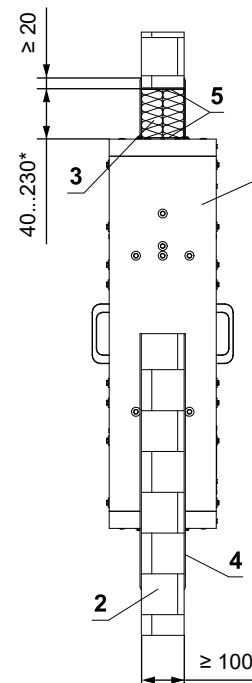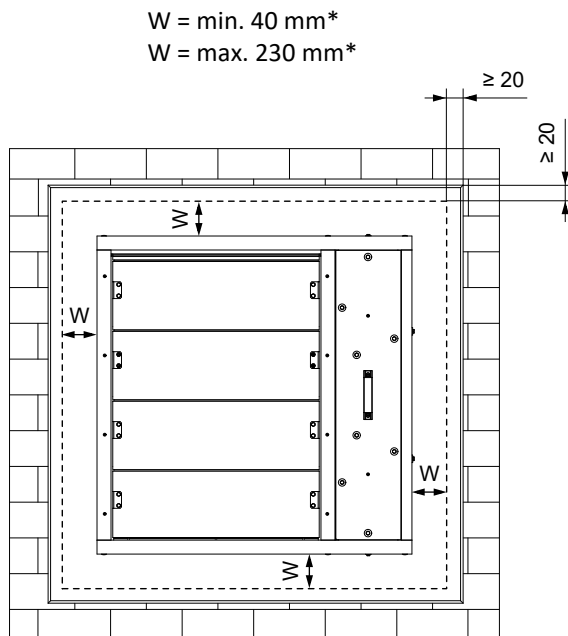

- 1 SEDM-L
- 2 Solid wall construction
Ablative Coated Batt System HILTI**
- 3 Mineral wool board - min. density 140 kg/m³ (HILTI CFS-CT B 1S 140/50...)
- 4 Fire stop coating - th. 1 mm (HILTI CFS-CT...) - coating is overcoated on the support construction and on the damper casing/duct.
- 5 Fire-resistant mastic - (HILTI CFS-S ACR...) fill the gap from both sides of the fire separation construction and around the perimeter of penetration and damper casing.

** HILTI system can be replaced by a similar system with the same or higher thickness, density, fire reaction class, tested according to EN 1366-3.



In gypsum wall construction

In gypsum wall or shaft wall construction min. EI 90 - mortar or gypsum

- Standard flexible wall construction min. EI 90 according to EN 1363-1.
- Examples of anchors to the fire dividing construction → see pages 38 to 40
- Damper must be properly supported until the gypsum has fully hardened.
- The installation opening is lined with a UW/CW profile.



EI90(v_{edw})S1000[H]C_{mod}HOT400/30MAmulti
*EI120(v_{edw})S1000[H]C_{mod}HOT400/30MAmulti¹⁾

1) Where the damper is installed without a connected duct, the installation shall be terminated with a grille.

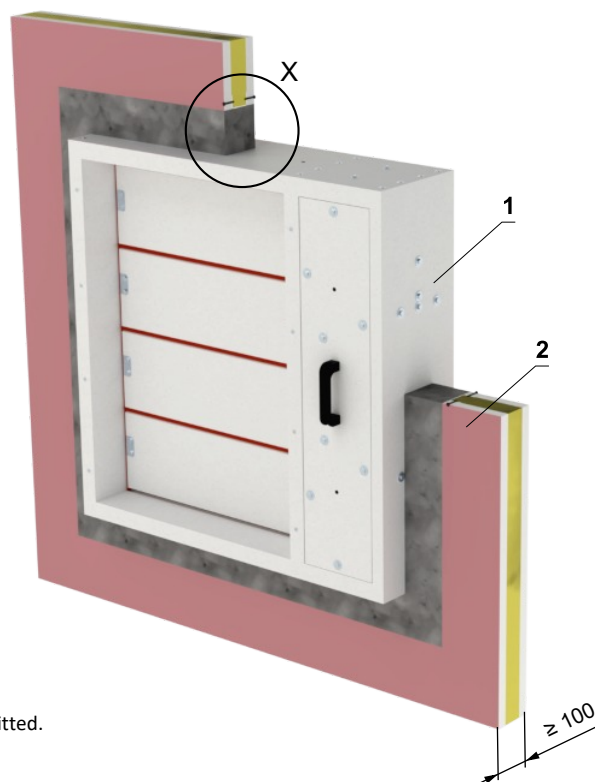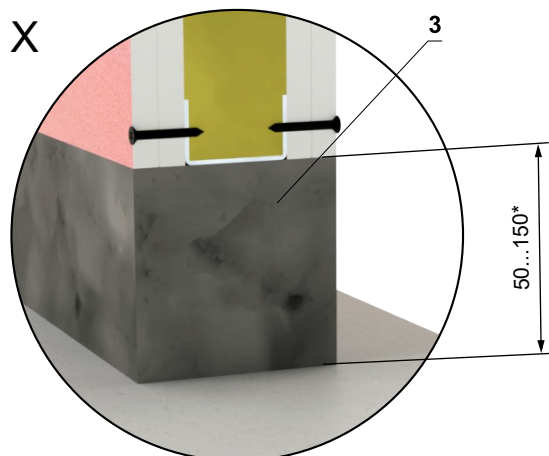

* In the case of fire resistance EI 120, the installation gap is limited to 50 mm ^{+10/-0}.
For fire resistance EI 90 or lower, an installation gap range of 50–150 mm is permitted.

W = min. 50 mm*
W = max. 150 mm*

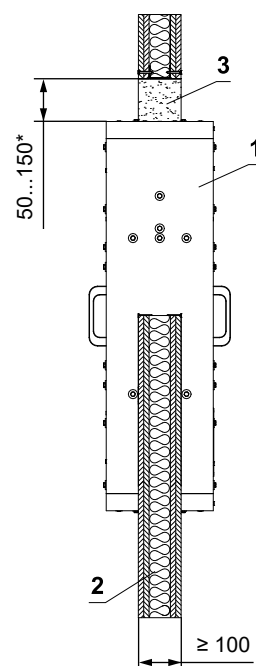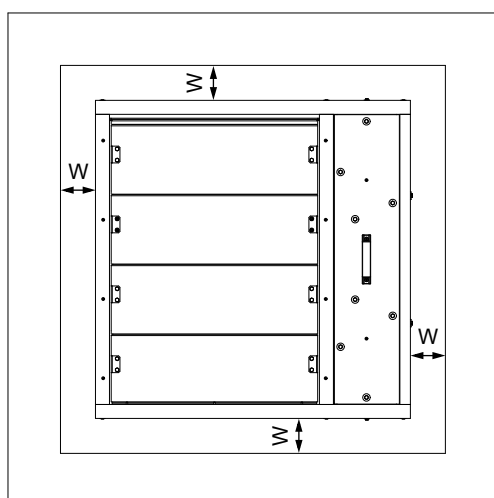



- 1 SEDM-L
- 2 Gypsum wall construction
- 3 Mortar or gypsum

In gypsum wall or shaft wall construction min. EI 90 - Ablative Coated Batt

- Standard flexible wall construction min. EI 90 according to EN 1363-1.
- Examples of anchors to the fire dividing construction → see pages 38 to 40
- The installation opening is lined with a UW/CW profile.



EI90(v_{edw})S1000[H]C_{mod}HOT400/30MAmulti
 *EI120(v_{edw})S1000[H]C_{mod}HOT400/30MAmulti¹⁾

1) Where the damper is installed without a connected duct, the installation shall be terminated with a grille.

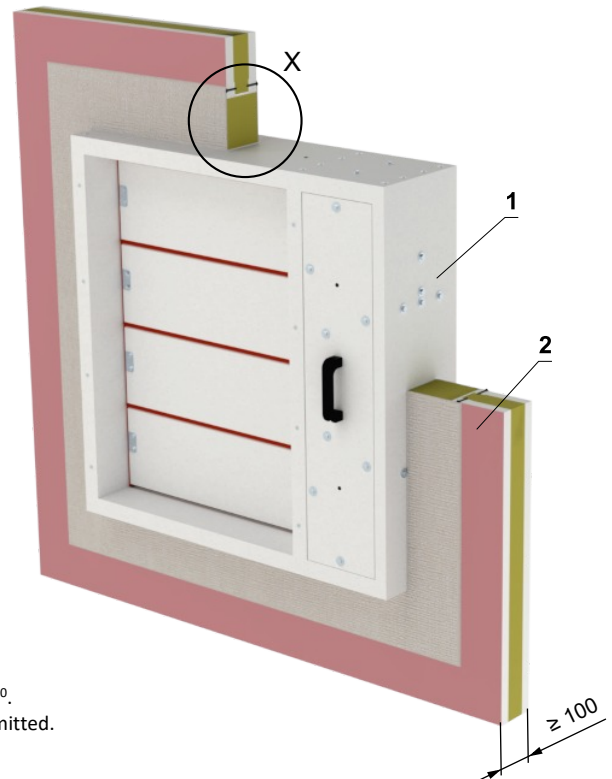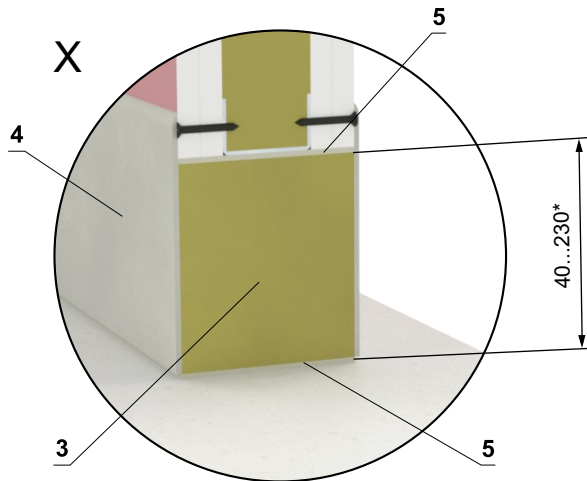

* In the case of fire resistance EI 120, the installation gap is limited to 200 mm ^{+0/-10}.
 For fire resistance EI 90 or lower, an installation gap range of 40–230 mm is permitted.

W = min. 40 mm*
 W = max. 230 mm*

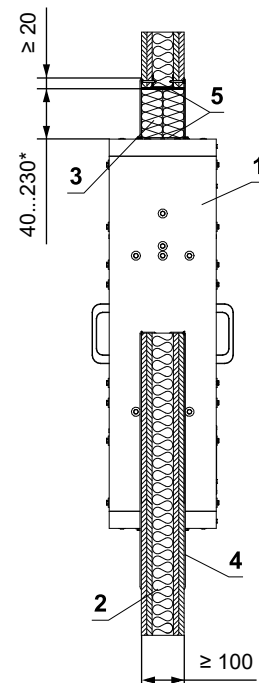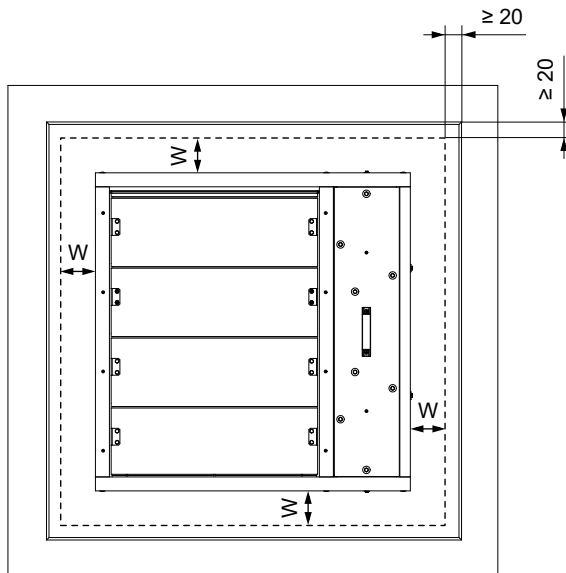

- 1 SEDM-L
- 2 Gypsum wall construction
Ablative Coated Batt System HILTI**
- 3 Mineral wool board - min. density 140 kg/m³ (HILTI CFS-CT B 1S 140/50...)
- 4 Fire stop coating - th. 1 mm (HILTI CFS-CT...) - coating is overcoated on the support construction and on the damper casing/duct.
- 5 Fire-resistant mastic - (HILTI CFS-S ACR...) fill the gap from both sides of the fire separation construction and around the perimeter of penetration and damper casing.

** HILTI system can be replaced by a similar system with the same or higher thickness, density, fire reaction class, tested according to EN 1366-3.







In shaft wall construction

In shaft wall construction min. EI 120 - mortar or gypsum

EI120(v_{edw})S1000[H]C_{mod}HOT400/30MAmulti^{1]}

- Non-standard asymm. shaft wall construction, min. EI 120
- Examples of anchors to the fire dividing construction → see pages 38 to 40
- It is possible to use e.g. wall type A306030... from www.british-gypsum.com
- It is possible to use walls that have the same or greater thickness and density of boards than the walls listed below (more layers of boards can also be used)
- Follow the instructions of the shaft wall manufacturer.
- Damper must be properly supported until the gypsum has fully hardened.

1] Where the damper is installed without a connected duct, the installation shall be terminated with a grille.

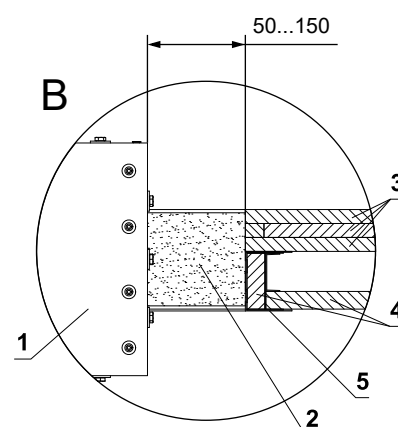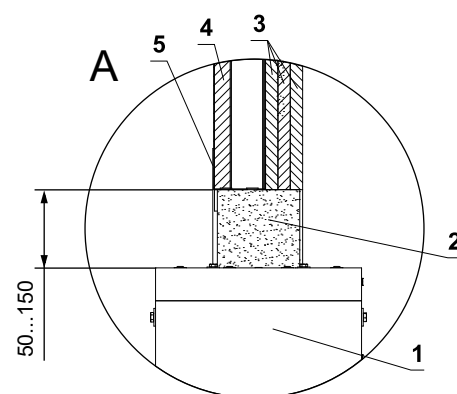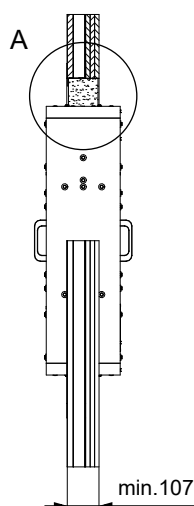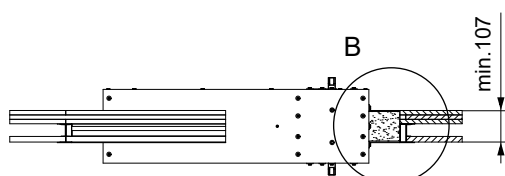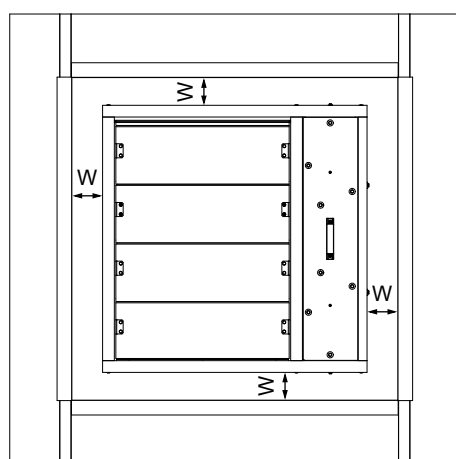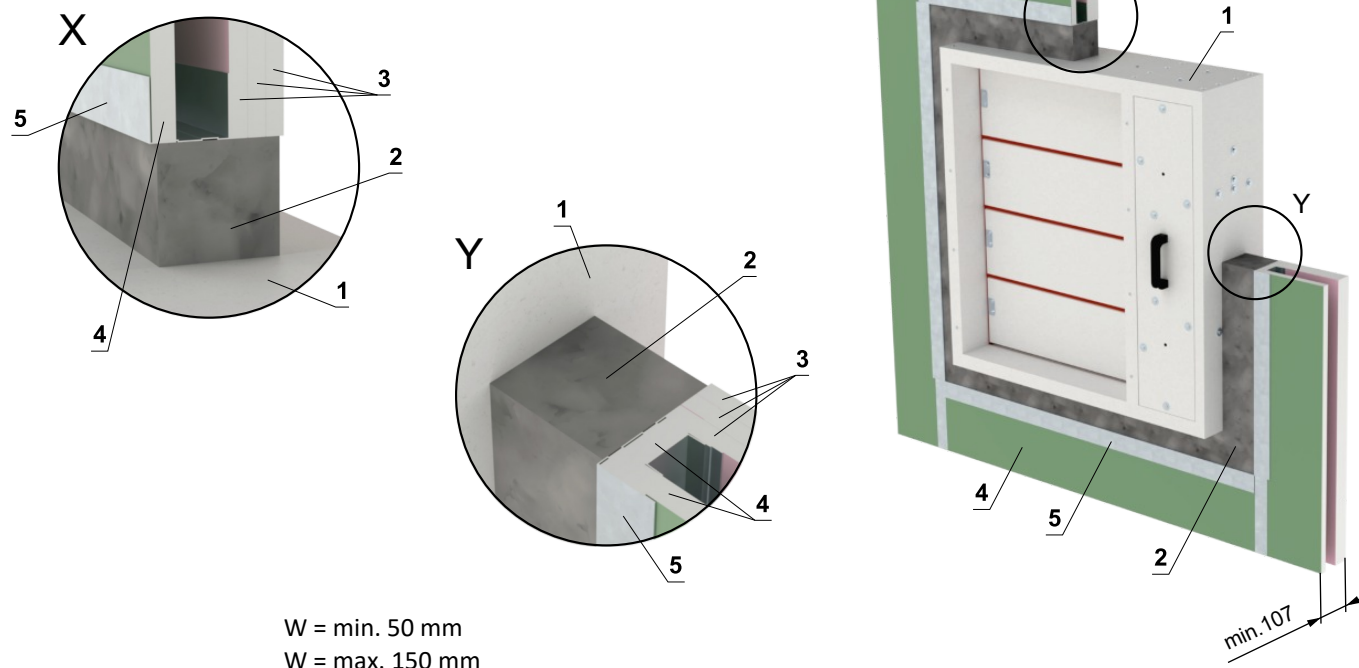

- 1 SEDM-L
- 2 Mortar or gypsum
- 3 Plasterboard EN 520 - Type F min. 3x15 mm
- 4 Plasterboard EN 520 - Type F min. 1x19 mm
- 5 Plasterboard profile


In solid ceiling construction

In solid ceiling construction - mortar or gypsum



- Standard low- and high-density rigid floor construction according to EN 1366-2
- Examples of anchors to the fire dividing construction → see pages 38 to 40
- Damper must be properly supported until the gypsum has fully hardened.
- The damper can be installed from both sides of the construction, i.e. From the top or the bottom side of the ceiling

EI90(h_{od})S1000[H]C_{mod}HOT400/30MAmulti
EI120(h_{od})S1000[H]C_{mod}HOT400/30MAmulti¹⁾

1) Where the damper is installed without a connected duct, the installation shall be terminated with a grille.

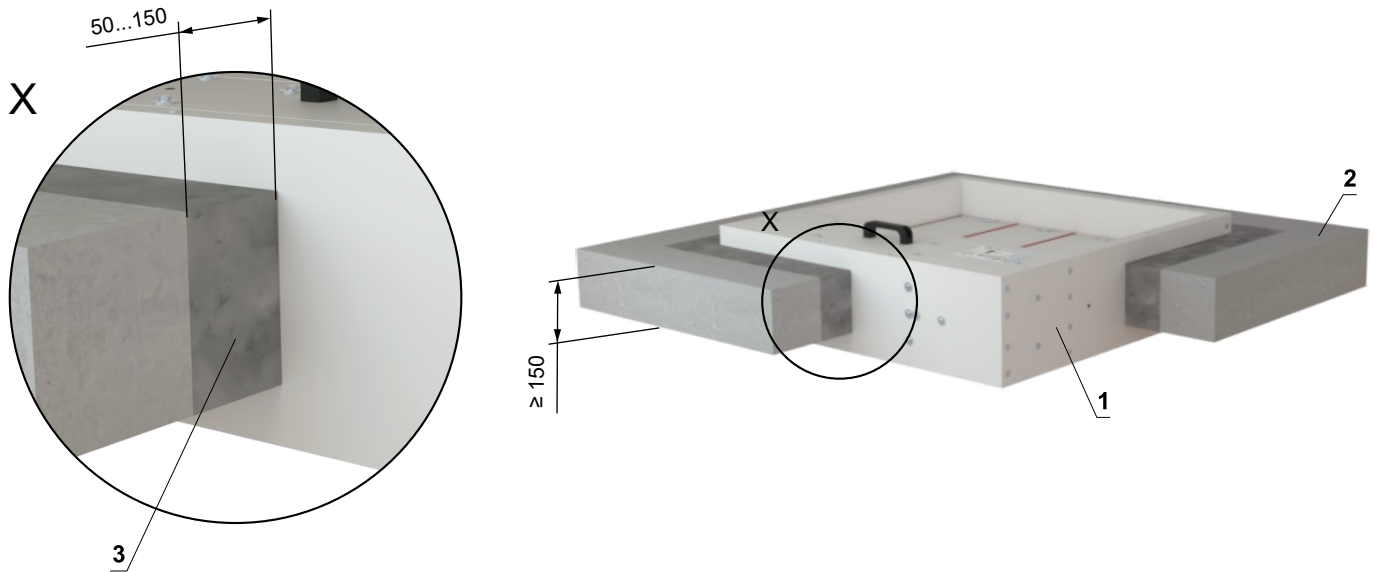

W = min. 50 mm
 W = max. 150 mm

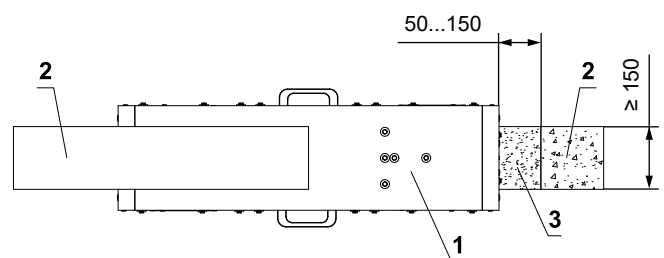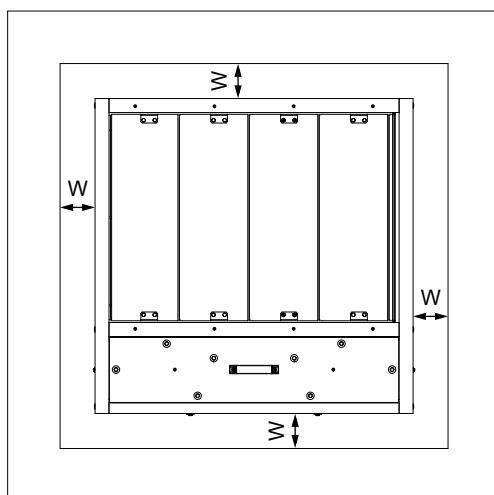

- 1 SEDM-L
- 2 Solid ceiling construction
- 3 Mortar or gypsum

Installation damper into/onto smoke extraction ducts

EI90(v_{ed})S1000[H]C_{mod}HOT400/30MAmulti¹⁾
EI120(v_{ed})S1000[H]C_{mod}HOT400/30MAmulti²⁾

Installation of the damper into/onto steel smoke extraction duct insulated with mineral wool

1) Damper installed onto a duct without grille

2) Damper installed into a duct or onto a duct with grille

■ The dampers may be installed onto or into smoke extraction ducts listed below:

■ FlameshieldEN (manufacturer Kent Ductwork Ltd.)

The duct is made of 1.2 mm thick galvanized steel sheet and insulated with 1 layer of 90 mm thick stone wool Rockwool FirePro DuctRock Slab (manufacturer ROCKWOOL Ltd.). The stone wool is finished with a black aluminium foil on the outer side.

■ FPL BW18 (manufacturer Fire Protection Ltd.)


The duct is made of galvanized steel sheet. The thickness of the duct depends of its dimensions. The surface of the duct is fire sprayed with Flamebar BW18 (manufacturer Firespray International Ltd). The duct is insulated with two layers of stone wool. The first layer is made of 50 mm thick ROCKWOOL FPL 110 SLAB and the second layer with aluminium foil is made of 50 mm thick ROCKWOOL FPL 110 FOIL FACED SLAB (manufacturer ROCKWOOL Ltd.)

■ IFS-DS (manufacturer Imperial Ductwork Services Ltd.)

The duct is made of 1 mm thick galvanized steel sheet and insulated with two layers of 60 mm thick stone wool ULTIMATE U Protect Slab 4.0 Alu1 (manufacturer ISOVER). The stone wool is finished with a black aluminium foil on the outer side.

■ The dampers may be installed onto or into other smoke extraction ducts than that specified above with the following limitations:

- The duct shall be tested according to EN 1366-9 or EN 1366-8 depending on the intended use.
- The duct shall be made of material of the same or greater density and of the same or greater thickness as the ducts listed above.
- Changing surface protection materials is not permitted.
- Changing the paint surface finish is not permitted.
- The damper must be independently provided with a duct support within 100 mm of the centre of the damper blade axis.
- Support, drop rods, anchors etc. must be used in accordance with a duct manufacturer instructions.
- The connected duct shall be suspended in such a way that the transfer of all loads from the duct to the damper is completely excluded.
- The damper may be installed in vertical position with the horizontal position of the blades axis.

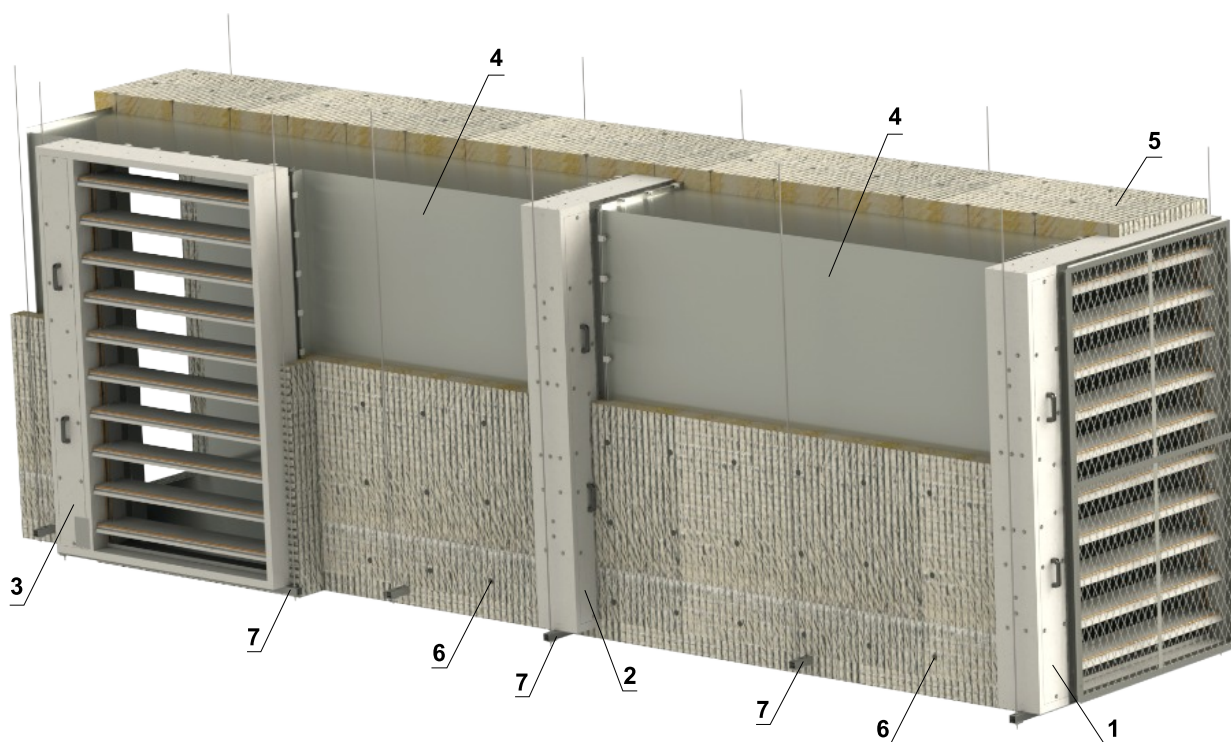

- 1 SEDM-L 2x flange, 1x grille
- 2 SEDM-L 2x flange
- 3 SEDM-L 1x flange*
- 4 Smoke extraction duct (type according to duct manufacturer instructions)
- 5 Surface protection material (type according to duct manufacturer instructions)
- 6 Steel insulation pin (type according to duct manufacturer instructions)
- 7 Suspension system (type according to duct manufacturer instructions)


* If the damper is installed as the final element in the duct system (i.e. with no ducting behind it), it must be fitted with a grille. Otherwise, the fire resistance will be reduced to EI 90 S.

(continued on next page)


continuation of installation the damper into/onto steel smoke extraction duct insulated with mineral wool

■ The damper is connected to the smoke extraction duct by the damper flange as follow:


- M10 bolts, washers and nuts are used at the corners of the flange
- C-clamps with M8 bolts with a maximum spacing of 200 mm are used around the circumference
- Ceramic selfadhesive sealing tape is inserted between flanges
- The gap between the flanges is filled with intumescent acrylic sealant*

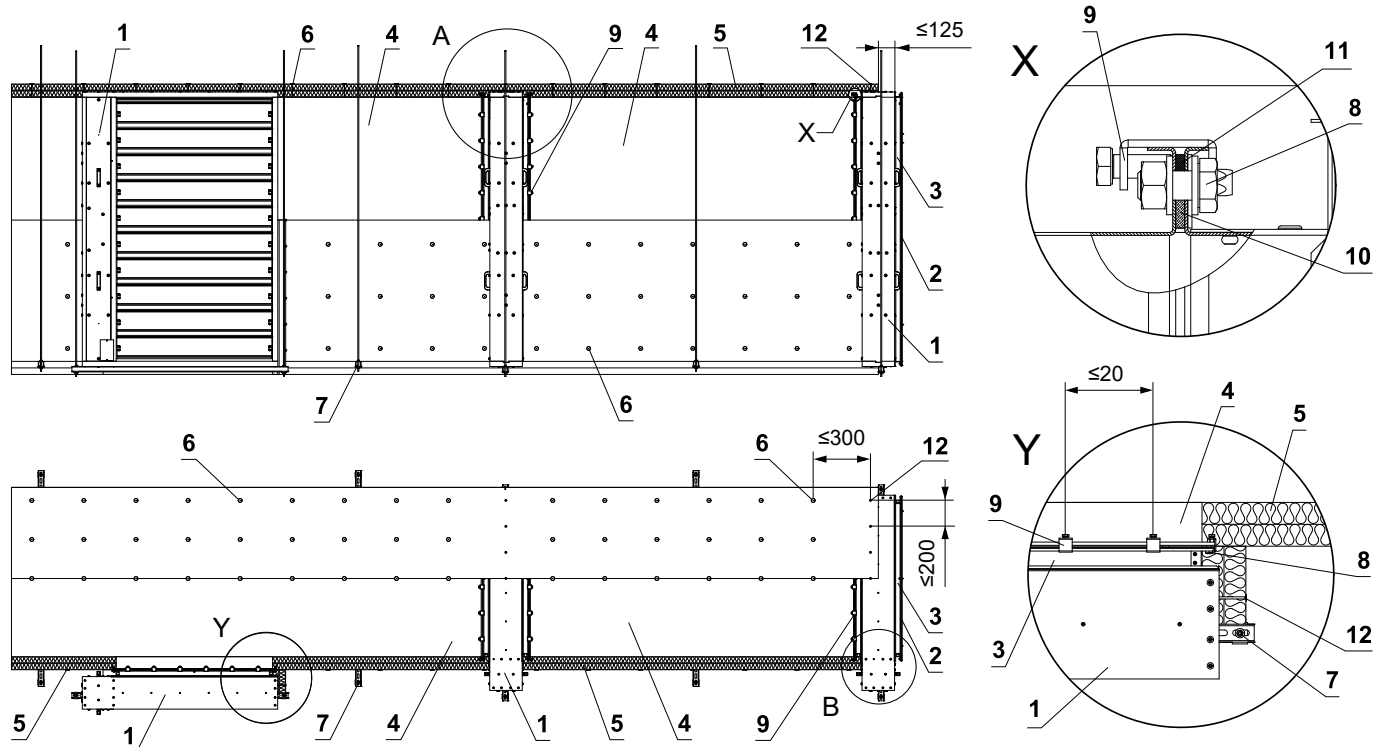


FlameshieldEN

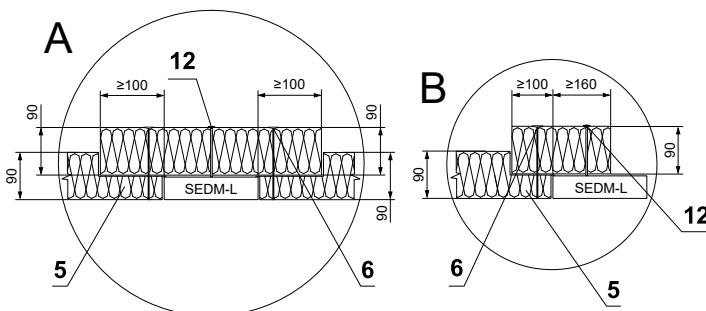

FPL BW18

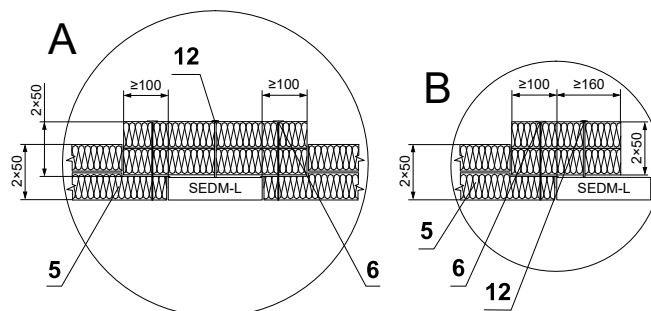

IFS-DS

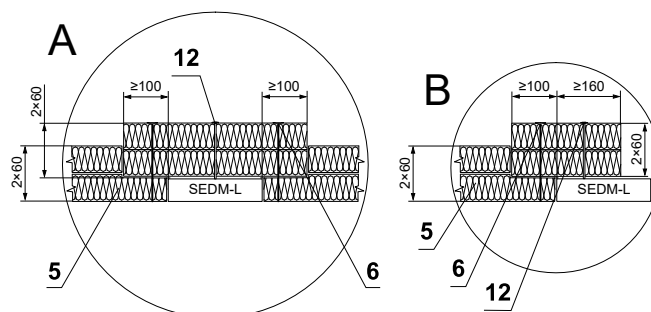

- 1 SEDM-L
- 2 KMM grille
- 3 SEDM-L flange
- 4 Smoke extraction duct
- 5 Surface protection material (type according to duct manufacturer instructions)
- 6 Steel insulation pin (type according to duct manufacturer instructions)
- 7 Suspension system (type according to duct manufacturer instructions)
- 8 Flange connection at corners - M10 bolt, washers and nut
- 9 M8 C-clamps - maximum spacing of C-clamps 200 mm (type according to duct manufacturer instructions)
- 10 Ceramic selfadhesive sealing tape - around the duct circumference (type according to duct manufacturer instructions)
- 11 Intumescent acrylic Sealant - around the duct circumference (type according to duct manufacturer instructions)*
- 12 Insulation connection to the damper body - washer M5 (DIN 125A), screw 5xL mm (screw lenght = insulation thickness + 20 mm)


* To be used only for FPL BW18 duct type

**Installation of the damper into/onto smoke extraction duct
made of calcium silicate boards**

**EI90(v_{ed})S1000[H]C_{mod}HOT400/30MAmulti^{1]}
EI120(v_{ed})S1000[H]C_{mod}HOT400/30MAmulti^{2]}**

- 1] Damper installed onto a duct without grille
2] Damper installed onto or into a duct with grille

- The dampers may be installed onto or into smoke extraction ducts listed below:
 - **Smoke extraction duct Promatect-L500 (manufacturer Promat)**
Smoke extraction self-supporting duct made of Promatect-L500 of thickness 40 mm and density 500 kg/m³.
- The dampers may be installed onto or into other smoke extraction ducts than that specified above with the following limitations:
 - The duct shall be tested according to EN 1366-9 or EN 1366-8 depending on the intended use.
 - The duct shall be made of material of the same or greater density and of the same or greater thickness as the ducts listed above.
- Support, drop rods, anchors etc. must be used in accordance with a duct manufacturer instructions.
- The connected duct shall be suspended in such a way that the transfer of all loads from the duct to the damper is completely excluded.
- The damper may be installed in position according picture below.

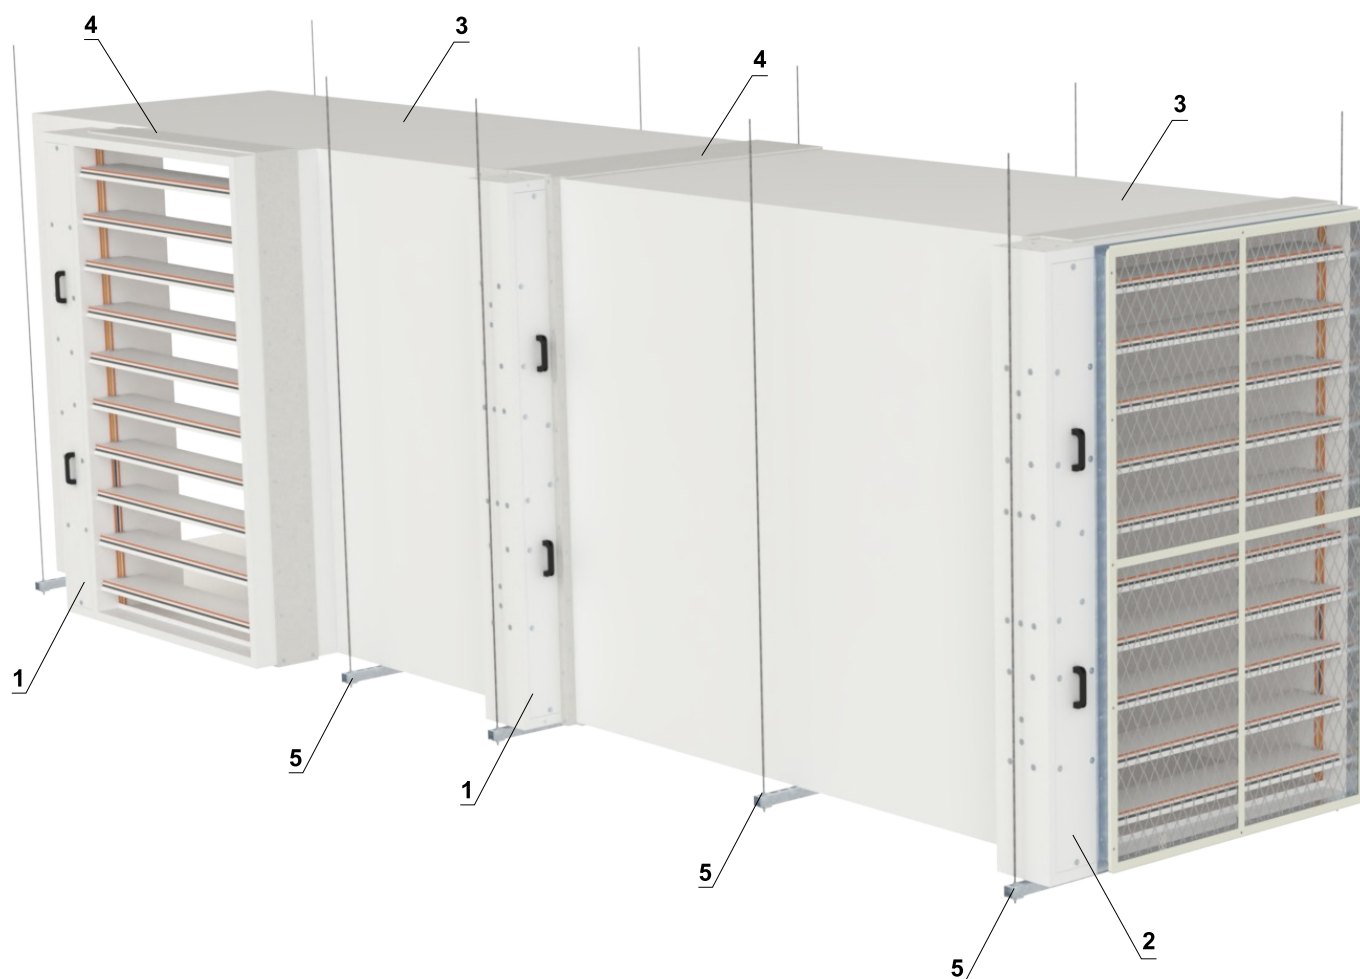


* If the damper is installed as the final element in the duct system (i.e. with no ducting behind it), it must be fitted with a grille. Otherwise, the fire resistance will be reduced to EI 90 S.

- 1 SEDM-L without flange and KMM grille*
- 2 SEDM-L with flange and KMM grille
- 3 Smoke extraction duct made of calcium silicate boards (e.g. PROMATECT-L500, th. 40 mm)
- 4 Connecting strip (e.g. PROMATECT-H, th. 10 mm, width 200 mm) - screwed across the gap between the damper body and the adjacent duct using 5×40 mm screws at a spacing of max. 200 mm. Joints between the damper, duct segment and connecting strip sealed with adhesive (e.g. PROMAT K84).
- 5 Suspension system (type according to duct manufacturer instructions)

(continued on next page)

continuation of installation the damper into/onto smoke extraction duct made of calcium silicate boards


- The damper is connected to the smoke extraction duct made of calcium silicate boards (e.g. PROMATECT-L500, th. 40 mm) as follow:
 - Using a connecting strip (e.g. PROMATECT-H, th. 10 mm, width 200 mm) - screwed across the gap between the damper body and the adjacent duct using 5×40 mm screws at a spacing of max. 200 mm. Joints between the damper, duct segment and connecting strip sealed with adhesive (e.g. PROMAT K84).

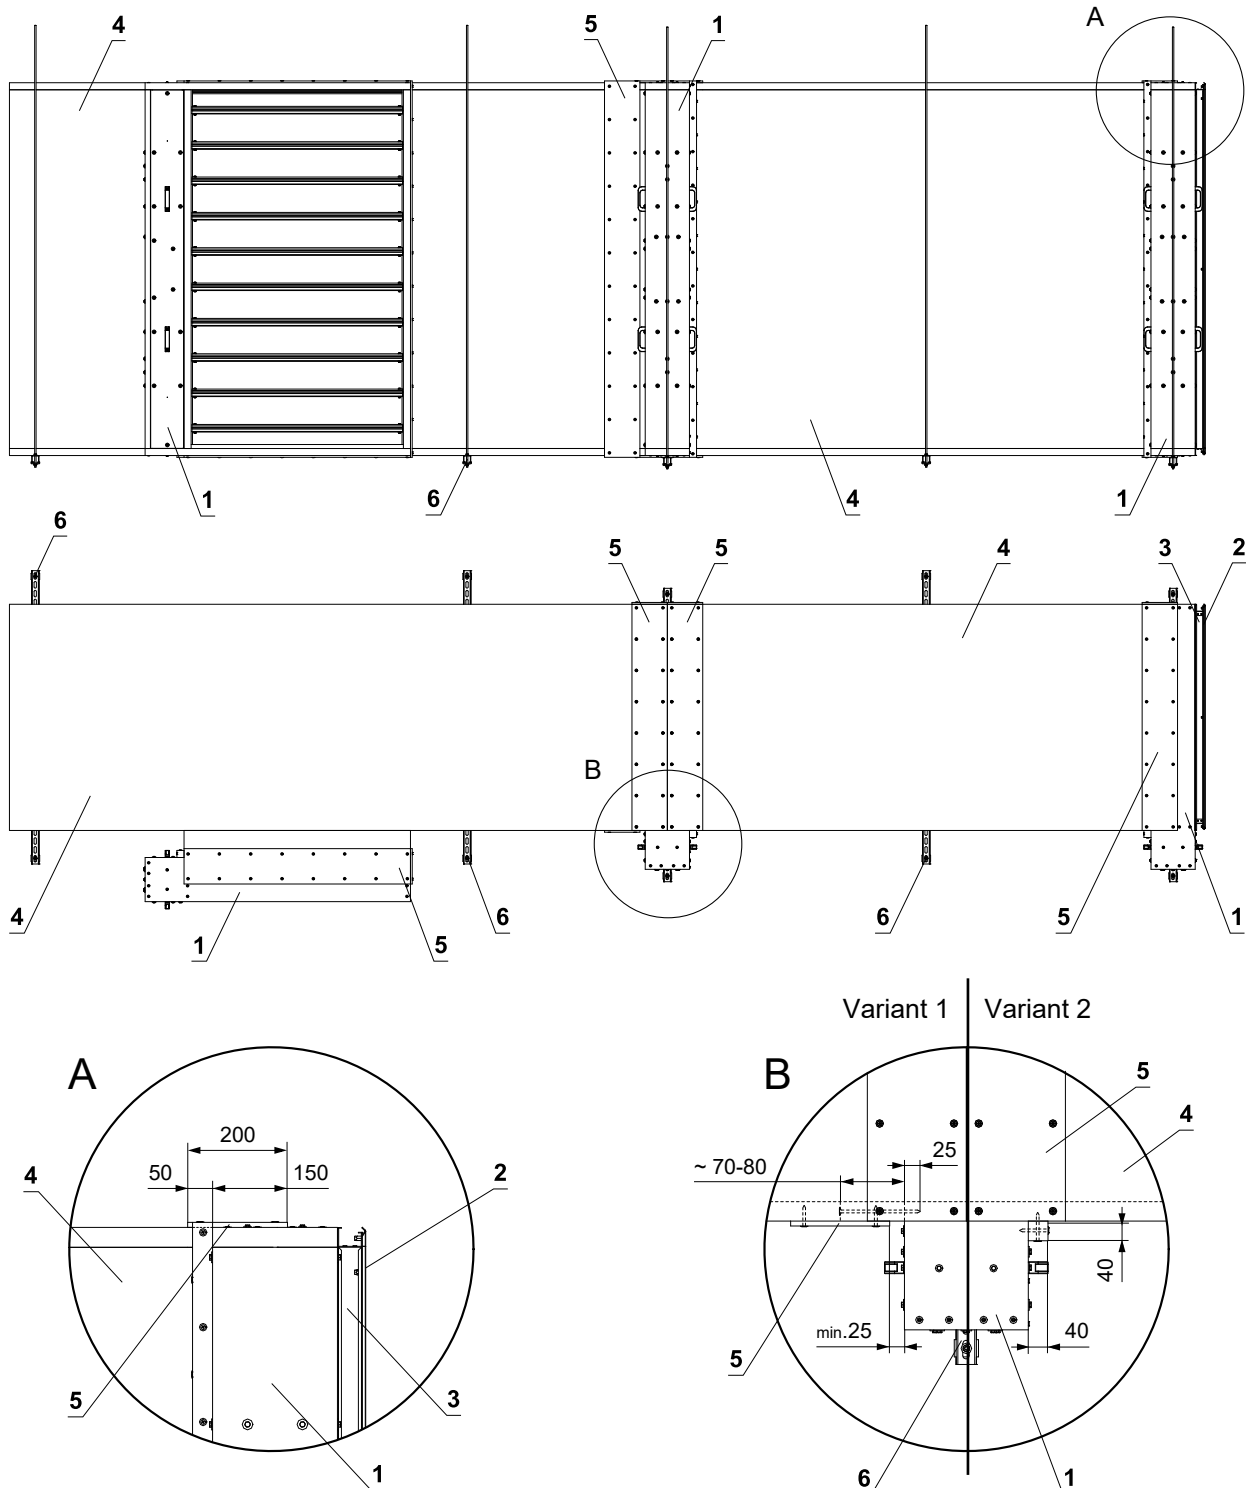

- 1 SEDM-L
- 2 KMM grille
- 3 SEDM-L flange
- 4 Smoke extraction duct made of calcium silicate boards (e.g. PROMATECT-L500, th. 40 mm)
- 5 Connecting strip (e.g. PROMATECT-H, th. 10 mm, width 200 mm) - screwed across the gap between the damper body and the adjacent duct using 5×40 mm screws at a spacing of max. 200 mm. Joints between the damper, duct segment and connecting strip sealed with adhesive (e.g. PROMAT K84).
- 6 Suspension system (type according to duct manufacturer instructions)


Installation of the damper on the fire-rated Orishaft duct

EI60(v_{ed})S1000[H]C_{mod}HOT400/30MAmulti
E120(v_{ed})S1000[H]C_{mod}HOT400/30MAmulti

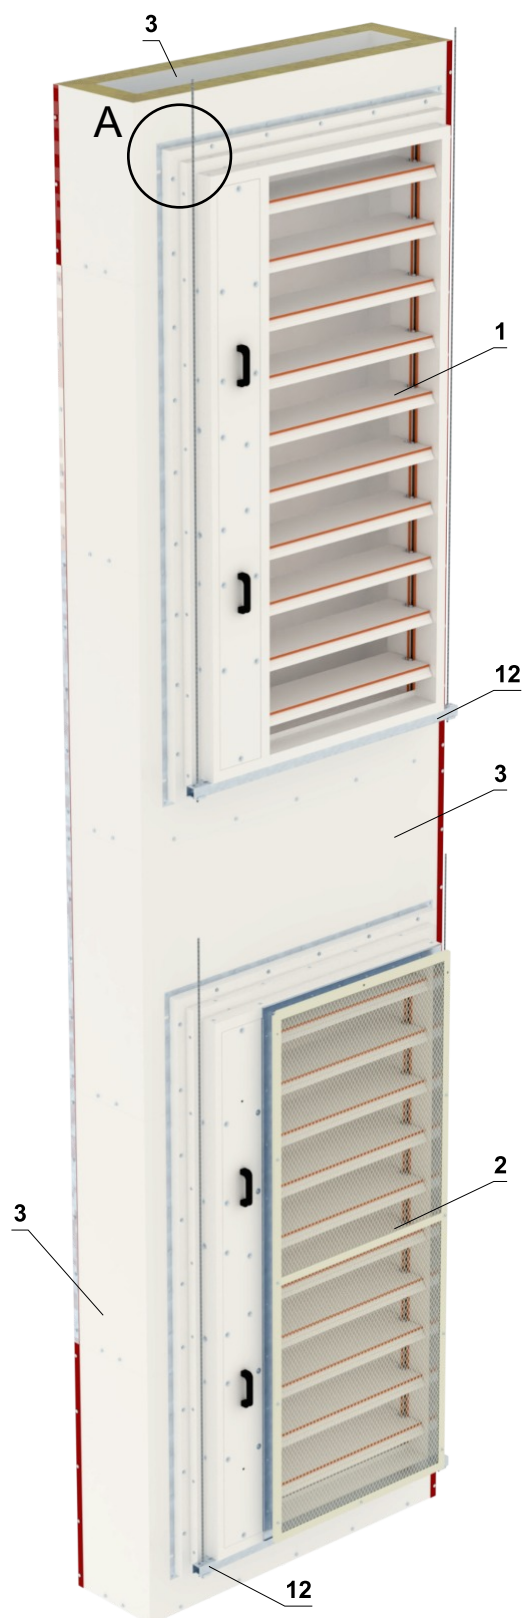

- 1 SEDM-L without flange and KMM grille
- 2 SEDM-L with 1x flange and 1x KMM grille
- 3 Duct Orishaft (manufacturer: Kera Group Oy)
- 4 Perforated profile 3 mm
- 5 Hexagon tapping screw 4,8x16 mm
- 6 Kerafix flexpress 100, 75x2 mm
- 7 Firerated sealant HILTI CFS-S ACR or equivalent sealant

- The fire-rated duct Orishaft (manufacturer: Kera Group Oy), is constructed from sandwich panels.
- The sandwich panel has a thickness of 100 mm and consists of two 0.6 mm steel sheets with mineral wool insulation in between, with a nominal density of 110 kg/m³.
- The damper must be independently provided with a duct support within 100 mm of the centre of the damper blade axis.
- Support, drop rods, anchors etc. must be used in accordance with a duct manufacturer instructions.
- The connected duct shall be suspended in such a way that the transfer of all loads from the duct to the damper is completely excluded.
- The damper may be installed in vertical position with the horizontal position of the blades axis.

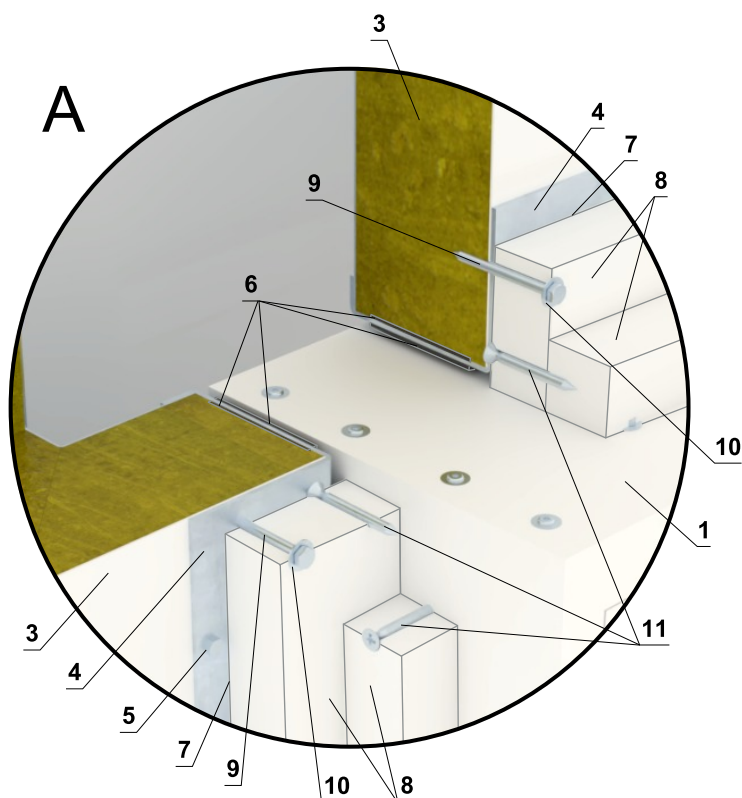


- 8 Sealing collar of damper, made of strip PROMATECT-MST - th. 40 mm, the first one of 80 mm in width and the second one of 40 mm in width. All joints shall be sealed with Promat K84 adhesive or equivalent adhesive.
- 9 Hexagon head drilling screw 6,3x70 mm, DIN780-K ZN
- 10 Washer M6x18, ZN HV140
- 11 Universal screw 6x60/37 mm
- 12 Suspension system (type according to duct manufacturer instructions)

(continued on next page)

continuation of installation the damper installed on the fire-rated Orishaft duct

- The edges of the duct opening are provided with a profile made of 3 mm thick steel sheet. The profile is fixed to the duct panels using self-tapping screws (4,8×16 mm).
- Intumescent tape Kerafix Flexpress 100, with a cross-section of 75×2 mm, is glued to the profile around the circumference of the opening.
- The damper housing is equipped with a sealing collar made of two strips of PROMATECT®-MST boards, each 40 mm thick. The first strip is 80 mm wide, and the second strip is 40 mm wide. The two strips are joined together using 6×60 mm screws and fixed to the damper housing with the same screws. All joints are bonded with Promat K84 adhesive or equivalent adhesive.
- The joint between the damper and the duct is sealed with fire-rated sealant HILTI CFS-S ACR or equivalent sealant.
- The damper is inserted into the opening to a depth of 100 mm and fixed through the 80 mm board strip to the perforated profile using head-drilling screws (6,3×70 mm) with washers M6×18.

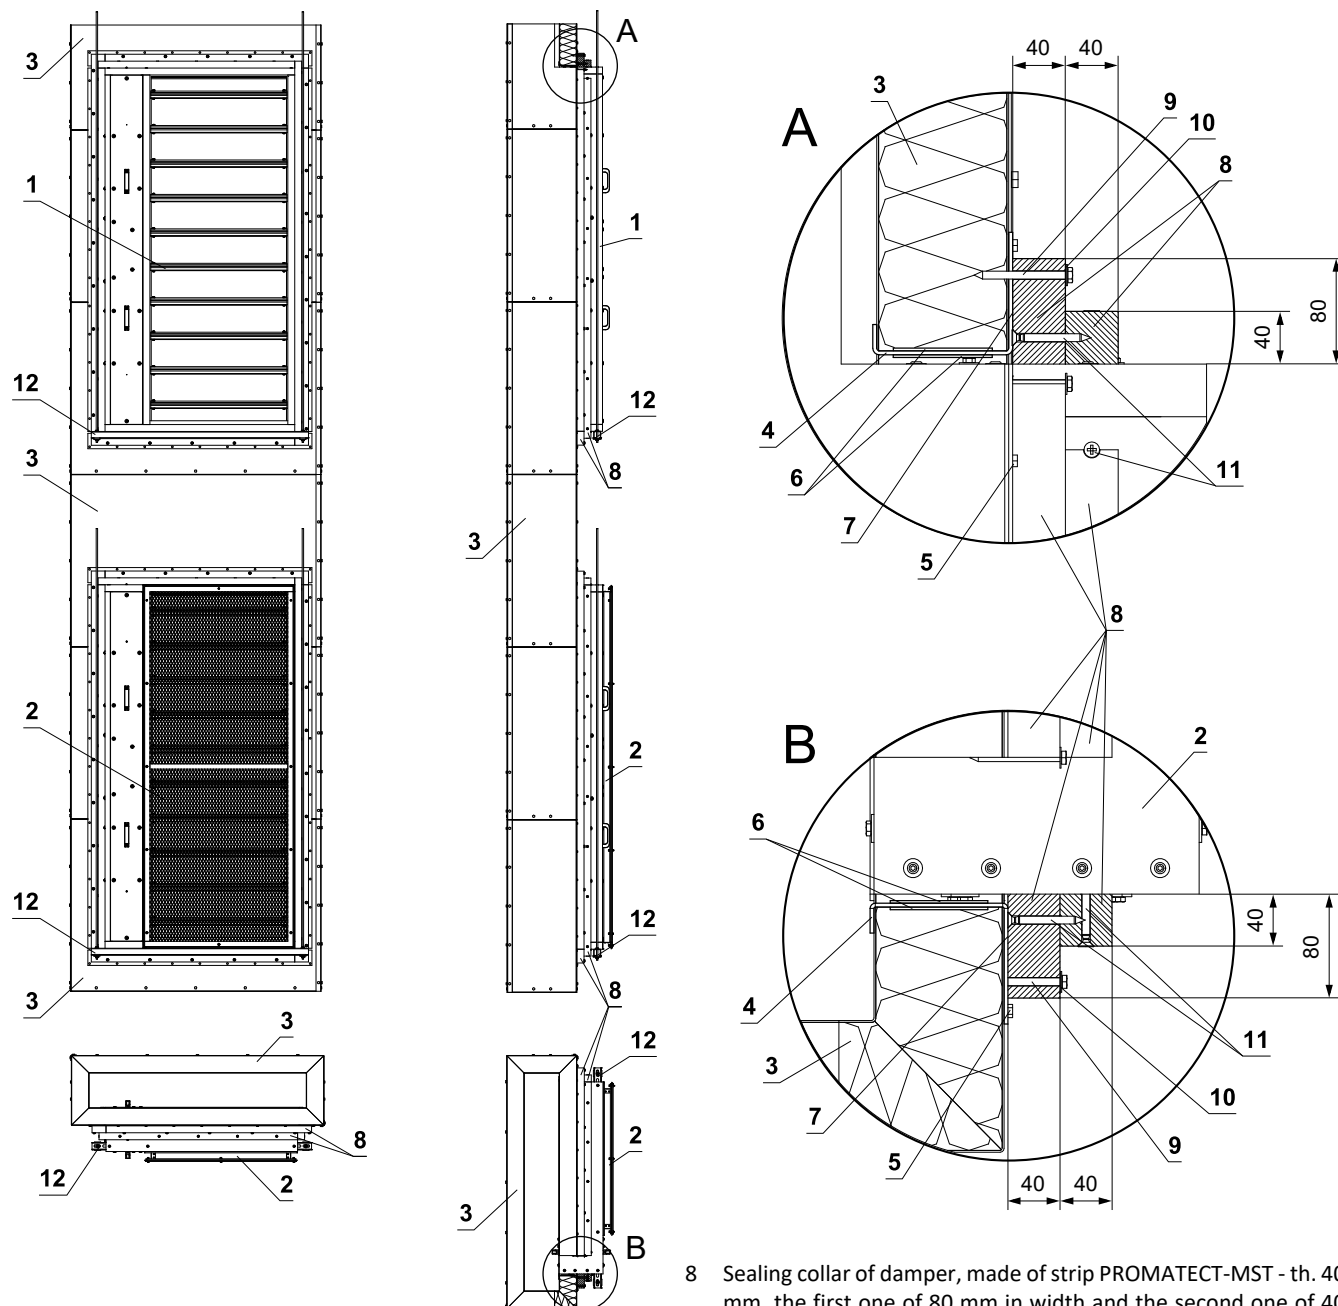


- 1 SEDM-L without flange and KMM grille
- 2 SEDM-L with 1x flange and 1x KMM grille
- 3 Duct Orishaft (manufacturer: Kera Group Oy)
- 4 Perforated profile 3 mm
- 5 Hexagon tapping screw 4,8×16 mm
- 6 Kerafix flexpress 100, 75×2 mm
- 7 Firerated sealant HILTI CFS-S ACR or equivalent sealant

- 8 Sealing collar of damper, made of strip PROMATECT-MST - th. 40 mm, the first one of 80 mm in width and the second one of 40 mm in width. All joints shall be sealed with Promat K84 adhesive or equivalent adhesive.
- 9 Hexagon head drilling screw 6,3×70 mm, DIN780-K ZN
- 10 Washer M6×18, ZN HV140
- 11 Universal screw 6×60/37 mm
- 12 Suspension system (type according to duct manufacturer instructions)

V. SUSPENSION SYSTEMS


Fixing SEDM-L to the solid wall construction - Ablative Coated Batt

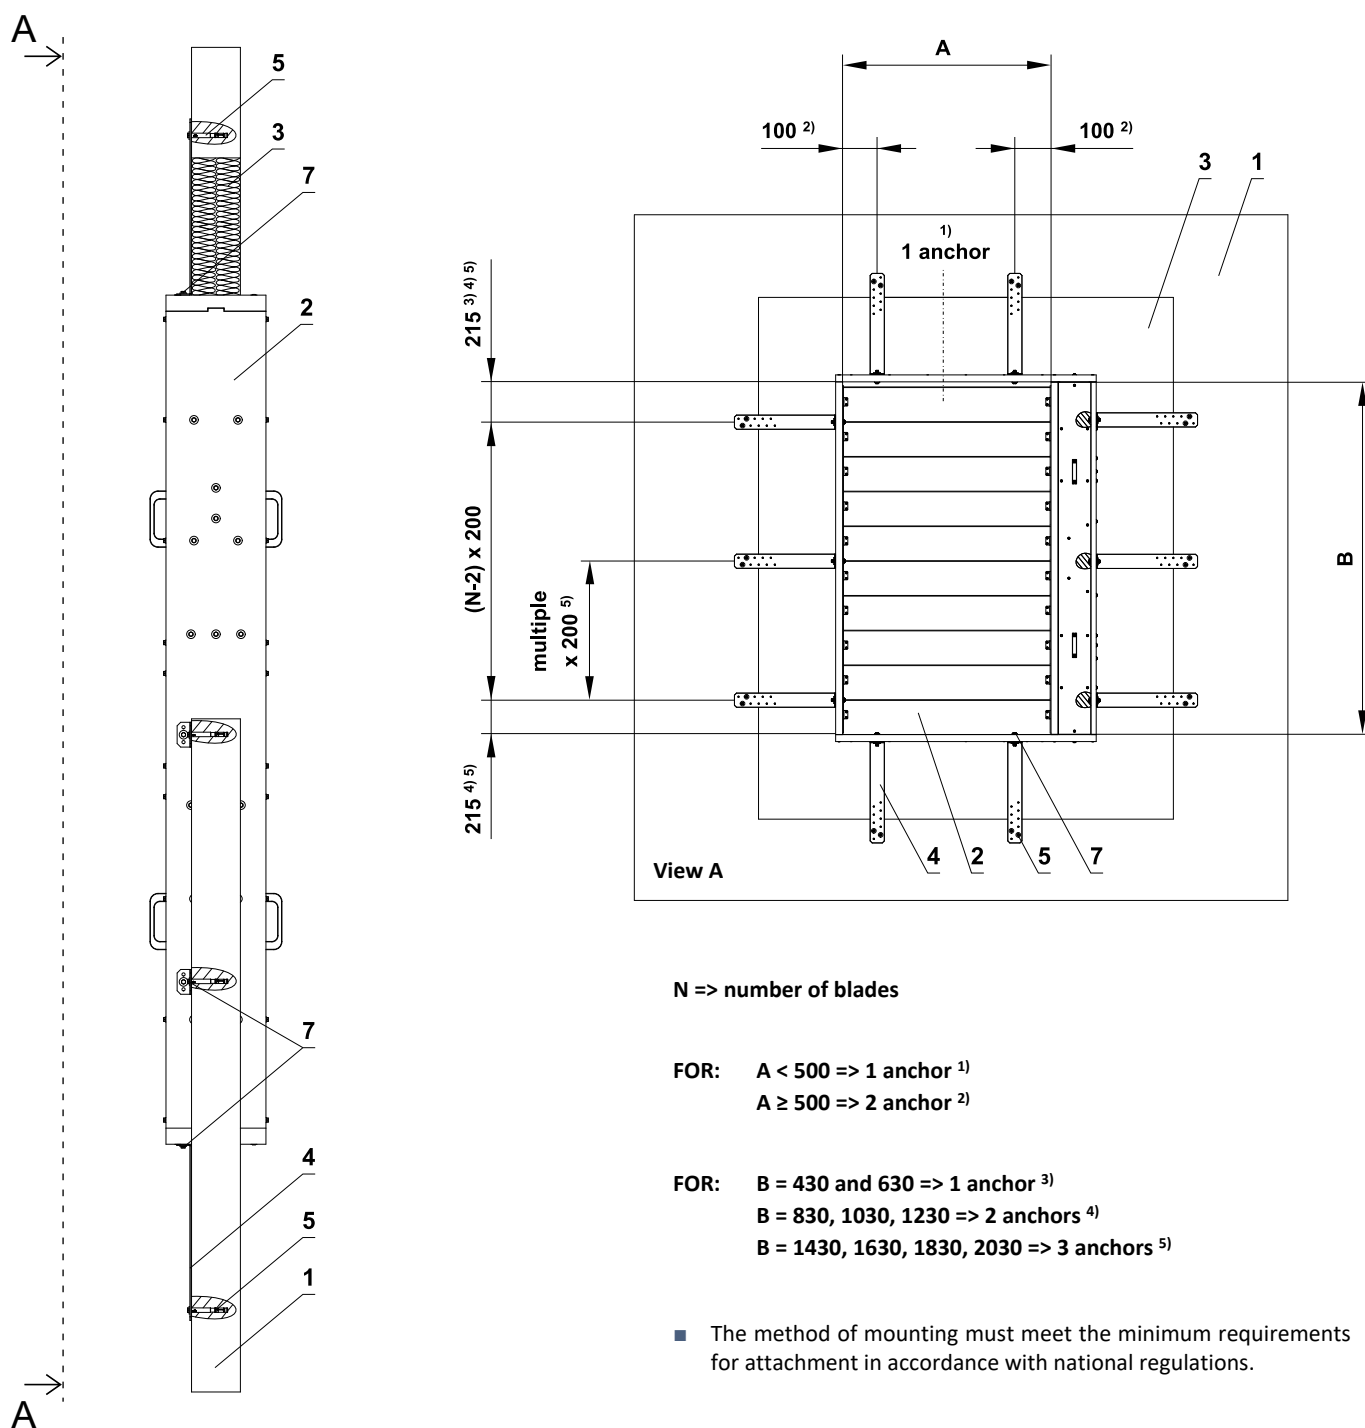


*** RESPECT JOINT POSITION !**

Bolts and nuts shall not prevent free rotation on the blades.

- 1 Solid wall construction
- 2 SEDM-L
- 3 Ablative Coated Batt
- 4 Installation holder for connecting damper to the wall (optional accessories MANDIK, a.s. or sheet metal min. thickness 2 mm and min. width 60 mm). Full drawing of bracket, → see page 40
- 5 Anchor to concrete min. M6
- 6 Installation holes
- 7 M8 bolt assembly (bolt M8x55 mm, 2 pcs large washer M8, nut M8) *

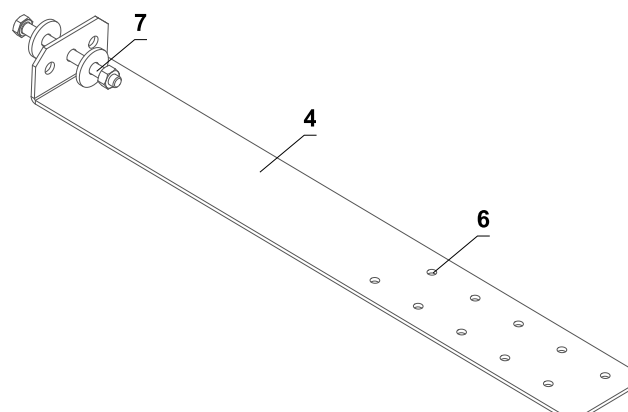

Fixing SEDM-L to the gypsum wall construction - Ablative Coated Batt

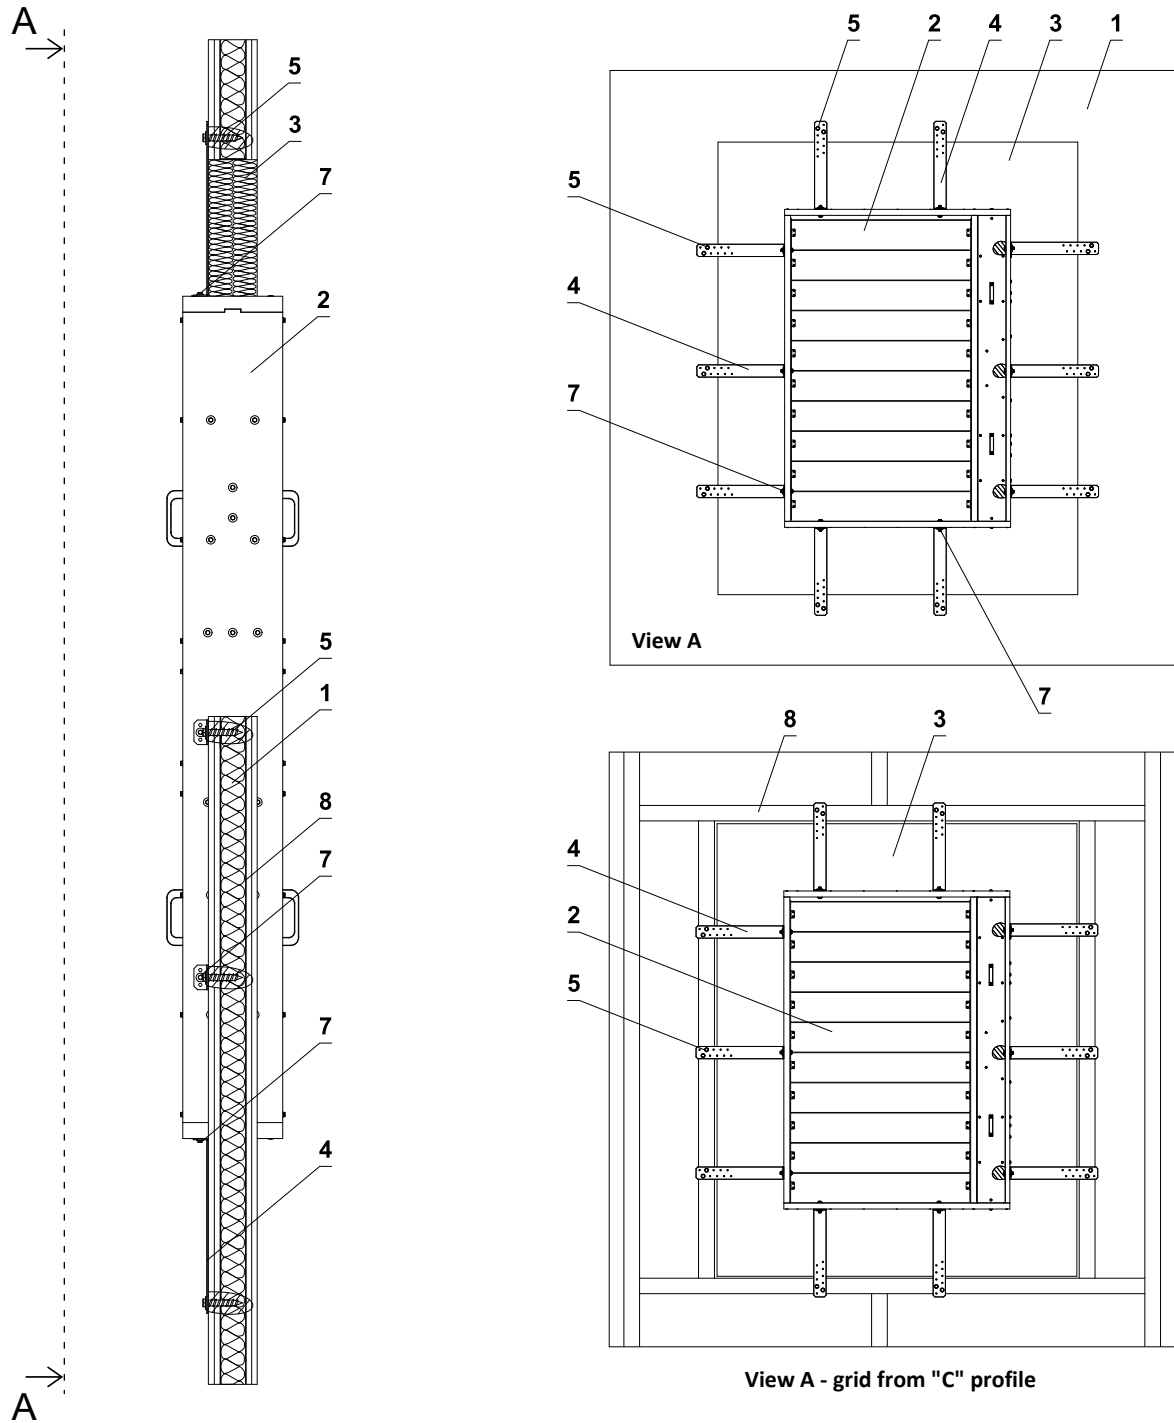



- The method of mounting must meet the minimum requirements for attachment in accordance with national regulations.

* RESPECT JOINT POSITION !

Bolts and nuts shall not prevent free rotation on the blades.

- 1 Gypsum wall construction
- 2 SEDM-L
- 3 Ablative Coated Batt
- 4 Installation holder for connecting damper to the wall (optional accessories MANDIK, a.s. or sheet metal min. thickness 2 mm and min. width 60 mm). Full drawing of bracket, → see page 40
- 5 Screw UNI 6x60 mm
- 6 Installation holes
- 7 M8 bolt assembly (bolt M8x55 mm, 2 pcs large washer M8, nut M8) *
- 8 Gypsum grid from "C" profile

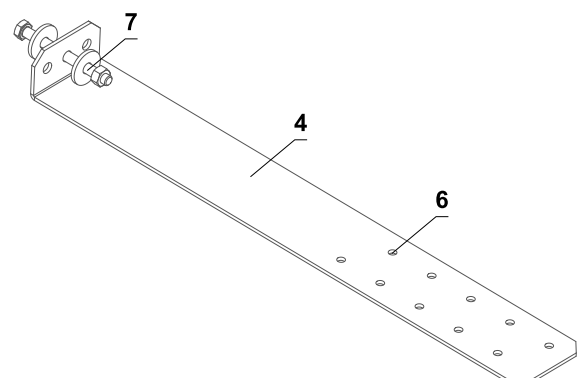


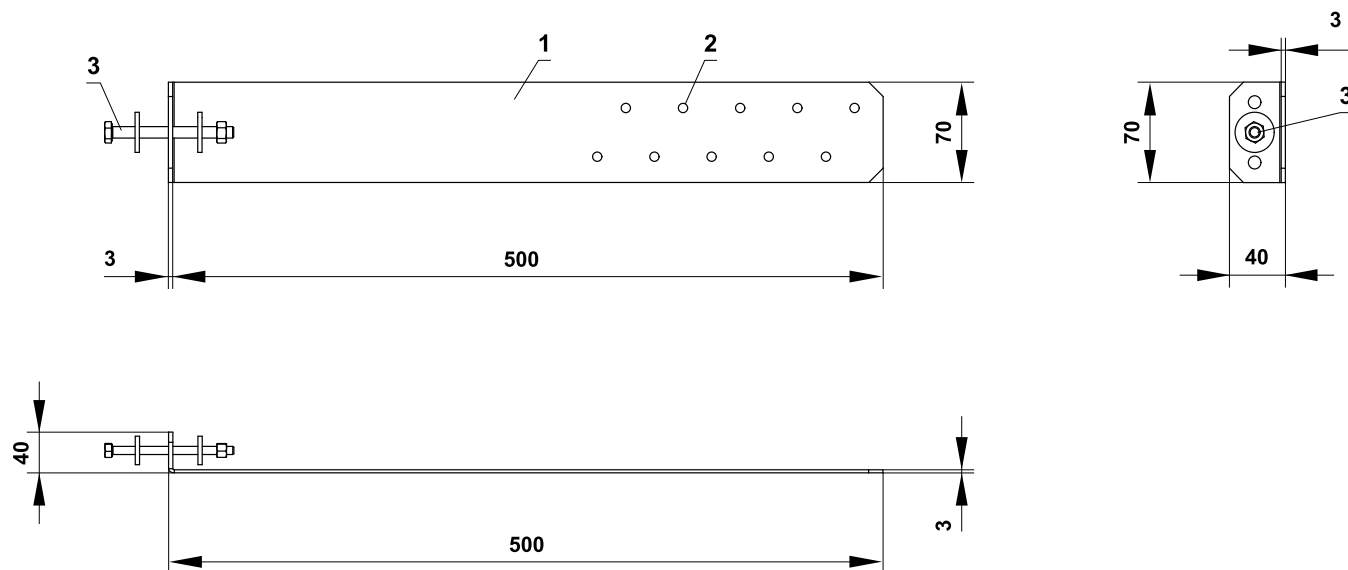Installation holder for connecting damper to the wall


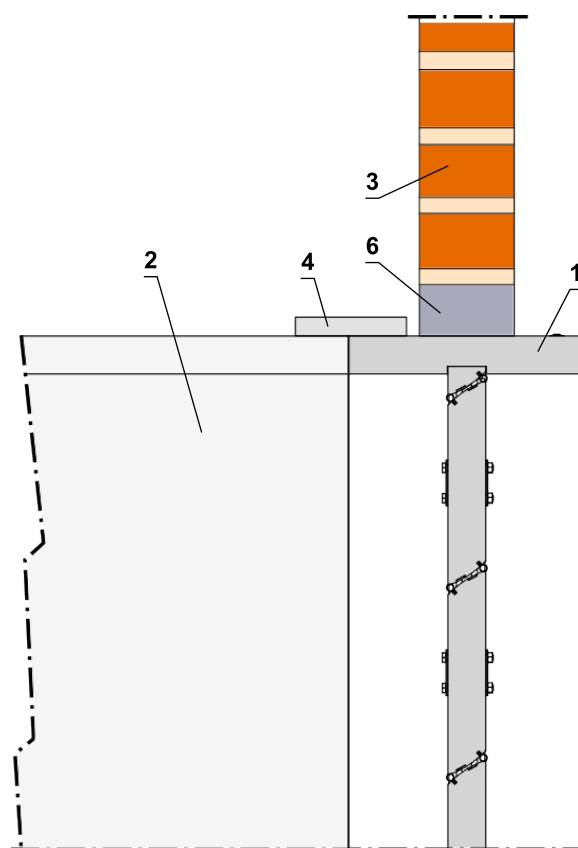
- 1 Installation holder for connecting damper to the wall (optional accessories MANDIK, a.s. or sheet metal min. thickness 2 mm and min. width 60 mm)
- 2 Installation holes
- 3 M8 bolt assembly (bolt M8x55 mm, 2 pcs large washer M8, nut M8)

Example of duct connection

Example of connection to SHEET STEEL duct

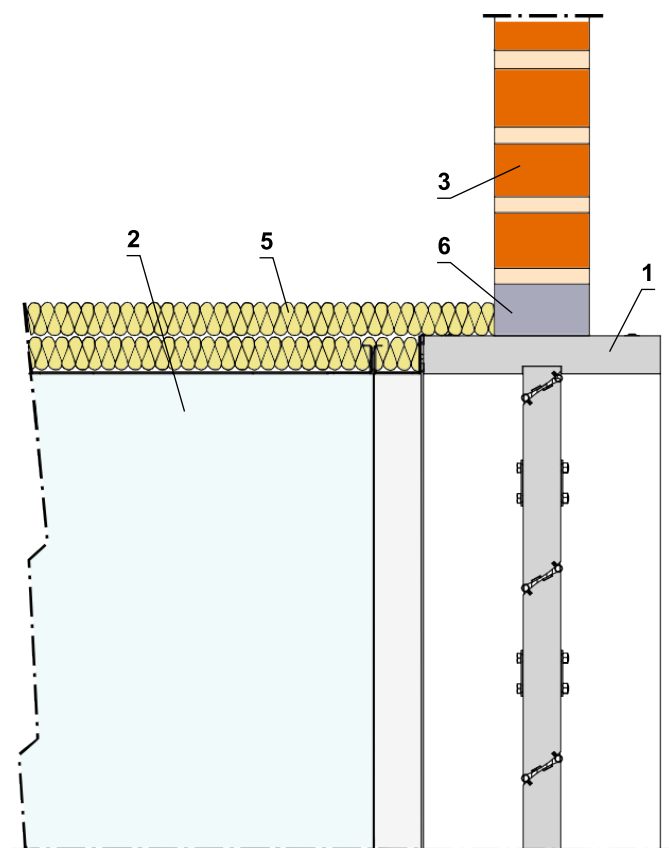

Example of connection to duct made of INSULATION BOARDS



- 1 SEDM-L
- 2 Smoke extraction duct - tested acc.to EN 1366-8 or EN 1366-9
- 3 Fire separating constructions
- 4 Overplating strip - min. th. 30 mm, the same material as a duct.
- 5 Surface protection material (type according to duct manufacturer instructions)
- 6 Penetration seal

VI. TECHNICAL DATA


Pressure loss

Pressure loss calculation

$$\Delta p = \xi \cdot \rho \cdot \frac{w^2}{2}$$


Δp	[Pa]	pressure loss
w	[m/s]	air flow speed in nominal damper section
ρ	[kg/m³]	air density
ξ	[-]	coefficient of local pressure loss for the nominal damper section → see pages 43 to 46

Determination of pressure loss by using diagram $\rho = 1,2 \text{ kg/m}^3$

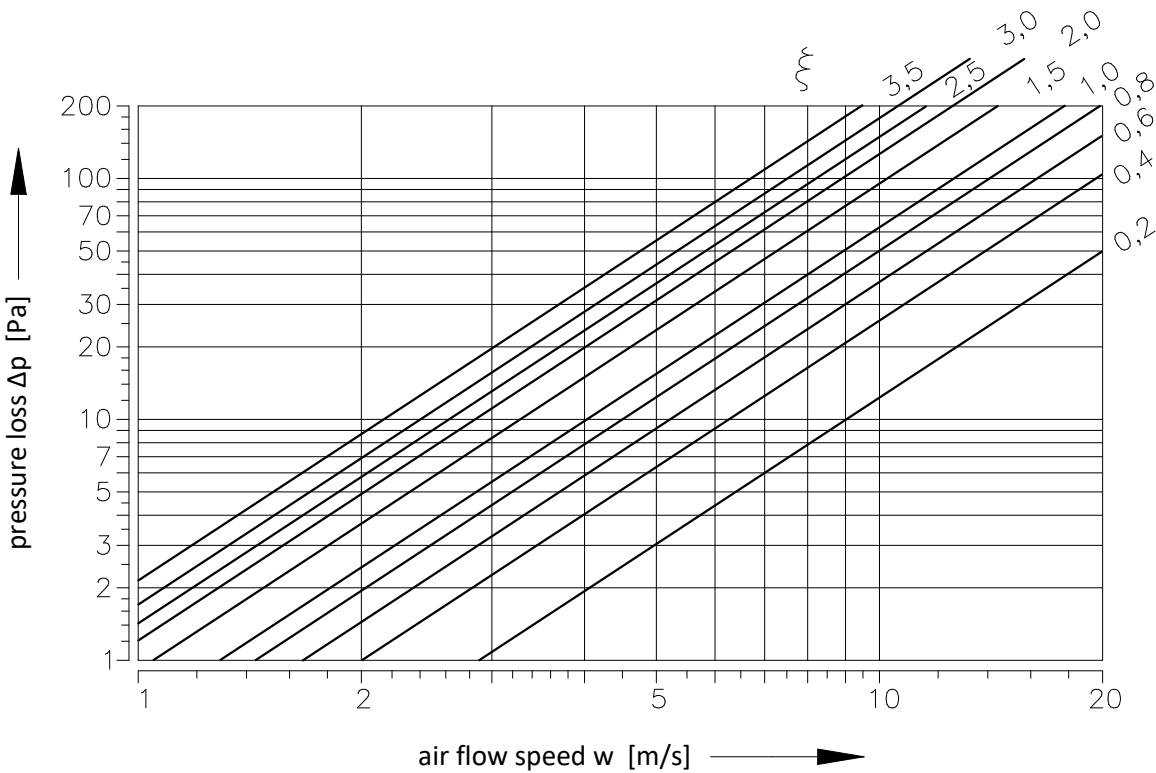


Coefficient of local pressure loss

Installation in duct

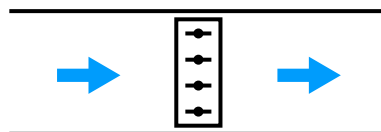


	B								
A	430	630	830	1030	1230	1430	1630	1830	2030
200	0,658	0,586	0,554	0,535	0,523	0,515	0,509	0,504	0,500
250	0,637	0,568	0,536	0,518	0,507	0,499	0,493	0,488	0,484
300	0,624	0,556	0,525	0,508	0,496	0,488	0,482	0,478	0,474
350	0,614	0,548	0,517	0,500	0,489	0,481	0,475	0,471	0,467
400	0,608	0,542	0,512	0,494	0,483	0,476	0,470	0,465	0,462
450	0,602	0,537	0,507	0,490	0,479	0,472	0,466	0,461	0,458
500	0,598	0,533	0,504	0,487	0,476	0,468	0,463	0,458	0,455
550	0,595	0,530	0,501	0,484	0,473	0,466	0,460	0,456	0,452
600	0,592	0,528	0,499	0,482	0,471	0,464	0,458	0,454	0,450
650	0,590	0,526	0,497	0,480	0,469	0,462	0,456	0,452	0,448
700	0,588	0,524	0,495	0,478	0,468	0,460	0,455	0,450	0,447
750	0,586	0,522	0,493	0,477	0,466	0,459	0,453	0,449	0,446
800	0,585	0,521	0,492	0,476	0,465	0,458	0,452	0,448	0,445
850	0,583	0,520	0,491	0,475	0,464	0,457	0,451	0,447	0,444
900	0,582	0,519	0,490	0,474	0,463	0,456	0,450	0,446	0,443
950	0,581	0,518	0,489	0,473	0,462	0,455	0,449	0,445	0,442
1000	0,580	0,517	0,488	0,472	0,462	0,454	0,449	0,444	0,441
1050	0,579	0,516	0,488	0,471	0,461	0,453	0,448	0,444	0,440
1100	0,579	0,516	0,487	0,471	0,460	0,453	0,447	0,443	0,440
1150	0,578	0,515	0,487	0,470	0,460	0,452	0,447	0,443	0,439
1200	0,577	0,515	0,486	0,470	0,459	0,452	0,446	0,442	0,439

Installation at the beginning of duct - without grille

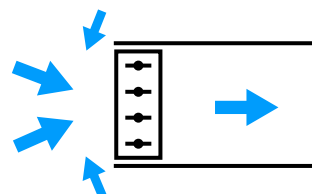


	B								
A	430	630	830	1030	1230	1430	1630	1830	2030
200	1,250	1,114	1,052	1,017	0,994	0,978	0,967	0,958	0,950
250	1,210	1,079	1,019	0,985	0,963	0,947	0,936	0,927	0,920
300	1,185	1,056	0,998	0,964	0,943	0,928	0,916	0,908	0,901
350	1,167	1,041	0,983	0,950	0,929	0,914	0,903	0,894	0,888
400	1,154	1,029	0,972	0,939	0,918	0,904	0,893	0,884	0,878
450	1,144	1,020	0,964	0,931	0,911	0,896	0,885	0,877	0,870
500	1,137	1,013	0,957	0,925	0,904	0,890	0,879	0,871	0,864
550	1,130	1,008	0,952	0,920	0,899	0,885	0,874	0,866	0,859
600	1,125	1,003	0,947	0,916	0,895	0,881	0,870	0,862	0,855
650	1,121	0,999	0,944	0,912	0,891	0,877	0,867	0,858	0,852
700	1,117	0,996	0,940	0,909	0,888	0,874	0,864	0,856	0,849
750	1,113	0,993	0,938	0,906	0,886	0,872	0,861	0,853	0,847
800	1,111	0,990	0,935	0,904	0,884	0,869	0,859	0,851	0,845
850	1,108	0,988	0,933	0,902	0,882	0,868	0,857	0,849	0,843
900	1,106	0,986	0,931	0,900	0,880	0,866	0,855	0,847	0,841
950	1,104	0,984	0,930	0,898	0,878	0,864	0,854	0,846	0,839
1000	1,102	0,983	0,928	0,897	0,877	0,863	0,852	0,844	0,838
1050	1,101	0,981	0,927	0,896	0,876	0,862	0,851	0,843	0,837
1100	1,099	0,980	0,926	0,895	0,875	0,860	0,850	0,842	0,836
1150	1,098	0,979	0,924	0,893	0,873	0,859	0,849	0,841	0,835
1200	1,097	0,978	0,923	0,893	0,872	0,858	0,848	0,840	0,834

Installation at the beginning of duct - with grille

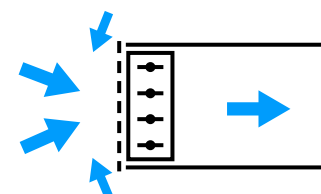


	B								
A	430	630	830	1030	1230	1430	1630	1830	2030
200	2,350	2,214	2,152	2,117	2,094	2,078	2,067	2,058	2,050
250	2,310	2,179	2,119	2,085	2,063	2,047	2,036	2,027	2,020
300	2,285	2,156	2,098	2,064	2,043	2,028	2,016	2,008	2,001
350	2,267	2,141	2,083	2,050	2,029	2,014	2,003	1,994	1,988
400	2,254	2,129	2,072	2,039	2,018	2,004	1,993	1,984	1,978
450	2,244	2,120	2,064	2,031	2,011	1,996	1,985	1,977	1,970
500	2,237	2,113	2,057	2,025	2,004	1,990	1,979	1,971	1,964
550	2,230	2,108	2,052	2,020	1,999	1,985	1,974	1,966	1,959
600	2,225	2,103	2,047	2,016	1,995	1,981	1,970	1,962	1,955
650	2,221	2,099	2,044	2,012	1,991	1,977	1,967	1,958	1,952
700	2,217	2,096	2,040	2,009	1,988	1,974	1,964	1,956	1,949
750	2,213	2,093	2,038	2,006	1,986	1,972	1,961	1,953	1,947
800	2,211	2,090	2,035	2,004	1,984	1,969	1,959	1,951	1,945
850	2,208	2,088	2,033	2,002	1,982	1,968	1,957	1,949	1,943
900	2,206	2,086	2,031	2,000	1,980	1,966	1,955	1,947	1,941
950	2,204	2,084	2,030	1,998	1,978	1,964	1,954	1,946	1,939
1000	2,202	2,083	2,028	1,997	1,977	1,963	1,952	1,944	1,938
1050	2,201	2,081	2,027	1,996	1,976	1,962	1,951	1,943	1,937
1100	2,199	2,080	2,026	1,995	1,975	1,960	1,950	1,942	1,936
1150	2,198	2,079	2,024	1,993	1,973	1,959	1,949	1,941	1,935
1200	2,197	2,078	2,023	1,993	1,972	1,958	1,948	1,940	1,934

Installation at the beginning of duct in the wall - without grille

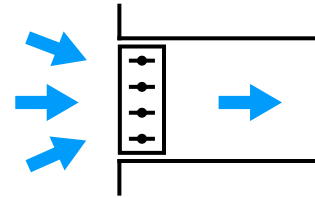


	B								
A	430	630	830	1030	1230	1430	1630	1830	2030
200	1,151	1,026	0,969	0,937	0,916	0,901	0,890	0,882	0,875
250	1,115	0,994	0,939	0,907	0,887	0,873	0,862	0,854	0,848
300	1,091	0,973	0,919	0,888	0,868	0,854	0,844	0,836	0,830
350	1,075	0,958	0,905	0,875	0,855	0,842	0,832	0,824	0,818
400	1,063	0,948	0,895	0,865	0,846	0,832	0,822	0,815	0,808
450	1,054	0,940	0,888	0,858	0,839	0,825	0,815	0,808	0,802
500	1,047	0,933	0,882	0,852	0,833	0,820	0,810	0,802	0,796
550	1,041	0,928	0,877	0,847	0,828	0,815	0,805	0,798	0,792
600	1,036	0,924	0,872	0,843	0,824	0,811	0,801	0,794	0,788
650	1,032	0,920	0,869	0,840	0,821	0,808	0,798	0,791	0,785
700	1,029	0,917	0,866	0,837	0,818	0,805	0,796	0,788	0,782
750	1,026	0,914	0,864	0,835	0,816	0,803	0,793	0,786	0,780
800	1,023	0,912	0,861	0,833	0,814	0,801	0,791	0,784	0,778
850	1,021	0,910	0,859	0,831	0,812	0,799	0,789	0,782	0,776
900	1,019	0,908	0,858	0,829	0,810	0,797	0,788	0,780	0,775
950	1,017	0,906	0,856	0,828	0,809	0,796	0,786	0,779	0,773
1000	1,015	0,905	0,855	0,826	0,808	0,795	0,785	0,778	0,772
1050	1,014	0,904	0,854	0,825	0,807	0,794	0,784	0,777	0,771
1100	1,012	0,903	0,853	0,824	0,805	0,793	0,783	0,776	0,770
1150	1,011	0,901	0,851	0,823	0,805	0,792	0,782	0,775	0,769
1200	1,010	0,900	0,851	0,822	0,804	0,791	0,781	0,774	0,768

Installation at the beginning of duct in the wall - with grille

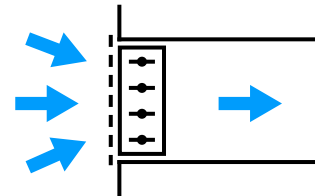


	B								
A	430	630	830	1030	1230	1430	1630	1830	2030
200	2,251	2,126	2,069	2,037	2,016	2,001	1,990	1,982	1,975
250	2,215	2,094	2,039	2,007	1,987	1,973	1,962	1,954	1,948
300	2,191	2,073	2,019	1,988	1,968	1,954	1,944	1,936	1,930
350	2,175	2,058	2,005	1,975	1,955	1,942	1,932	1,924	1,918
400	2,163	2,048	1,995	1,965	1,946	1,932	1,922	1,915	1,908
450	2,154	2,040	1,988	1,958	1,939	1,925	1,915	1,908	1,902
500	2,147	2,033	1,982	1,952	1,933	1,920	1,910	1,902	1,896
550	2,141	2,028	1,977	1,947	1,928	1,915	1,905	1,898	1,892
600	2,136	2,024	1,972	1,943	1,924	1,911	1,901	1,894	1,888
650	2,132	2,020	1,969	1,940	1,921	1,908	1,898	1,891	1,885
700	2,129	2,017	1,966	1,937	1,918	1,905	1,896	1,888	1,882
750	2,126	2,014	1,964	1,935	1,916	1,903	1,893	1,886	1,880
800	2,123	2,012	1,961	1,933	1,914	1,901	1,891	1,884	1,878
850	2,121	2,010	1,959	1,931	1,912	1,899	1,889	1,882	1,876
900	2,119	2,008	1,958	1,929	1,910	1,897	1,888	1,880	1,875
950	2,117	2,006	1,956	1,928	1,909	1,896	1,886	1,879	1,873
1000	2,115	2,005	1,955	1,926	1,908	1,895	1,885	1,878	1,872
1050	2,114	2,004	1,954	1,925	1,907	1,894	1,884	1,877	1,871
1100	2,112	2,003	1,953	1,924	1,905	1,893	1,883	1,876	1,870
1150	2,111	2,001	1,951	1,923	1,905	1,892	1,882	1,875	1,869
1200	2,110	2,000	1,951	1,922	1,904	1,891	1,881	1,874	1,868

Installation in the wall between the rooms - 1 grille

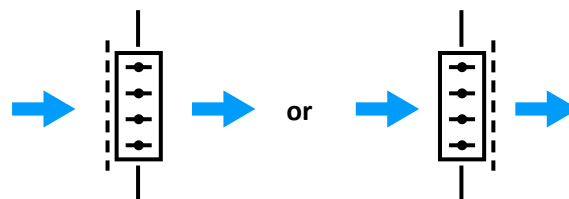

	B								
A	430	630	830	1030	1230	1430	1630	1830	2030
200	3,994	3,680	3,537	3,456	3,403	3,366	3,339	3,318	3,301
250	3,903	3,599	3,460	3,381	3,330	3,294	3,268	3,247	3,231
300	3,844	3,546	3,411	3,333	3,283	3,248	3,222	3,202	3,187
350	3,803	3,510	3,376	3,300	3,251	3,216	3,191	3,171	3,156
400	3,773	3,483	3,351	3,276	3,227	3,193	3,168	3,148	3,133
450	3,750	3,463	3,332	3,257	3,209	3,175	3,150	3,131	3,115
500	3,732	3,446	3,316	3,242	3,194	3,160	3,136	3,117	3,101
550	3,717	3,433	3,304	3,230	3,182	3,149	3,124	3,105	3,090
600	3,705	3,422	3,294	3,220	3,173	3,139	3,115	3,096	3,081
650	3,695	3,413	3,285	3,212	3,165	3,131	3,107	3,088	3,073
700	3,686	3,405	3,278	3,205	3,158	3,125	3,100	3,081	3,067
750	3,679	3,399	3,271	3,199	3,152	3,119	3,094	3,076	3,061
800	3,672	3,393	3,266	3,193	3,146	3,114	3,089	3,071	3,056
850	3,666	3,388	3,261	3,189	3,142	3,109	3,085	3,066	3,051
900	3,661	3,383	3,257	3,184	3,138	3,105	3,081	3,062	3,048
950	3,657	3,379	3,253	3,181	3,134	3,101	3,077	3,059	3,044
1000	3,652	3,375	3,249	3,177	3,131	3,098	3,074	3,056	3,041
1050	3,649	3,372	3,246	3,174	3,128	3,095	3,071	3,053	3,038
1100	3,645	3,369	3,243	3,172	3,125	3,093	3,069	3,050	3,036
1150	3,642	3,366	3,241	3,169	3,123	3,090	3,066	3,048	3,033
1200	3,640	3,364	3,239	3,167	3,121	3,088	3,064	3,046	3,031

Installation in the wall between the rooms - 2 grille



	B								
A	430	630	830	1030	1230	1430	1630	1830	2030
200	4,894	4,580	4,437	4,356	4,303	4,266	4,239	4,218	4,201
250	4,803	4,499	4,360	4,281	4,230	4,194	4,168	4,147	4,131
300	4,744	4,446	4,311	4,233	4,183	4,148	4,122	4,102	4,087
350	4,703	4,410	4,276	4,200	4,151	4,116	4,091	4,071	4,056
400	4,673	4,383	4,251	4,176	4,127	4,093	4,068	4,048	4,033
450	4,650	4,363	4,232	4,157	4,109	4,075	4,050	4,031	4,015
500	4,632	4,346	4,216	4,142	4,094	4,060	4,036	4,017	4,001
550	4,617	4,333	4,204	4,130	4,082	4,049	4,024	4,005	3,990
600	4,605	4,322	4,194	4,120	4,073	4,039	4,015	3,996	3,981
650	4,595	4,313	4,185	4,112	4,065	4,031	4,007	3,988	3,973
700	4,586	4,305	4,178	4,105	4,058	4,025	4,000	3,981	3,967
750	4,579	4,299	4,171	4,099	4,052	4,019	3,994	3,976	3,961
800	4,572	4,293	4,166	4,093	4,046	4,014	3,989	3,971	3,956
850	4,566	4,288	4,161	4,089	4,042	4,009	3,985	3,966	3,951
900	4,561	4,283	4,157	4,084	4,038	4,005	3,981	3,962	3,948
950	4,557	4,279	4,153	4,081	4,034	4,001	3,977	3,959	3,944
1000	4,552	4,275	4,149	4,077	4,031	3,998	3,974	3,956	3,941
1050	4,549	4,272	4,146	4,074	4,028	3,995	3,971	3,953	3,938
1100	4,545	4,269	4,143	4,072	4,025	3,993	3,969	3,950	3,936
1150	4,542	4,266	4,141	4,069	4,023	3,990	3,966	3,948	3,933
1200	4,540	4,264	4,139	4,067	4,021	3,988	3,964	3,946	3,931

Noise data - level of acoustic output corrected with filter A

Air velocity 2 m/s Level of acoustic output [dB]									
	B								
A	430	630	830	1030	1230	1430	1630	1830	2030
200	27	28	29	30	30	31	31	32	32
250	28	29	30	30	31	32	32	33	33
300	28	29	30	31	32	32	33	33	34
350	29	30	31	32	32	33	33	34	34
400	29	30	31	32	33	33	34	34	35
450	30	31	32	33	33	34	34	35	35
500	30	31	32	33	34	34	35	35	36
550	31	32	33	33	34	35	35	36	36
600	31	32	33	34	34	35	36	36	36
650	31	32	33	34	35	35	36	36	37
700	32	33	34	34	35	36	36	37	37
750	32	33	34	35	35	36	36	37	37
800	32	33	34	35	36	36	37	37	38
850	32	34	34	35	36	36	37	37	38
900	33	34	35	35	36	37	37	38	38
950	33	34	35	36	36	37	37	38	38
1000	33	34	35	36	37	37	38	38	39
1050	33	34	35	36	37	37	38	38	39
1100	34	35	36	36	37	38	38	39	39
1150	34	35	36	36	37	38	38	39	39
1200	34	35	36	37	37	38	38	39	39

Air velocity 3 m/s Level of acoustic output [dB]									
	B								
A	430	630	830	1030	1230	1430	1630	1830	2030
200	36	37	38	39	39	40	40	41	41
250	37	38	39	39	40	41	41	42	42
300	37	38	39	40	41	41	42	42	43
350	38	39	40	41	41	42	42	43	43
400	38	39	40	41	42	42	43	43	44
450	39	40	41	42	42	43	43	44	44
500	39	40	41	42	43	43	44	44	45
550	40	41	42	42	43	44	44	45	45
600	40	41	42	43	43	44	45	45	45
650	40	41	42	43	44	44	45	45	46
700	41	42	43	43	44	45	45	46	46
750	41	42	43	44	44	45	45	46	46
800	41	42	43	44	45	45	46	46	47
850	41	43	43	44	45	45	46	46	47
900	42	43	44	44	45	46	46	47	47
950	42	43	44	45	45	46	46	47	47
1000	42	43	44	45	46	46	47	47	48
1050	42	43	44	45	46	46	47	47	48
1100	43	44	45	45	46	47	47	48	48
1150	43	44	45	45	46	47	47	48	48
1200	43	44	45	46	46	47	47	48	48

Air velocity 4 m/s
Level of acoustic output [dB]

	B								
A	430	630	830	1030	1230	1430	1630	1830	2030
200	42	43	44	45	46	47	47	47	48
250	43	44	45	46	47	47	48	48	49
300	44	45	46	47	47	48	49	49	49
350	44	46	47	47	48	49	49	50	50
400	45	46	47	48	49	49	50	50	51
450	45	47	48	48	49	50	50	51	51
500	46	47	48	49	50	50	51	51	52
550	46	47	48	49	50	51	51	52	52
600	47	48	49	50	50	51	51	52	52
650	47	48	49	50	51	51	52	52	53
700	47	48	49	50	51	52	52	53	53
750	48	49	50	51	51	52	52	53	53
800	48	49	50	51	51	52	53	53	53
850	48	49	50	51	52	52	53	53	54
900	48	50	50	51	52	53	53	54	54
950	49	50	51	52	52	53	53	54	54
1000	49	50	51	52	52	53	54	54	54
1050	49	50	51	52	53	53	54	54	55
1100	49	50	51	52	53	53	54	54	55
1150	49	51	52	52	53	54	54	55	55
1200	50	51	52	53	53	54	54	55	55

Air velocity 5 m/s
Level of acoustic output [dB]

	B								
A	430	630	830	1030	1230	1430	1630	1830	2030
200	49	50	51	52	53	54	54	54	55
250	50	51	52	53	54	54	55	55	56
300	51	52	53	54	54	55	56	56	56
350	51	53	54	54	55	56	56	57	57
400	52	53	54	55	56	56	57	57	58
450	52	54	55	55	56	57	57	58	58
500	53	54	55	56	57	57	58	58	59
550	53	54	55	56	57	58	58	59	59
600	54	55	56	57	57	58	58	59	59
650	54	55	56	57	58	58	59	59	60
700	54	55	56	57	58	59	59	60	60
750	55	56	57	58	58	59	59	60	60
800	55	56	57	58	58	59	60	60	60
850	55	56	57	58	59	59	60	60	61
900	55	57	57	58	59	60	60	61	61
950	56	57	58	59	59	60	60	61	61
1000	56	57	58	59	59	60	61	61	61
1050	56	57	58	59	60	60	61	61	62
1100	56	57	58	59	60	60	61	61	62
1150	56	58	59	59	60	61	61	62	62
1200	57	58	59	60	60	61	61	62	62

Air velocity 6 m/s
Level of acoustic output [dB]

	B								
A	430	630	830	1030	1230	1430	1630	1830	2030
200	54	55	56	57	58	58	59	59	60
250	55	56	57	58	59	59	60	60	61
300	55	57	58	59	59	60	60	61	61
350	56	57	58	59	60	60	61	61	62
400	57	58	59	60	60	61	62	62	62
450	57	58	59	60	61	62	62	63	63
500	57	59	60	61	61	62	62	63	63
550	58	59	60	61	62	62	63	63	64
600	58	60	61	61	62	63	63	64	64
650	59	60	61	62	62	63	64	64	64
700	59	60	61	62	63	63	64	64	65
750	59	60	61	62	63	64	64	65	65
800	59	61	62	63	63	64	64	65	65
850	60	61	62	63	64	64	65	65	66
900	60	61	62	63	64	64	65	65	66
950	60	61	62	63	64	65	65	66	66
1000	60	62	63	64	64	65	65	66	66
1050	61	62	63	64	64	65	66	66	67
1100	61	62	63	64	65	65	66	66	67
1150	61	62	63	64	65	65	66	66	67
1200	61	62	63	64	65	66	66	67	67

Air velocity 8 m/s
Level of acoustic output [dB]

	B								
A	430	630	830	1030	1230	1430	1630	1830	2030
200	60	62	63	64	64	65	66	66	66
250	61	63	64	65	65	66	66	67	67
300	62	63	64	65	66	67	67	68	68
350	63	64	65	66	67	67	68	68	69
400	63	65	66	67	67	68	68	69	69
450	64	65	66	67	68	68	69	69	70
500	64	66	67	67	68	69	69	70	70
550	65	66	67	68	69	69	70	70	71
600	65	66	67	68	69	70	70	71	71
650	65	67	68	69	69	70	70	71	71
700	66	67	68	69	70	70	71	71	72
750	66	67	68	69	70	71	71	72	72
800	66	68	69	69	70	71	71	72	72
850	66	68	69	70	70	71	72	72	73
900	67	68	69	70	71	71	72	72	73
950	67	68	69	70	71	72	72	73	73
1000	67	68	70	70	71	72	72	73	73
1050	67	69	70	71	71	72	73	73	73
1100	67	69	70	71	72	72	73	73	74
1150	68	69	70	71	72	72	73	73	74
1200	68	69	70	71	72	73	73	74	74

Air velocity 10 m/s
Level of acoustic output [dB]

	B								
A	430	630	830	1030	1230	1430	1630	1830	2030
200	66	68	69	70	70	71	72	72	72
250	67	69	70	71	71	72	72	73	73
300	68	69	70	71	72	73	73	74	74
350	68	70	71	72	73	73	74	74	75
400	69	71	72	72	73	74	74	75	75
450	70	71	72	73	74	74	75	75	76
500	70	71	73	73	74	75	75	76	76
550	70	72	73	74	75	75	76	76	77
600	71	72	73	74	75	76	76	77	77
650	71	73	74	75	75	76	76	77	77
700	71	73	74	75	76	76	77	77	78
750	72	73	74	75	76	77	77	78	78
800	72	73	75	75	76	77	77	78	78
850	72	74	75	76	76	77	78	78	79
900	72	74	75	76	77	77	78	78	79
950	73	74	75	76	77	78	78	79	79
1000	73	74	76	76	77	78	78	79	79
1050	73	75	76	77	77	78	79	79	79
1100	73	75	76	77	78	78	79	79	80
1150	74	75	76	77	78	78	79	79	80
1200	74	75	76	77	78	79	79	80	80

Air velocity 12 m/s
Level of acoustic output [dB]

	B								
A	430	630	830	1030	1230	1430	1630	1830	2030
200	71	73	74	75	75	76	76	77	77
250	72	73	75	75	76	77	77	78	78
300	73	74	75	76	77	78	78	79	79
350	73	75	76	77	78	78	79	79	80
400	74	75	77	77	78	79	79	80	80
450	74	76	77	78	79	79	80	80	81
500	75	76	77	78	79	80	80	81	81
550	75	77	78	79	80	80	81	81	82
600	76	77	78	79	80	81	81	82	82
650	76	77	79	79	80	81	81	82	82
700	76	78	79	80	81	81	82	82	83
750	77	78	79	80	81	81	82	83	83
800	77	78	79	80	81	82	82	83	83
850	77	79	80	81	81	82	83	83	84
900	77	79	80	81	82	82	83	83	84
950	78	79	80	81	82	82	83	84	84
1000	78	79	80	81	82	83	83	84	84
1050	78	80	81	82	82	83	83	84	84
1100	78	80	81	82	82	83	84	84	85
1150	78	80	81	82	83	83	84	84	85
1200	79	80	81	82	83	84	84	85	85

VII. MATERIAL, FINISHING

- Damper casings and blades are made of fire resistant asbestos free boards made of mineral fibres.
- Damper bodies and blades can be coated with Promat 2000 anti-moisture coating or Promat-SR anti-aggressive coating.
- Fasteners are galvanized.
- Any other requirements for the design shall be considered atypical and shall be addressed on an individual basis.

VIII. TRANSPORTATION, STORAGE AND WARRANTY

Logistic terms

- Dampers are delivered on special pallets. As standard, the dampers are wrapped in plastic foil for protection during transport and must not be used for long-term storage of the equipment. Changes in temperature during transport may cause condensation of water vapour inside the packaging and thereby conditions may arise inside the packaging that are suitable for corrosion of materials used in the equipment (e.g. white corrosion on zinc-coated items or mould on calcium silicate). Therefore, it is necessary to remove the transport packaging immediately after unloading to allow air to circulate around the product.
- The equipment must be stored in clean, dry, well ventilated and dust-free environment out of direct sunlight. ensuring protection against moisture and extremes of temperatures (minimum temperature +5°C) the equipment must be protected against mechanical and accidental damage prior to installation.
- Another required packaging system should be approved and agreed by manufacturer. Packaging material is not returnable in case that another packaging system (material) is required and used and it is not included into final price of damper.
- For unloading and further manipulation with the damper is necessary to use appropriate tooling (forklifts) due to damper weight. Dampers are fragile.
- Dampers are transported by box freight vehicles without direct weather impact, there must not occur any shocks and ambient temperature must not exceed +50°C. Dampers must be protected against impact when transported and manipulated. During transportation, the damper blades must be in the "CLOSED" position.
- Dampers are stored indoor in environment without any aggressive vapours, gases or dust. Indoor temperature must be in the range from -30°C to +50°C and maximum relative humidity 95% (avoid condensation on the damper body). Dampers must be protected against impact when transported and manipulated.

Warranty

- The manufacturer provides a warranty of 24 months from the date of dispatch for the dampers.
- The warranty for fire dampers SEDM-L, provided by the manufacturer, is completely void if actuating, closing and control devices are unprofessionally handled by untrained workers or if electric components, i.e. actuators.
- The warranty is void if dampers are used for other purposes, devices and working conditions than those allowed by these technical conditions or if the dampers are mechanically damaged during handling.
- If the dampers are damaged by transport, a record must be written down with the forwarder at reception for later complaint.


IX. ASSEMBLY, ATTENDANCE AND MAINTENANCE

- Assembly, maintenance and damper function check can be done only by qualified and trained person, i.e. "AUTHORIZED PERSON" according to the manufacturer documentation. All works done on the smoke control dampers must be done according international and local norms and laws.
- All effective safety standards and directives must be observed during damper assembly.
- To ensure reliable smoke exhaust damper function it is necessary to avoid blocking the closing mechanism and contact surfaces with collected dust, fibre and sticky materials and solvents.
- Manual operation
 - Without power supply, the damper can be operated manually and fixed in any required position.

Electrical connection of the actuator in protection box

Protection box without slot or predrilled holes


- Drill two holes into the protection box (from outside to inside) and pull through field wiring cables (CAT 3 fire resistant cables as BS 8519) to connect to the actuator trailing lead inside the housing, using a standard screwed cable connector block, the protection box is made of calcium silicate plates.
- Procedure
 - Use drill (drill size acc. To suit connecting cable $\varnothing + 2$ mm for seal up by mastic) and make two holes. It is possible to drill holes in any side of the housing.
 - Pull the heat resistant cable through the calcium silicate plate (wall) and connect with cables from actuator acc. to above mentioned electrical diagram.
 - Seal up the space around cable with fire resistant mastic (HILTI CFS-S ACR, PROMASTOP) or equivalent.
 - Let the mastic harden.

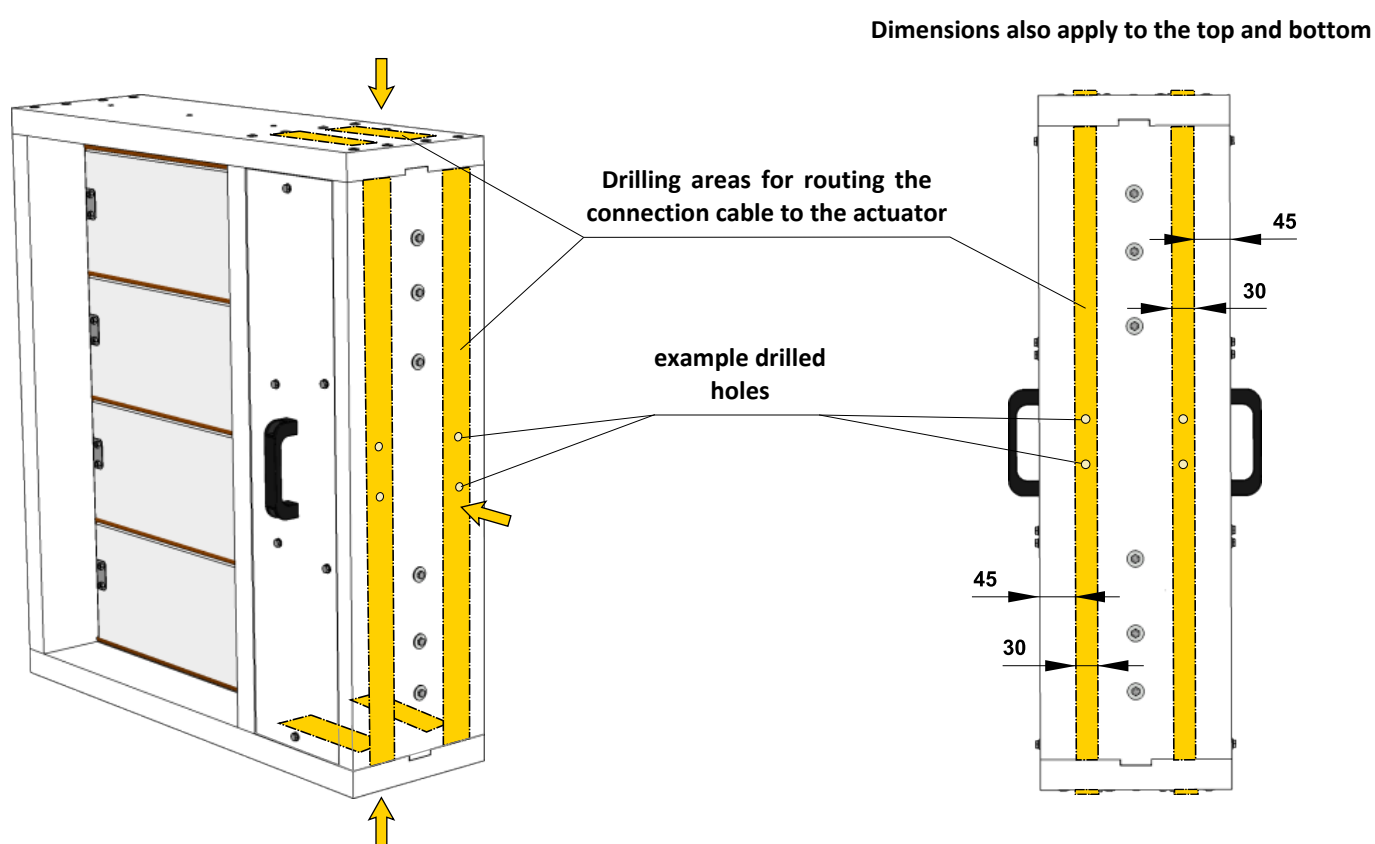

Example of position of holes in the wall of the box, without pre-manufactured slot

Entry into service and revisions

- Before entering the dampers into operation after assembly and after sequential revisions, checks and functionality tests of all designs including operation of the electrical components must be successfully provided and finished. After entering into operation, these revisions must be done according to requirement set by national regulations.
- In case that dampers are found unable to serve for their function for any cause, it must be clearly marked. The operator is obliged to ensure that the damper is put into condition in which it is ready for function and meanwhile he is obliged to provide the fire protection by another appropriate way.
- Removing actuator housing cover (from both sides)
 - Release actuator housing cover by unscrewing all the screws located on the cover.
- Results of regular checks, imperfections found and all-important facts connected with the damper function must be recorded in the "FIRE BOOK" and immediately reported to the operator.
- Before entering the dampers into operation after their assembly and by sequential checks, the following checks must be carried out for all designs.
- Visual inspection of proper damper integration, inside damper area, damper blade, contact surfaces and silicon sealing.

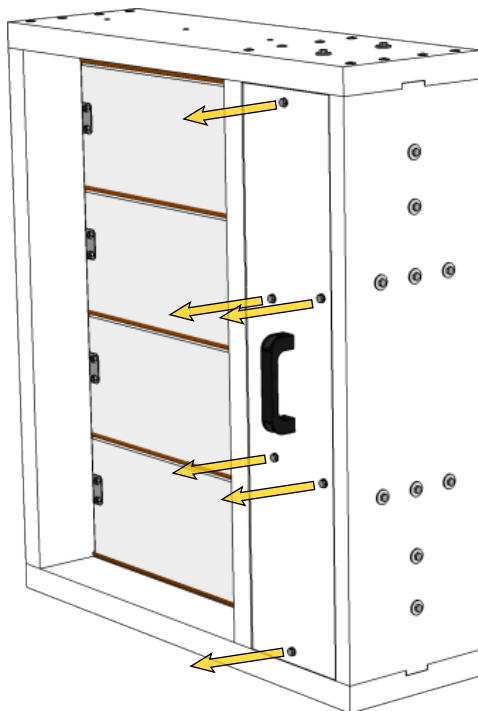

Actuator housing cover detail

- Ensure each damper is fully checked for operational capability, control should be initiated from the control system. Dampers blades should open and close correctly and operation should be visually inspected and documented prior to handover.

X. ORDERING INFORMATION

Ordering key

1	2	3	4	5	6	7	8	9
SEDM-L	EN	1200x2030	.44	/ M1	/ P2	Q30	- ZN	IW

EXAMPLE:

SEDM-L EN 1200x2030 .44/M1/P2 Q30-ZN

Smoke control damper SEDM-L, dimension 1200x2030 mm, control design with actuating mechanism AC 230 V, flange and cover grille KMM over blades (on one side), flange over damper (on other side), flange dimension 30 mm, galvanized material variant.

1 | Type of smoke control damper - SEDM-L

2 | Country of destination

3 | Damper dimensions A x B → see pages 12 to 14

„A“ is the width of the damper

„B“ is the height of the damper

4 | Damper design

.44	With actuating mechanism BEN, BEE, BE for 230V
.54	With actuating mechanism BEN, BEE, BE for 24V
.65*	With actuating mechanism BEN (BEE)-SR for 24V

* Design .65 is not available by using actuating mechanism BE.

5 | Flange/Cover grille KMM (on one side)

	Without flange and without KMM cover grille
P1	Flange over blades
P2	Flange over damper
M1	Flange and cover grille KMM over blades*
M2	Flange and cover grille KMM over damper*

* The surface of the cover grille KMM is provided with powder coating, standard colour is the RAL 9010. Requirements for other colour of the cover grille KMM, must be discussed in advance with the manufacturer.

6 | Flange/Cover grille KMM (on other side)

	Without flange and without KMM cover grille
P1	Flange over blades
P2	Flange over damper
M1	Flange and cover grille KMM over blades*
M2	Flange and cover grille KMM over damper*

* The surface of the cover grille KMM is provided with powder coating, standard colour is the RAL 9010. Requirements for other colour of the cover grille KMM, must be discussed in advance with the manufacturer.

7 | Flange dimension

Q30	Flange width 30 mm
-----	--------------------

8 | Material

ZN	Galvanized
----	------------

9 | Surface treatment

	Without surface treatment
IW	Damper blade impregnation, impregnating agent PROMAT 2000 - impregnation against humidity
IA	Damper blade impregnation, impregnating agent PROMAT SR - impregnation against chemical

Accessories

Flange



- 1 | Accessory type - flange
- 3 | Type of smoke control damper - SEDM-L
- 4 | Damper dimensions A x B → see pages 12 to 14

2 Flange design	
P1	Flange over blades
P2	Flange over damper

Cover grille KMM



- 1 | Accessory type - cover grille KMM
- 3 | Type of smoke control damper - SEDM-L
- 4 | Damper dimensions A x B → see pages 12 to 14

2 Cover grille KMM design*	
M1	Cover grille KMM over blades
M2	Cover grille KMM over damper

* The surface of the cover grille KMM is provided with powder coating, standard colour is the RAL 9010. Requirements for other colour of the cover grille KMM, must be discussed in advance with the manufacturer.

Installation holder



- 1 | Accessory type - installation holder
- 2 | Installation holder design

L = 500	Length 500 mm
L = 250	Length 250 mm

Data label

- Data label is placed on the damper casing (example)

MANDÍK®

MANDÍK, a.s.
Dobříšská 550, 267 24 Hostomice, Czech Republic

MULTI COMPARTMENT SMOKE CONTROL DAMPER - XXXX

DIMENSION:

DESIGN:

SERIAL.NO.:

WEIGHT (kg):

CLASSIFICATION:

TPM XXX/XX

Cert. No.: 1391-CPR-XXXX/XXXX, DoP: PM/XXXX/XX/XX/X

XX

EN 12101:2011


MANUAL


1391

The producer reserves the right for innovations of the product.
For actual product information see www.mandik.com

MANDÍK[®]
www.mandik.com

